


25.06.08

P_{ab} [kW]
 I [A]
 n [min⁻¹]
 η %

GNDO 1512-D ; 0,55kW - 1400min⁻¹ ; 24/24V - 30/1,5A ; duty S1

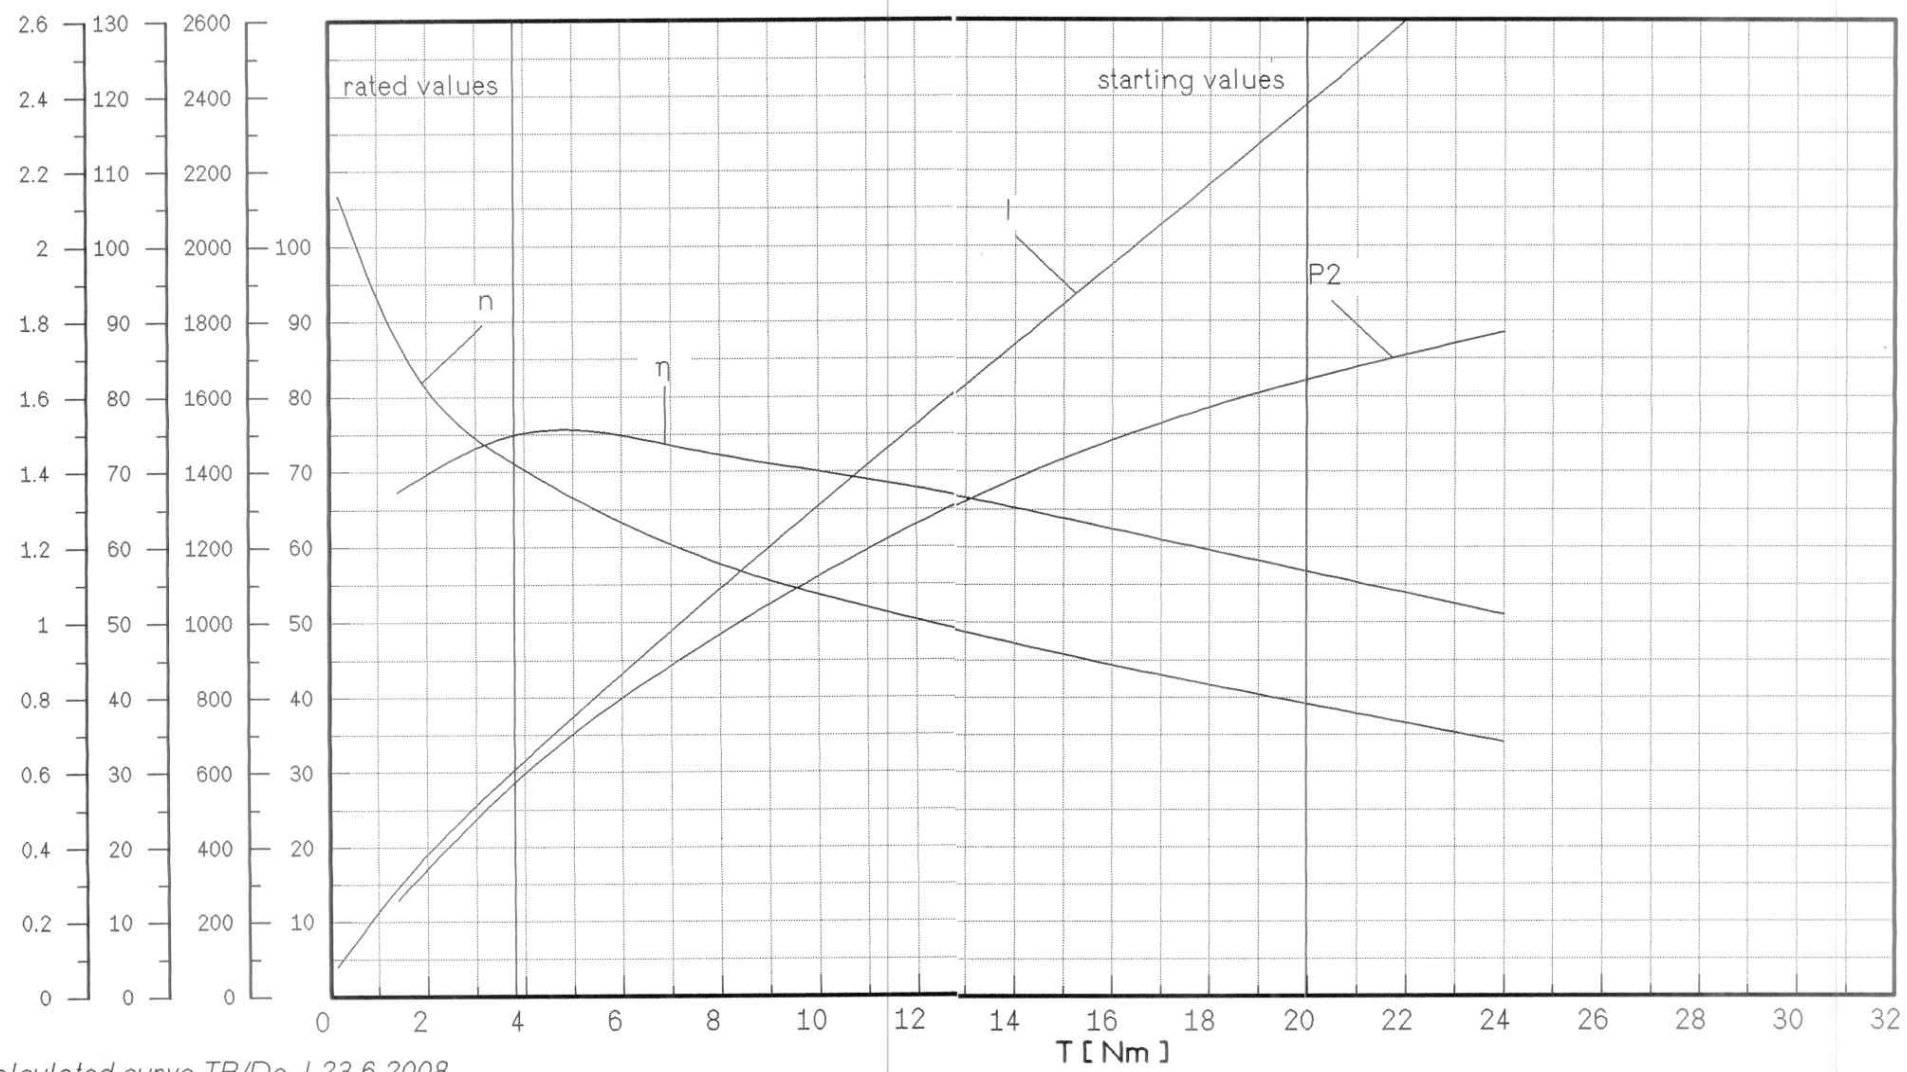

calculated curve TB/De | 23.6.2008