THE PROPERTY OF BORG-WARNER CORP.
FURNISHED ONLY FOR THE PURPOSE
AND ALL CONFIDENTIAL, PROPRIETARY

BYRON JACKSON

Min flow = 870 gpm

CERTIFIED CORRECT
SENIOR TEST ENGINEER

UNLESS OTHERWISE SPECIFICALLY AGREED, THE CAPACITY, HEAD AND EFFICIENCY GUARANTEES ARE BASED ON SHOP TESTS AND WHEN HANDLING CLEAR, COLD, FRESH WATER AT A TEMPERATURE OF NOT OVER 85 DEGREES F. THE GUARANTEE IS AT THE SPECIFIED RATING ONLY AND DOES NOT COVER SUSTAINED PERFORMANCE OVER ANY PERIOD OF TIME, NOR UNDER CONDITIONS VARYING FROM THE ABOVE.

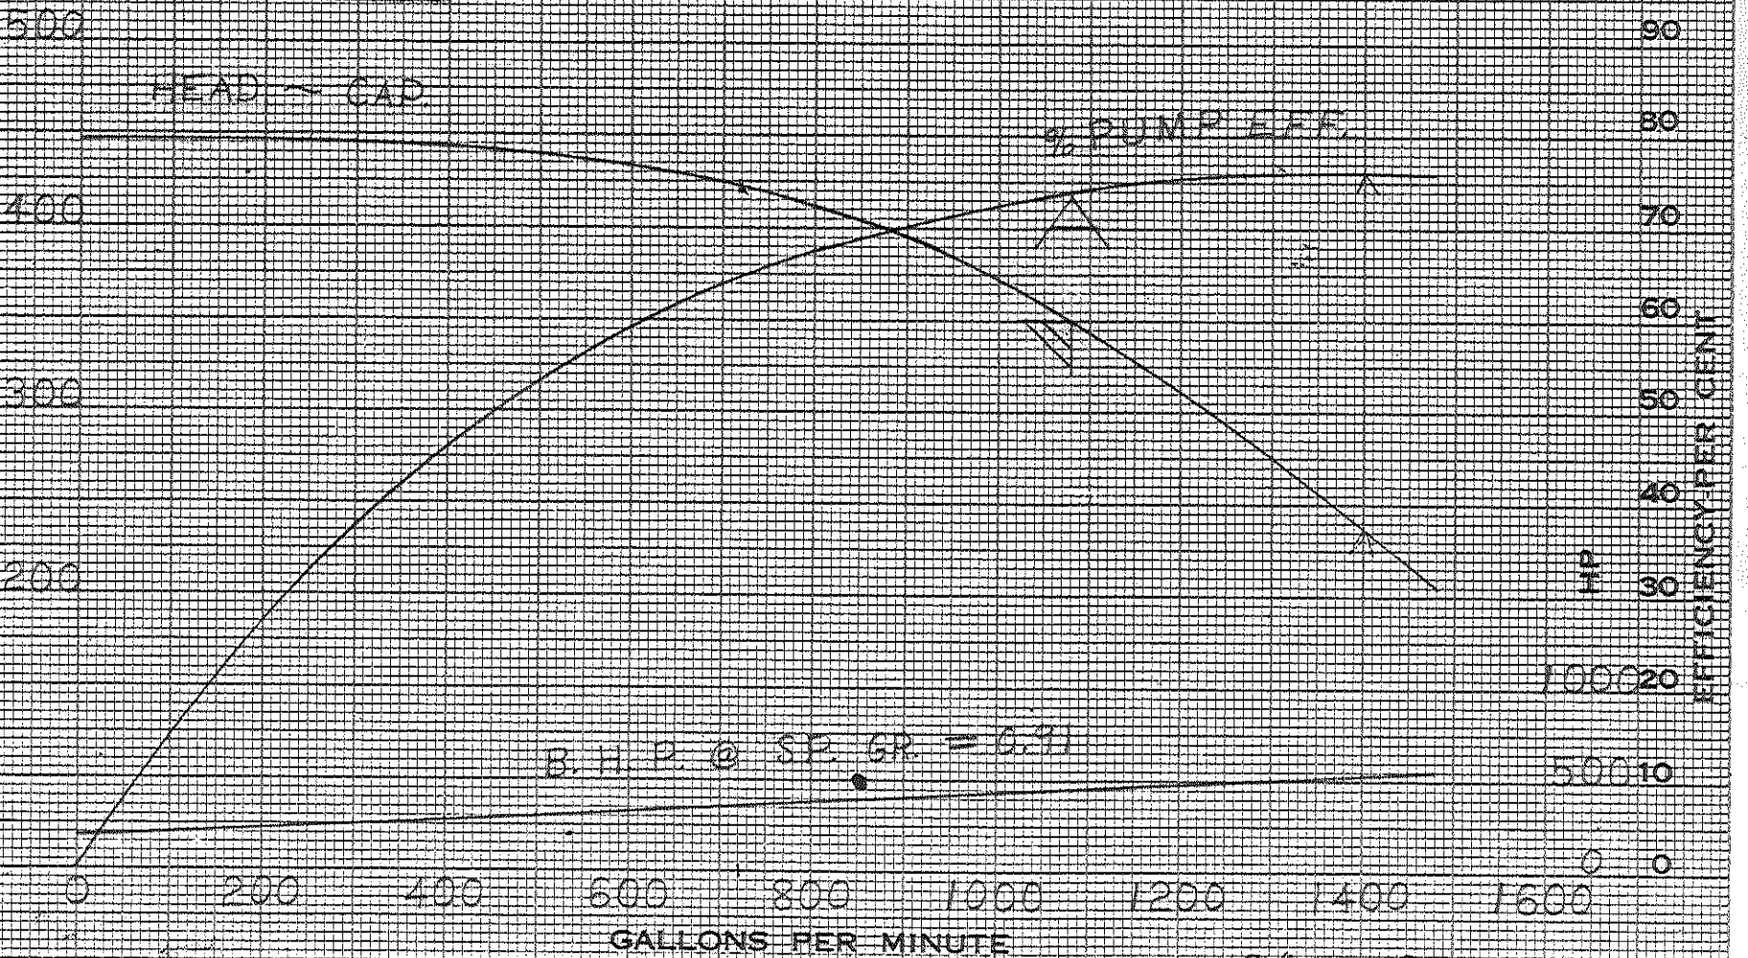

FE BADGER CO.
O.# E-3750-103 ITEM# 3P101

1ST STG. R-3274 12 7/8" DIA. SUCTION EYE VANE TRIMS OVER FILED TO 1/16 X 2
2ND STG. R-3536 12 7/8" DIA.

AND TYPE	RPM	ASSEMBLY NO.	IMPELLER NO. / DIA / UNDER / OVER / FILED TO			BYRON JACKSON TEST
6x14 GSJ H	3550	FACTORY NO. 711-N-0218.	DATE 3-7-72	DATA BY F.J.	DRAWN BY F.J.	T-32880-1

T.T.I. No. 3820.