


• CTM •

INST  
 $I_1$  amp



INST  
 $I_2$  amp

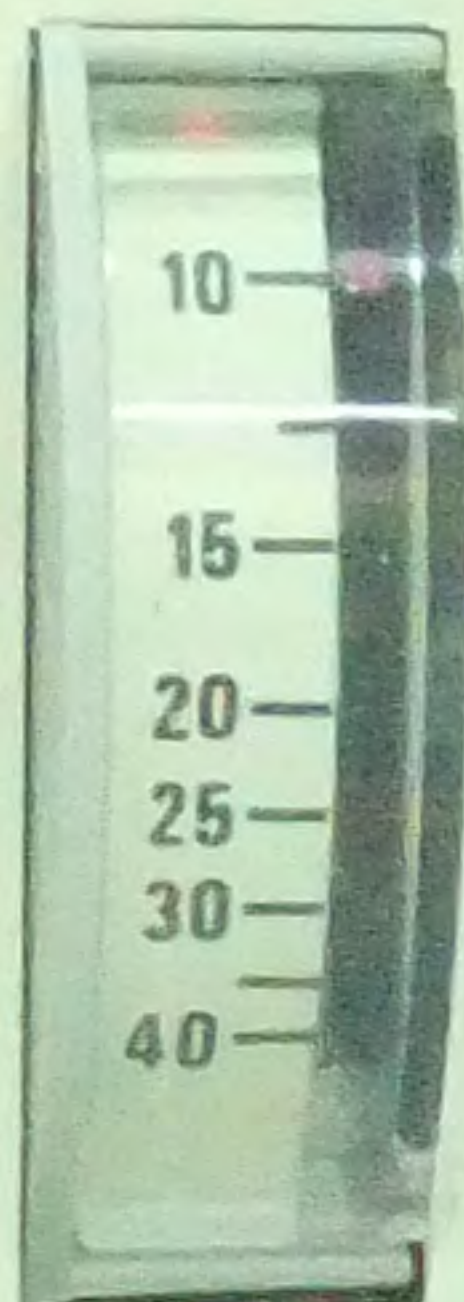

INST.  $I_0$  1 amp

NO  
SEÑALIZA  
(SCN 966A315A)



CTM 44PF2AC3251J  
Nº 040164H

$I_n$  5 A 50 Hz  
 $V_x$  220/250 V  $\sim$   
( $R_{ext}$  1K  $\Omega$ )

Th  
R

↑  
R



Th  
 $I_5$  amp



GEC Measurements Made in UK

Calibró / Preparó		Firma
FEV 15. 2011		MM
Fecha		
Vto.		

(SCN 966A315A)

1 2 3 4 5 6 7 8 9 10