


DRY RUBBLE MASONRY RETAINING WALLS


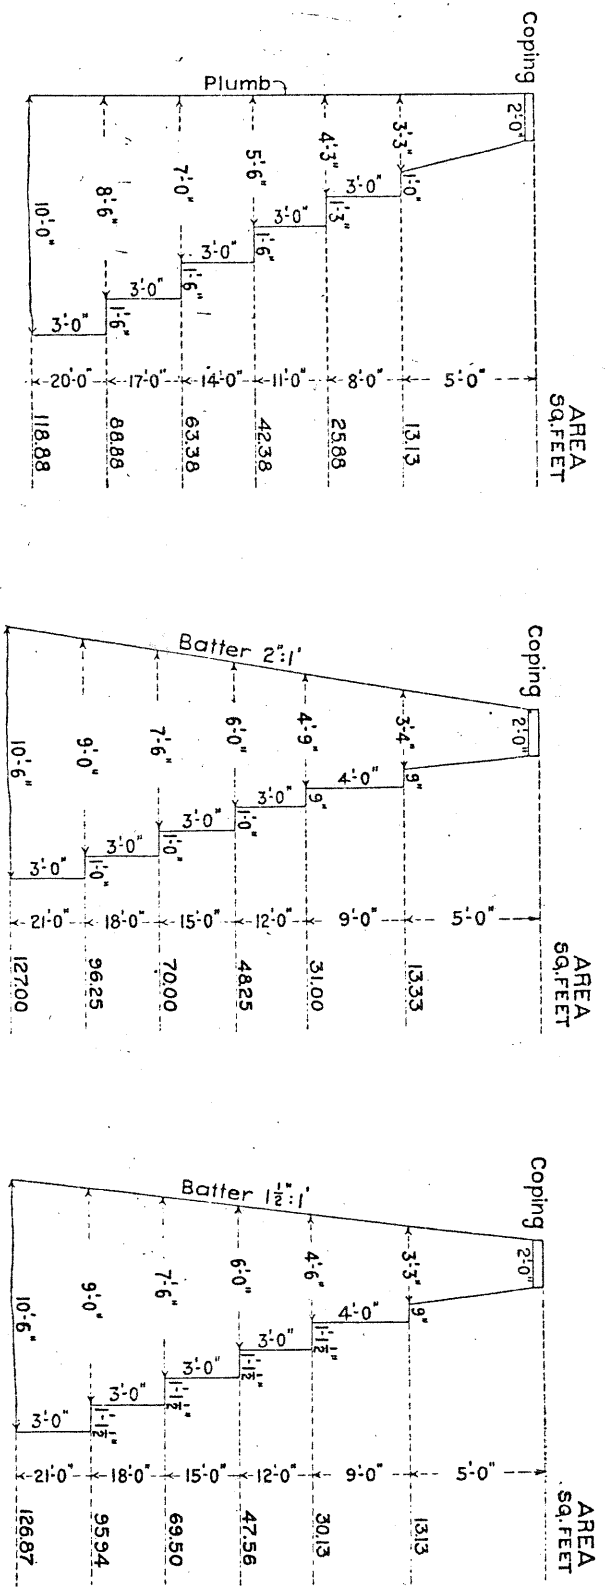


DRY RUBBLE MASONRY CULVERT

DIMENSIONS

W	H	a	b	c	d	e
1'-6"	1'-6"	3'-6"	1'-6"	2'-0"	1'-0"	0'-6"
2'-0"	2'-0"	4'-0"	1'-6"	2'-0"	1'-0"	0'-8"
2'-6"	2'-6"	4'-6"	1'-6"	2'-0"	1'-0"	0'-10"
3'-0"	3'-0"	5'-0"	2'-0"	2'-6"	1'-6"	1'-0"

Note: The dimensions H, c and d may be increased, if the conditions require it.

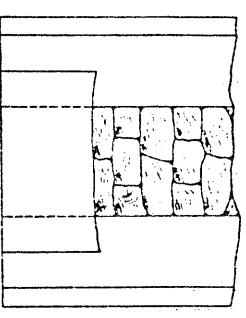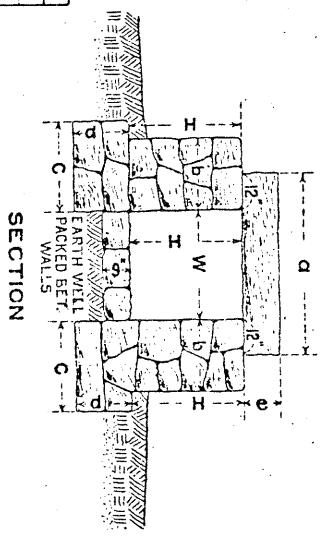

Note: Foundations of Retaining Walls may be widened if conditions require it.
For Walls of different batter or greater height than shown, details will be furnished during construction.
The contractor may, at his option, furnish and place coping, as shown hereon, of stone or Class B concrete.
For Stone Coping the minimum thickness shall be 5 inches.
For Concrete Coping the thickness shall be 7 inches.

CITY OF NEW YORK
PRESIDENT OF THE BOROUGH OF THE BRONX
DRY RUBBLE MASONRY
RETAINING WALLS
AND CULVERTS