


EINSCHALTSTROMVERLAUF / INRUSH CURRENT CURVE

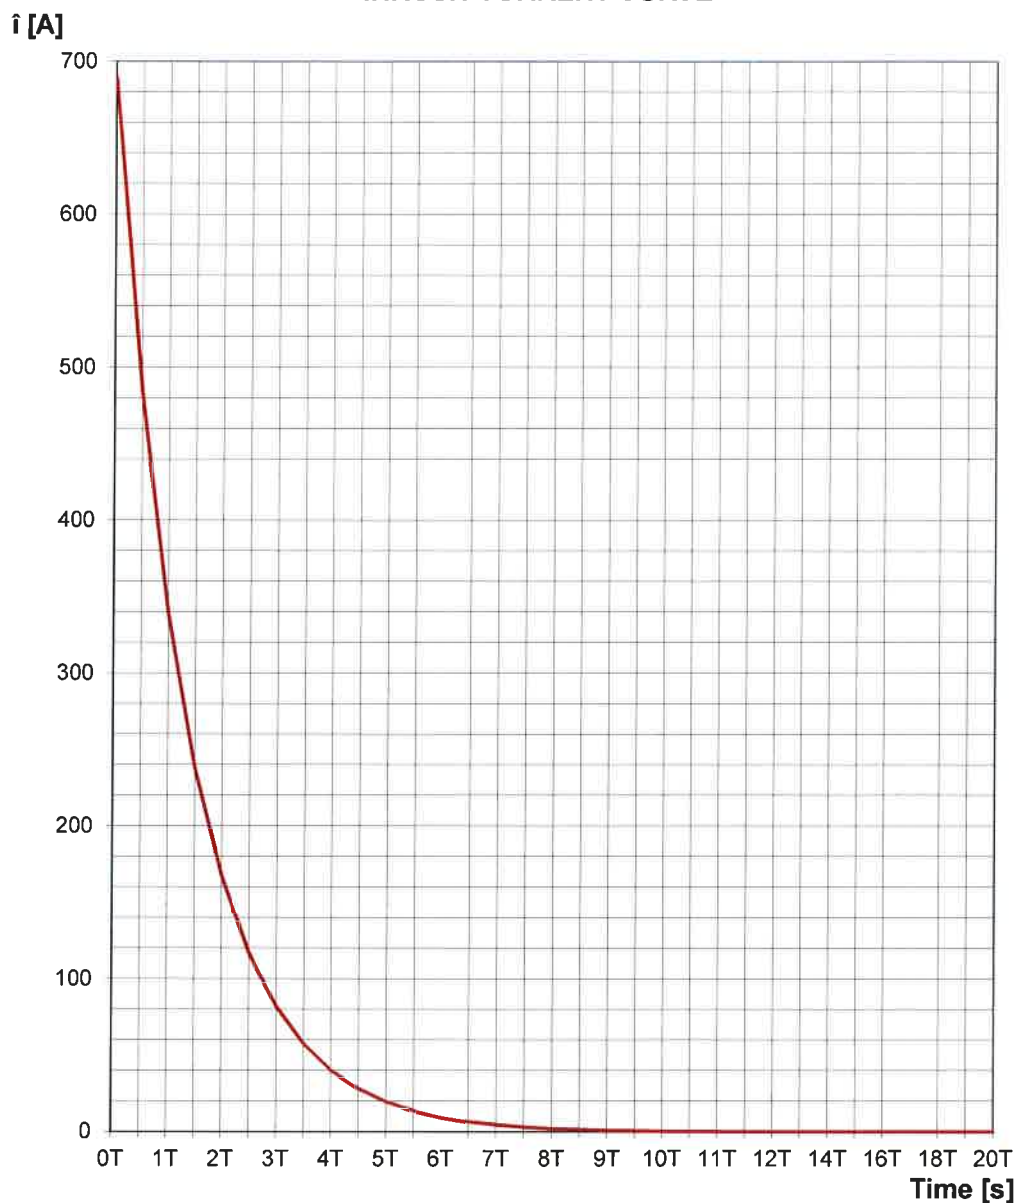

1T = Halbwertszeit / Half-crest-value time

1T = 0,451 s

TG5_1000m_Spec_F302_254_27112013.R9

Transformator / Transformer:					Maßstab/Scale:	
2800 kVA 33 kV / 0,660 kV					Kunde / Customer:	
Dy5					EINSCHALTSTROMVERLAUF INRUSH CURRENT CURVE	
			Editor	Datum/Date		
			Auditor	26.07.2014		
			Standard			
			ANR	39648984-8985		SIEMENS DK D
Status	Change	Date	Name	Auditor	EDV Nr.:	