


SYMBOL	NAME	TYPE	QTY	SOURCE	PARTS No.	STANDARD No.	REMARKS
EV1	FAN	ASF80372-DC24V	1	MATSUSHITA	M304776	DC24V	
GS1	POWER SUPPLY	BWT24SX-U	1	ETA	M305966	VOE:EN60950, (UL1950)	
KA1	RELAY	HH52PW-CRL-AC200/220V	1	FUJII	M103210	UL-E42419, CSA-LR20479, TUV-R9251339	
	SOCKET	TP58X1	1	FUJII	M103211	UL-E90265, CSA-LR20479, TUV-T9251612	
KA2	SAFETY RELAY	G9S-2002	1	OMRON	M103422	UL-E95399, CSA-LR35535, BIA-R974021	
KM1	MAGNETIC CONTACTOR	SJ-0G/UL-1A-DC24V	1	FUJII	M102723	UL-E42419, CSA-LR20479, EN60947-4-1	
KM2	MAGNETIC CONTACTOR	SD-Q19-1A1B-DC24V	1	mitsubishi	M102954	UL-E58968, CSA-E58968, TUV-R9251629	
M1,2	GEARMOTOR	CNVM01-5085-87-0.1KW-200V-NC	2	SUMITOMO	M305215	A TYPE	
	GEARMOTOR	CNVM02-E085-59-0.2KW-200V-NC	2	SUMITOMO	M307334	B TYPE	
M3	GEARMOTOR	GMT040U20-0.4KW-200V-NC	1	TSUBAKI	M306052		
M4	GEARMOTOR	GM-H2-0.4KW-1/30-TB-200V	1	mitsubishi	M304199		
M5	MOTOR	GFM-15-20-T90K-TB-200V NTSS	1	NISSEI	M306872		
PT1	HOUR METER	H7ET-NV	1	OMRON	M800687	UL-E67871, CSA-LR22310	
QF1	MAIN SW	P1-25/EA/SVB	1	K.M	M001849	UL-E36332, IEC-408	
QF2	BREAKER	NF50-FHU-3P-10A	1	mitsubishi	M201376	UL-134317, CSA-LR103083, EN60947-2	
	TERMINAL COVER	TCS-05FH3	1	mitsubishi	M201368		
RV1	SURGE ABSORBER	RFM2E145K PD	1	MARUCON	M400893		
SB1	PUSH BUTTON SW	AR22V2R-01R	1	FUJII	M003591	UL-E44592, TUV-R9551062	
SQ1	PROXIMITY SW	TL-Q5MC1	1	OMRON	M001812	DC24V	10mA
SQ2,3	LIMIT SW	02044	2	GUARD MASTER	M003484	BS5304	
SQ4	LIMIT SW	02075	1	GUARD MASTER	M003545	BS5304	
TM1	TRANSFORMER	220-380-415/200V3KVA/3	1	KOWA	M305119		
U5	INVERTER	FR-E520-0.1K	1	mitsubishi	M103057	UL-E131592, CSA-C22.2 No.14, VDE0160	
U1,2	INVERTER	FR-E520-0.2K	2	mitsubishi	M103058	UL-E131592, CSA-C22.2 No.14, VDE0160	
U3,4	INVERTER	FR-E520-0.4K	2	mitsubishi	M103059	UL-E131592, CSA-C22.2 No.14, VDE0160	
U6	OPERATION PANEL	AB60C-0002/ANO	1	FUJII	M900302	DC24V	500mA
XS2,3	CONNECTOR RECEPTACLE	WK6420	2	MATSUSHITA	M500683		
XS4	CONNECTOR FEMALE INSERT	HBE6-10.1910	1	CONTACT	M500629	UL-E75770	
	CONNECTOR 6P		1	RHEON	B024700		
XT1	TERMINAL BLOCK	BA111T(3P)	9	IZUMI	M500508	UL-E78117, CSA-LR64803	
XT2	TERMINAL BLOCK	PCN-1H34	1	TOGI	M501203	DC24V	
XT3	TERMINAL BLOCK	CTW-15S2	9	TOGI	M501204	DC24V, DC5V	
Z1	NOISE FILTER	3XYEB-105,104	1	OKAYA	M401121		

☆ IS OPTIONAL PARTS

K.M=KLOCKNER MOELLER

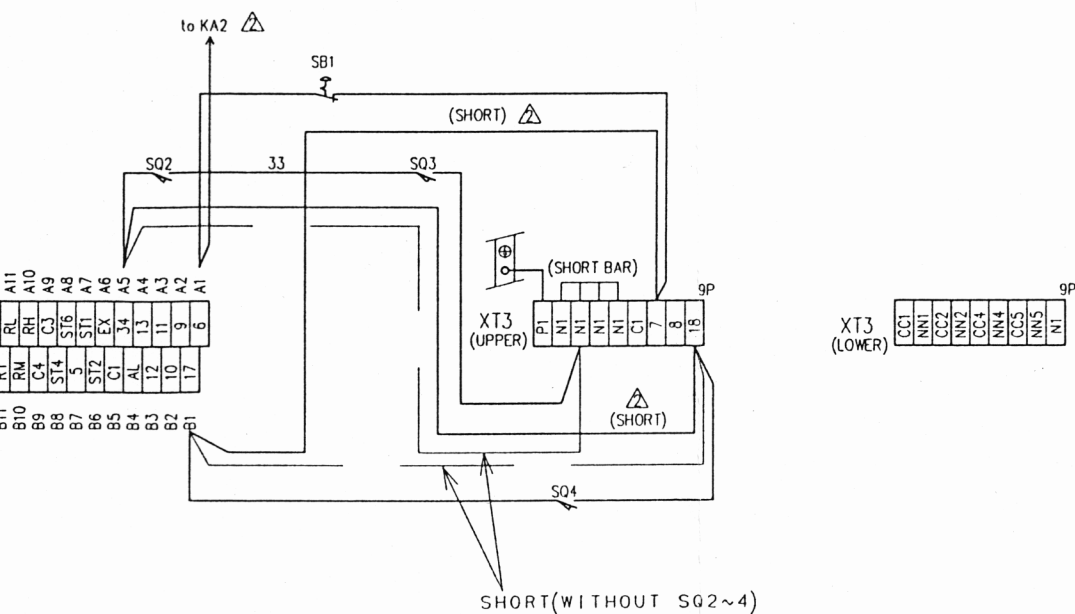

Title		KN135	
P2			
Spec.	Dr. No.	Sheet	
Date	03.06.24	WD113986	2/2
Drawn	西山昌夫	Rheon Automatic Machinery Co., Ltd.	
Checked	K.K.		
App'd	M.L.		

周	01.05.08	KA2, KM2追加	改訂	Proj. No.	Model	77号機より	Volt	fig.2	Phase	3φ	Drawn	西山昌夫
西山	99.10.20	HM位置変更	改訂	RA No.	Serial No.		Hertz	50/60Hz			Checked	K.K.
西山	Rev.	Date	Revision Description	By	RX No.		Total Amps.		Fig.2		App'd	M.L.