

# **EXPANSION JOINTS IN BUILDINGS**

Technical Report No. 65

Prepared by the  
Standing Committee on Structural Engineering  
of the  
Federal Construction Council  
Building Research Advisory Board  
Division of Engineering  
National Research Council

NATIONAL ACADEMY OF SCIENCES  
Washington, D.C.  
1974

**NOTICE:** The program under which the project reported was conducted was approved by the Governing Board of the National Research Council, acting on behalf of the National Academy of Sciences. Such approval reflects the Board's judgment that the program is of national importance and appropriate with respect to both the purposes and resources of the National Research Council.

The members of the Committee selected to undertake this project and prepare this report were chosen for recognized scholarly competence and with due consideration for the balance of disciplines appropriate to the project. Responsibility for the detailed aspects of this report rests with that Committee.

Each report issuing from a study committee of the National Research Council is reviewed by an independent group of qualified individuals according to procedures established and monitored by the Report Review Committee of the National Academy of Sciences. Distribution of the report is approved, by the President of the Academy, upon satisfactory completion of the review process.

This report was prepared under the following contracts between the National Academy of Sciences and the supporting federal agencies: Atomic Energy Commission, WA-73-3061; Department of the Army, DACA 73-73-C-0004; Department of Health, Education, and Welfare, OS-73-116; National Aeronautics and Space Administration, NASW-2461; Department of the Navy, N00025-73-C-0024; Department of the Air Force, N00025-73-C-0024; Department of Commerce, 3-35819; General Services Administration, GS-00-B-871; Veterans Administration, V1001P-290; Department of the Interior, 13-D-2501.

By supporting contract agreement, federal agencies wishing copies of this report are entitled to such copies on request to: Building Research Advisory Board, Division of Engineering, National Research Council, Washington, D.C. 20418.

Inquiries concerning this publication should be addressed to: The Executive Director, Building Research Advisory Board, Division of Engineering, National Research Council, 2101 Constitution Avenue, N.W., Washington, D.C. 20418.

*Available from*

Printing and Publishing Office, National Academy of Sciences  
2101 Constitution Avenue, N.W., Washington, D.C. 20418

**Library of Congress Cataloging in Publication Data**

Federal Construction Council. Standing Committee on Structural Engineering.  
Expansion joints in buildings.

(Federal Construction Council. Technical report no. 65)

1. Expansion joints—Contracts and specifications. I. Title. II. Series.

TH7.F4 no. 65 [TA660.E9] 690'.08s [690] 74-9845

ISBN 0-309-02233-9

Printed in the United States of America

## FEDERAL CONSTRUCTION COUNCIL of the BUILDING RESEARCH ADVISORY BOARD

The Federal Construction Council serves as a planning, coordinating, and operating body to encourage continuing cooperation among federal agencies in advancing the science and technology of building as related to federal construction activities.

In this pursuit, its specific objectives include: assembly and correlation of available knowledge and experience from each of the agencies; elimination of undesirable duplication in investigative effort on common problems; free discussion among scientific and technical personnel, both within and outside the government, on selected building problems; objective resolution of technical problems of particular concern to the federal construction agencies; and appropriate distribution of resulting information.

The Council as such comprises ten members appointed by the BRAB Chairman from among BRAB membership, plus one member from the senior professional staff of each of the supporting federal agencies (currently nine), also appointed by the BRAB Chairman on nomination from the individual agencies; all appointments are subject to approval by the President of the National Academy of Sciences.

The Council directs the conduct of technical investigations and surveys of practice, holds symposia/workshops, and arranges for interchanges of information and for monitoring of research and technical projects.

### FEDERAL CONSTRUCTION COUNCIL—1973–1974

#### Chairman

Walter S. Douglas, *Senior Partner\**  
Parsons, Brinckerhoff, Quade and Douglas  
New York, New York

James M. Bayne, *Director*, Programs and Engineering Division, National Aeronautics and Space Administration, Washington, D.C.  
Robert W. Blake, *Chief*, Research and Development Staff, Office of Facilities, Engineering, and Property Management, Department of Health, Education, and Welfare, Washington, D.C.  
Richard T. Geoghegan, Darien, Connecticut  
Robert A. Georgine, *Secretary Treasurer*, Building and Construction Trades Department, American Federation of Labor—Congress of Industrial Organizations, Washington, D.C.  
Charles P. Graves, *Professor*, College of Architecture, University of Kentucky, Lexington, Kentucky  
\*Walter R. Hibbard, Jr., *Vice President—Technical Services*, Owens-Corning Fiberglas Corporation, Toledo, Ohio  
Samuel Kramer, *Chief*, Office of Federal Building Technology, Center for Building Technology, National Bureau of Standards, Washington, D.C.  
Edwin B. Mixon, *Deputy Chief of Engineering Division*, Directorate of Civil Engineering, Department of the Air Force, Washington, D.C.  
Nyal E. Nelson, *Chief*, Specifications and Estimating Branch, Office of the Chief of Engineers, Department of the Army, Washington, D.C.  
Robert D. Pauley, *Vice President—Research and Engineering*, Weyerhaeuser Company, Tacoma, Washington  
Tom Lewis Peyton, Jr., *Deputy Assistant Commissioner for Construction Management*, Public Buildings Service, General Services Administration, Washington, D.C.  
Blake J. Ratliff, *Director*, Research Staff, Office of Construction, Veterans Administration, Washington, D.C.  
Joseph A. Rorick, *Director of Design and Engineering*, Real Estate and Construction Division, IBM Corporation, White Plains, New York  
John F. C. Turner, *Lecturer*, Department of Urban Studies and Planning, Massachusetts Institute of Technology, Cambridge, Massachusetts  
Richard H. Welles, *Director*, Specifications and Cost Division, Naval Facilities Engineering Command, Department of the Navy, Alexandria, Virginia  
Beverly A. Willis, AIA, Willis & Associates, San Francisco, California  
Charles I. York, *Assistant Director for Engineering*, Division of Construction, United States Atomic Energy Commission, Washington, D.C.  
Joseph H. Zettel, *Vice President, Director of Research*, Industrial Products Research Department, Research and Development Center, Johns-Manville Products Corporation, Denver, Colorado

---

\*Member, National Academy of Engineering.

## FEDERAL CONSTRUCTION COUNCIL STANDING COMMITTEE ON STRUCTURAL ENGINEERING

While the Federal Construction Council itself has overall responsibility for its technical programs, specific projects such as this are carried out under the direction of appointed task groups or standing committees of engineers, architects, and scientists. Each member serves as a specialist in his field or as a generalist in the problem area, not as a spokesman for or representative of his own agency or any other organization with which he may be associated. At the request of the Council, this report was prepared by members of the Standing Committee on Structural Engineering.

Walter Buckholtz, *Civil Engineer*, Plant Engineering Division, Directorate of Civil Engineering, Department of the Air Force  
Edward Caligiuri, *Head*, Structural/Civil Section, Facilities Engineering Division, National Aeronautics and Space Administration  
Carl Connor, *General Engineer*, Division of Construction, U.S. Atomic Energy Commission  
Alvin Dailey, *Supervisory Structural Engineer*, Office of Construction Management, Public Buildings Service, General Services Administration  
William Heitmann, *Chief*, Structural Section, Engineering Division, Military Construction, Office of the Chief of Engineers  
Edgar V. Leyendecker, *Structural Research Engineer*, Structures Section, Building Research Division, National Bureau of Standards  
Richard D. McConnell, *Chief*, Structural Division, Veterans Administration  
Blake J. Ratliff, *General Engineer*, Research Staff, Office of Construction, Veterans Administration  
Joseph V. Tyrrell, *Chief Structural Engineer*, Naval Facilities Engineering Command, Department of the Navy  
William J. Werner, *Supervisory General Engineer*, Office of Policy Development and Research, Department of Housing and Urban Development  
Ross M. Webb, *Structural Consultant*, Division of Engineering, Department of Health, Education, and Welfare

### BRAB SUPPORTING STAFF

Michael C. Soteriades, *BRAB Consultant*  
Wallace A. Norum, *Project Coordinator*, Federal Construction Council  
S. Narayan Bodapati, *Staff Engineer*, Federal Construction Council  
James R. Smith, *Assistant Director*—Technical Operations, BRAB  
Claret Heider, *Editor*, Building Research Advisory Board

## FOREWORD

Many factors affect the amount of temperature-induced movement that takes place in a building and also the extent to which this movement can take place before serious damage will occur or extensive maintenance will be required. Because of the complexity of the problem, no one has yet established nationally acceptable procedures for precisely determining the size and location of expansion joints required in a particular structure. In the absence of such definitive procedures, most designers and federal construction agencies have individually developed guidelines based on rough calculations and experience.

Although relatively few serious problems attributable to inadequate provision for temperature-induced movement have been reported, significant differences are found in the various guidelines used for locating and sizing expansion joints, suggesting that at least some of the guidelines must be in error. Therefore, it is quite likely that in some cases joints are being omitted where they are needed--thus creating a risk of structural failure or causing unnecessary operations and maintenance costs--and in other cases they are being used where they are not required--thus increasing the initial cost of construction and creating space utilization problems.

As a consequence, the Federal Construction Council (FCC) undertook the study reported herein in hopes of developing more definitive criteria for expansion joints than have existed in the past. The study was carried out for the Council by the FCC Standing Committee on Structural Engineering.

This report has been reviewed and approved by the Federal Construction Council, and, on the recommendation of the Council, the Building Research Advisory Board (BRAB) has approved the report for publication.

The Board gratefully acknowledges the work of the FCC Standing Committee on Structural Engineering in conducting the study and developing this report.

HERBERT H. SWINBURNE, Chairman  
Building Research Advisory Board

## CONTENTS

	Page
I. Introduction . . . . .	1
A. Purpose of Report . . . . .	1
B. Scope . . . . .	1
C. Conduct of Study . . . . .	1
D. Organization of Report . . . . .	2
II. Recommendations . . . . .	3
A. General . . . . .	3
B. Criteria for Determining the Need for Expansion Joints . .	4
C. Suggested Procedures for Design of Expansion Joints . . .	6
D. Areas of Future Research . . . . .	7
III. Discussion . . . . .	9
A. General . . . . .	9
B. Determination of Need for Expansion Joints . . . . .	14
C. The Design of Expansion Joints . . . . .	27
D. Areas of Future Research . . . . .	30

## APPENDIXES

A. Computer Printout of an Elastic Analysis . . . . .	33
B. Temperature Data . . . . .	39

## LIST OF TABLES

1. Mean Construction-Season Temperatures for Various Localities . . . . .	11
2. Tabulated Results of Analysis . . . . .	21

## LIST OF FIGURES

1. Maximum allowable building length without use of expansion joints for various design temperature changes . . . . .	5
2. Differential temperature effects on a building element . . . . .	12
3. Expansion joint spacing criteria of one federal agency . . . . .	15
4. Analysis of one-bay simple bent subjected to uniform temperature change . . . . .	18
5. Analysis of multistory and multibay frame subjected to uniform temperature change . . . . .	19
6. Computation of effective length $L$ of building segments adjacent to the expansion joint . . . . .	28

## I INTRODUCTION

### A. PURPOSE OF REPORT

The purpose of this report is to provide federal agencies with practical procedures for evaluating the need for through-building expansion joints in structural framing systems and with guidelines for designing expansion joints for those systems when they are required.

### B. SCOPE

The term "expansion joint" as used throughout this report refers to the isolation joints provided within a building to permit the separate segments of the structural frame to expand and contract in response to temperature changes without adversely affecting the building's structural integrity or serviceability.

This report is limited to the investigation of expansion joints that permit movement in the horizontal direction only. All types of building and all climatic conditions experienced in the United States are considered. Problems such as those associated with vertical movement of the structural frame, dimensional changes of cladding, relative motion of cladding to frame, shrinkage of concrete, manufacturing errors in the length of members, and differential settlement of foundations are not considered.

### C. CONDUCT OF STUDY

The study on which this report is based was carried out under the direction of the Federal Construction Council Standing Committee on Structural Engineering. The Committee first examined in detail an unpublished report in which horizontal changes in dimension in nine federal buildings were observed and related to recorded temperature changes. Additionally, the Committee studied the current practices of federal agencies regarding expansion joint criteria.

To enhance its understanding of the distribution of stresses and associated deformation in frames subjected to uniform temperature change, the Committee formulated and conducted an analytical study of the effects of uniform temperature change on typical two-dimensional elastic frames. A theoretical



computer model was developed for this purpose. Observed dimensional changes caused by temperature changes were correlated with data obtained from the computer analysis. The results of the Committee's study and analysis, as well as its collective experience and judgment, served as the bases for this report.

#### D. ORGANIZATION OF REPORT

This report includes two main sections in addition to this Introduction: Section II, Recommendations, in which the Committee presents its recommendations without detailed discussion, and Section III, Discussion, in which the Committee presents the data and rationale upon which the recommendations are based and on which attention is focused on the nature of the problems associated with temperature changes and their effects on structural integrity and building serviceability. The computer printout of an elastic analysis that illustrates the effects of temperature changes on horizontal dimensional movements and a compilation of temperature data for various cities in the United States are included as appendixes.

## II RECOMMENDATIONS

### A. GENERAL

1. The structural analysis of a building should include a determination of the need for thermal expansion joints in view of the potential impact of temperature-produced dimensional changes on structural integrity and building serviceability.\*
2. As a minimum, each of the following factors should be examined and taken into account during expansion joint location and design:
  - a. Dimensions and configuration of the building.
  - b. Design temperature change, which should be computed in accordance with the formula:

$$\Delta t = (T_w - T_m) \text{ or } (T_m - T_c), \quad (1)$$

whichever is greater, where,

$T_m$  = the mean temperature during the normal construction season in the locality of the building. For the purpose of this report, the normal construction season for a locality is defined as that contiguous period in a year during which the minimum daily temperature equals or exceeds 32 °F. [For example, the normal construction season for Anchorage, Alaska, is 5-1/2 months (April 24-October 8) and for Birmingham, Alabama, is year-round (January-December).]

$T_w$  = the temperature exceeded, on the average, only 1 percent of the time during the summer months of June through September in the locality of the building. (In a normal summer there would be approximately 30 hours at or above this design value.)

$T_c$  = the temperature equaled or exceeded, on the average, 99 percent of the time during the winter months of December, January, and February in the locality of the building. (In a normal winter there would be approximately 22 hours at or below this design value.)

---

\*Dimensional changes in the vertical direction and methods of fastening non-structural elements to the structural frame of the building do not fall within the scope of this report.

Values for  $T_w$ ,  $T_m$ , and  $T_c$  for different localities in the United States are included in Appendix B. The  $T_w$  and  $T_c$  values were extracted from the ASHRAE Handbook of Fundamentals (1972) published by the American Society of Heating, Refrigerating and Air-Conditioning Engineers.

- c. Provision for temperature control.
- d. Type of frame, type of connection to the foundation, and symmetry of stiffness against lateral displacement.
- e. Materials of construction.

## B. CRITERIA FOR DETERMINING THE NEED FOR EXPANSION JOINTS

The need for thermal expansion joints in buildings may be determined initially on an empirical basis. If results are deemed by the designer to be too conservative or if the empirical approach is not sufficiently comprehensive to be applicable to the type of structure being investigated, a more precise analysis should be undertaken. In either case, the following criteria should be utilized in the absence of more rational approaches.

### 1. Empirical Approach

- a. For buildings having a beam-and-column or slab-and-column structural frame,\* the maximum length of the building\*\* without expansion joints should be determined in accordance with Figure 1 on the basis of the design temperature change ( $\Delta t$ ) in the locality of construction.
- b. For buildings supported by continuous exterior unreinforced masonry, expansion joints should be placed at intervals not exceeding 200 feet. In addition, intermediate subjoints should be positioned and spaced in accordance with the recommendations of the Brick Institute of America (BIA) and the National Concrete Masonry Association (NCMA).\*\*\*

---

\*A building should be considered to have a beam-and-column or slab-and-column structural frame even if intermittent interior shear walls or other stiffening elements are incorporated in the frame and even if the frame is supported on an above-grade reinforced concrete continuous perimeter base wall. The provisions of this recommendation do not apply to buildings with fully exposed exterior frames placed outside the cladding elements.

\*\*The maximum diameter or diagonal of a round, elliptical, or closed polygonic building should be considered its maximum dimension.

\*\*\*At the time of this writing such recommendations are provided in the BIA publications, Differential Movement, Cause and Effect (No. 18, April 1963), Differential Movement, Expansion Joint (No. 18A, May 1963), and Differential Movement, Flexible Anchorage (No. 18B, June 1963) and the NCMA publication, Control of Wall Movement with Concrete Masonry (TEK 3, 1972).

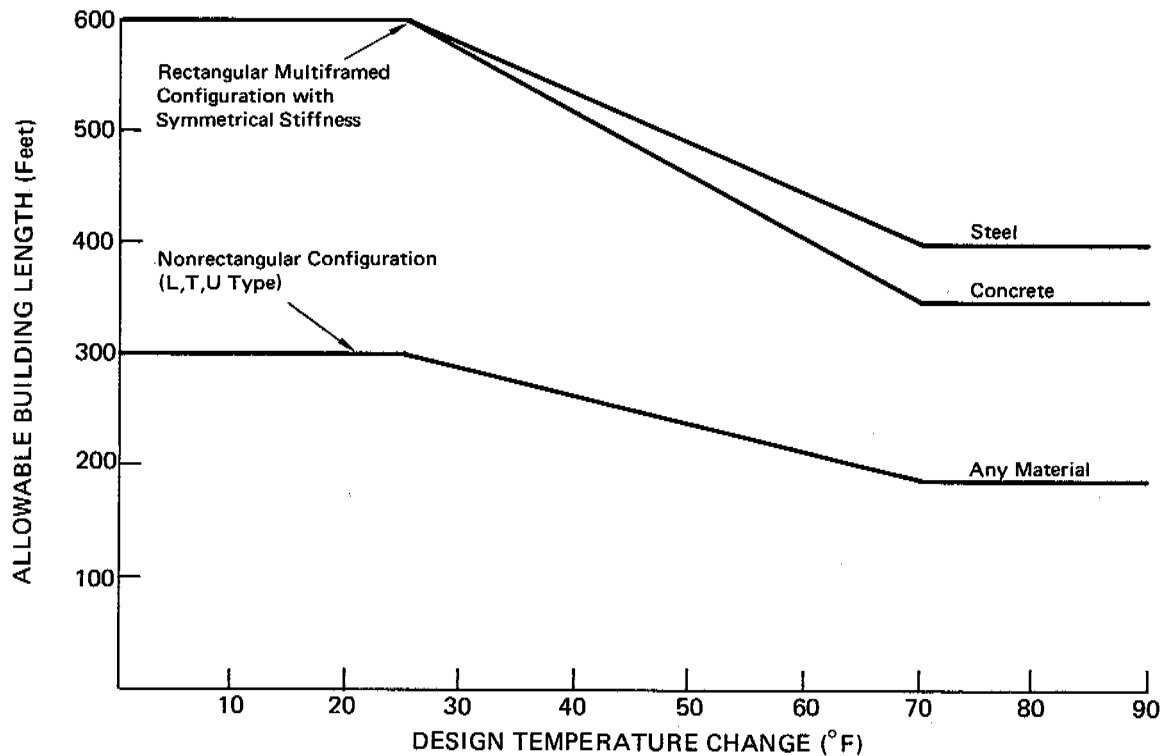


FIGURE 1 Maximum allowable building length without use of expansion joints for various design temperature changes. These curves are directly applicable to buildings of beam-and-column construction, hinged at the base, and with heated interiors. When other conditions prevail, the following rules are applicable:

- (a) If the building will be heated only and will have hinged-column bases, use the allowable length as specified;
- (b) If the building will be air conditioned as well as heated, increase the allowable length by 15 percent (provided the environmental control system will run continuously);
- (c) If the building will be unheated, decrease the allowable length by 33 percent;
- (d) If the building will have fixed-column bases, decrease the allowable length by 15 percent;
- (e) If the building will have substantially greater stiffness against lateral displacement at one end of the plan dimension, decrease the allowable length by 25 percent.

When more than one of these design conditions prevail in a building, the percentile factor to be applied should be the algebraic sum of the adjustment factors of all the various applicable conditions.

## 2. Analytical Method

For those situations in which the need for thermal expansion joints cannot be determined on an empirical basis or in which the empirical approach provides a solution that professional judgment indicates is too conservative, a detailed analysis like that discussed in Section III.B.2 should be performed. The analysis should include identification and evaluation of the effects of the factors listed in III.A.2, as well as a stress-strain analysis of the effects on the structural frame of a uniform temperature change,  $C \Delta t$ , where  $\Delta t$  is computed as described under III.A.2.b and the coefficient  $C$  is:

- a. Equal to unity for unheated buildings,
- b. Equal to 0.70\* for buildings heated but not air conditioned, and
- c. Equal to 0.55\* for buildings heated and air conditioned.

### C. SUGGESTED PROCEDURES FOR DESIGN OF EXPANSION JOINTS

The following guidelines are recommended as bases for expansion joint design and location:

1. Expansion joints should extend over the entire height of the building from the top of the foundation footing (or perimeter basewall) through the roof. The resulting two separate but adjacent structural frames may share the same footing.
2. The upper bound (UB) of horizontal joint closing in buildings with a beam-and-column frame should be calculated from the expression:

$$UB = 6 \cdot 10^{-6} \cdot \Delta t_e \cdot L, \quad (2)$$

where  $\Delta t_e = (T_w - T_m)$  in degrees Fahrenheit and  $L$  = effective length.\*\*

---

\*The  $C$  values of less than unity are based on the assumption that the environmental control system in the building would operate continuously. Hence, the lower  $C$  value cannot be applied if it is anticipated that the environmental control system will be regularly shut down for extended periods of time (i.e., 2 days or longer). Any deviation from these values should be quantitatively justified.

\*\*The effective length should be considered the average length of the building segments abutting the joint. If either building segment has one end substantially stiffer to lateral displacement than the other, the length of the building segment used for computing the effective length  $L$  should be considered 50 percent greater if the stiff end is farther from the joint and 33 percent smaller if the stiff end is the one abutting the joint.

3. To allow for construction tolerances and compressibility and expandability of the joint sealants, the expansion joint width (W), in inches, should be computed as follows:

$$W = C_1 \cdot UB, \quad (3)$$

where UB is as computed in Eq. (2), and  $C_1^*$  = 2.0 for unheated buildings, 1.7 for buildings heated but not air conditioned, or 1.4 for buildings for both heated and air conditioned.

4. For buildings with continuous exterior bearing walls of clay masonry, the maximum spacing of the expansion joints should be limited to 200 feet, and the minimum required joint width (W), in inches, should be calculated from the following expression:

$$W = C_1 \cdot L(50^\circ\text{F} \cdot \Delta t_e)(4 \cdot 10^{-6}), \quad (4)$$

where  $\Delta t_e$ ,  $C_1$ , and L are as defined for Eq. (2) and (3).

5. The minimum width of an expansion joint should in no case be less than 1 inch. If the computed expansion joint width exceeds 2 inches, special consideration should be given to the materials and methods of joint construction to ensure that the joint itself will be able to withstand the distress caused by substantial movement at the joint. (Additional consideration should be given to architectural and structural details to ensure that the building will tolerate the inherent deformations without loss of serviceability.)
6. Expansion joint design should permit uninterrupted relative motion of the abutting building segments, prevent the entrance of water or debris, and allow for easy inspection and maintenance.

#### D. AREAS OF FUTURE RESEARCH

Research directed toward the establishment of a valid data base for the development of technically sound criteria for the design and location of expansion joints should be initiated immediately. Special attention should be given to the following:

1. The collection, classification, and interpretation of data on building damage attributable to temperature fluctuation.

---

\*Coefficient  $C_1$  differs from coefficient C in that  $C_1$  takes into consideration construction tolerances and the compressibility/expandability of the joint filler, as well as temperature.

2. The development of data necessary for the correlation of ambient temperature with temperatures of building components (structural and nonstructural) at the periphery and within buildings for different building types and materials.
3. The development of data for the correlation of ambient temperature fluctuations with temperature gradients existing within building components under different conditions of exposure and types and methods of insulation.
4. Analytic and experimental investigation that will lead to the correlation of stresses in the various building components to the different patterns of temperature fluctuations and gradients and to the different types of assembly component (connectors).

The effects of temperature change on the performance of buildings supported on masonry walls should be examined for each type of masonry material or combination of materials likely to be used, and each type or combination of materials should be investigated with respect to construction details, connections of walls to horizontal and vertical components (roofs, floors, walls, and partitions at right angles), optimal spacing of joints, and extent of joints.

### III DISCUSSION

#### A. GENERAL

A building is a dynamic product subjected to a host of conditions that keep its various elements in a constant state of stress, strain, and displacement. During design, displacement must be evaluated and, when necessary, controlled to ensure that the building will perform as intended throughout its expected life without the need for unanticipated large-scale maintenance. Expansion joints introduced by the designer to avoid the effects of large lateral displacements are relied upon to limit the internal stresses caused by expansion and contraction and the actual movement of building elements, permit relative motion of the building members without disturbing functional continuity, and affect a complete structural separation without disturbing structural integrity.

Experience indicates that appropriate use of expansion joints presents a rather complex design problem and requires a thorough understanding of those factors that dictate their need as well as those that affect their ultimate performance after installation. The design, location, and performance of expansion joints can be influenced by such factors as building form, function, and economics; construction techniques; the varying characteristics of the different materials employed, changes of these characteristics under varying environmental conditions, and the physical relationship of one to the other; and the ability to withstand stresses resulting from dimensional changes.

The problem is further complicated by recent trends and developments in structural engineering. A better understanding of the behavior of materials and an evolution in the precision of structural analysis of buildings, coupled with the advent of computers that permit economical, rapid, and accurate analyses, have encouraged designers to include a mixture of materials and a variety of jointing systems in most major structures. These factors make it possible to generally decrease the dimensions of resisting structural elements from those customarily used in past practice. As a consequence, structures are less likely to be overdesigned than in the past; therefore, the risk of their reaching the threshold of structural failure is greater, giving emphasis to the importance of adequate expansion joints.

Previously developed empirical rules for expansion joint spacing are not necessarily compatible with these recent trends and developments. If desired margins of safety are to be maintained, it appears that the need for thermal expansion joints should be determined as part of the structural analysis of a building and that special attention should be given to the potential impact



of horizontal dimensional changes\* on structural integrity and building serviceability. Factors that are considered to be most significant with respect to the design and location of expansion joints, and which are treated herein, include dimensions and configuration of the building; design temperature change; provision for temperature control; type of frame, type of connection to the foundation, and symmetry of stiffness against lateral displacement; and materials of construction.

## 1. Dimensions and Configuration of the Building

The dimensions of a building are obviously an overriding parameter with regard to the need for expansion joints because the problem of expansion joints arises when the dimensions become substantial.

The configuration of a building is a parameter influencing the severity of the effects of temperature changes on a building and, as such, should be given consideration during the design process. Rectangular buildings and buildings with two axes of symmetry in plan with no internal open courts experience temperature-induced stresses that have relatively simple patterns, while buildings with a more complex configuration, such as U-shaped or L-shaped buildings, experience horizontal dimensional changes that result in complex stress patterns, particularly at re-entrant corners.

## 2. Temperature Change

Since construction is carried out over a considerable period of time, the various elements of the structure are installed at different temperatures. The temperature changes causing displacements and stresses in a structure are changes from these installation/erection temperatures, over which the designer has little, if any, control. Yet, while it is apparent that temperature change is one of the most important factors influencing the potential linear expansion/contraction of a building, there is no possibility of establishing exactly the maximum expected temperature change because this change is not the same for all parts of the structure and is not known during the design phase for any one particular part of the structure.

### a. Computation of design temperature change

To properly account for the effects of temperature on buildings requires a procedure that uniquely defines the temperature differences for which a building in a given locality should be designed. Currently, however, there is no one established procedure for determining this design temperature change with precision; therefore, the

---

\*While the scope of this report is concerned only with horizontal dimensional changes, the analysis also should be supplemented by consideration of dimensional changes in the vertical direction of buildings and of methods used to fasten nonstructural elements to the structural frame of the building.

following guidelines were developed by the Committee to serve as an aid in its computation until a more definitive procedure is developed:

- It should be assumed that structures will be built when the minimum daily temperatures are above 32 °F.
- Mean temperatures ( $T_m$ ) should be based on only the construction season--the contiguous period\* during which the minimum daily temperatures are above 32 °F. This season varies for different localities (see Table 1) and, except for southern areas, the mean construction season temperature is different from the mean annual temperature.
- The anticipated high-temperature extreme ( $T_w$ ) should be considered as the temperature that is exceeded, on the average, only 1 percent of the time during the summer months (June through September) in the locality of the building.
- The anticipated low-temperature extreme ( $T_c$ ) should be considered as the temperature that is equaled or exceeded, on the average, 99 percent of the time during the winter months (December through February) in the locality of the building.
- Using the data described above, the design temperature change ( $\Delta t$ ) can be uniquely defined according to  $\Delta t = (T_w - T_m)$  or  $(T_m - T_c)$ , whichever is greater. The  $T_w$ ,  $T_m$ , and  $T_c$  values for many localities in the United States are presented in Appendix B.

TABLE 1 Mean Construction-Season Temperatures for Various Localities

Locality	Construction Season			Annual Mean Temperature (°F)
	From	To	Mean Temperature (°F)	
Birmingham, Alabama	Jan 1	Dec 31	63.2	63.2
Anchorage, Alaska	April 24	Oct 8	50.6	35.5
Almose, Colorado	May 8	Sept 28	60.4	42.2
Daytona Beach, Florida	Jan 1	Dec 31	70.3	70.3

\*Obtained from Decennial Census of United States Climate--Daily Normals of Temperature and Heating Days, Climatography of the United States No. 84, U.S. Department of Commerce, Weather Bureau, Washington, D. C. (1963).

b. Differential temperature effects on a building element

As illustrated in Figure 2, the differential temperature profile of a member can be assumed to consist of the superposition of two temperature profiles:

- (1) A uniform temperature change ( $\Delta t_g$ ) equal to the temperature change that takes place along the axis of the member, and
- (2) A differential temperature change [ $d(\Delta t)$ ] equal to the difference of the temperature change at one face of the member less the temperature change at the opposite face of the member; i.e.,  $d(\Delta t) = (\Delta t_2 - \Delta t_1) = (a+b)$ .

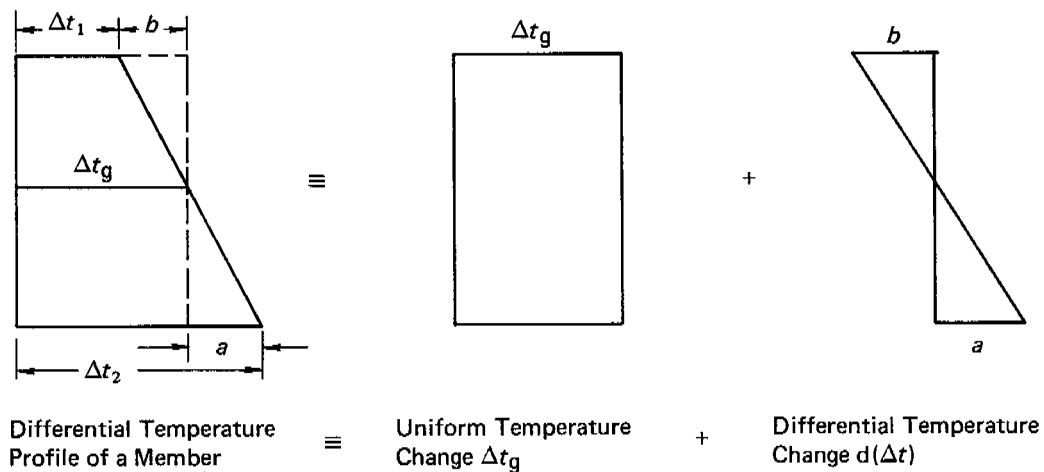


FIGURE 2 Differential temperature effects on a building element.

When viewed in this manner, it becomes apparent that the differential temperature change [ $d(\Delta t)$ ] causes no change in the length of the member along its axis. Instead, it tends to cause curvature in the member, which, to the extent it is resisted, results in internal stresses. However, neither the curvature nor the ensuing internal stresses propagate and cause a cumulative increase in the length of the structure as do those stresses and deformations brought about by uniform temperature change.

Thus, with respect to expansion joint requirements, a differential temperature profile can be replaced by the superposition of a uniform temperature change corresponding to the change at the level of the centroidal axis of the member and a differential temperature change that causes no change in the overall length of the member.

From this discussion it becomes evident that the uniform temperature change component ( $\Delta t$ ) of the differential temperature profile is the principal cause of building distress due to temperature changes. For a symmetrical member, the effective uniform temperature change will be equal to the average of the temperature changes on the opposite faces undergoing differential temperature changes. In members with nonsymmetrical cross sections, the effective uniform temperature change obviously will have an intermediate value between the temperature changes on the two opposite faces.

### 3. Provision for Temperature Control

Properly functioning heating and air conditioning in a building will maintain a relatively constant temperature within the building and, thus, reduce the potential for adverse temperature change effects on internal and peripheral members. However, buildings that are heated but not air conditioned are subject to substantial changes in temperature during the summer and these must be taken into account. Buildings that are both heated and air conditioned can be considered only theoretically immune to the effects of extreme temperature fluctuations since malfunctions or intentional shutdowns of mechanical equipment could lead to sudden injurious temperature variations. Thus, the potential for such also must be considered during expansion joint design.

### 4. Type of Frame, Type of Connection to the Foundation, and Symmetry of Stiffness against Lateral Displacement

Thermal effects on buildings with fixed-column bases are likely to be more severe than on buildings with hinged-column bases. Comparison of the behavior of two identical tall buildings, one with fixed-column bases and one with hinged-column bases, subjected to the same temperature changes indicates that both buildings underwent virtually the same dimensional changes in all levels above the first. However, in the case of the fixed-column building, temperature-induced stresses (shear forces, axial forces, and bending moments) at critical sections within the lowest story were almost twice as high as those at corresponding locations in the hinged-column building.

The extent of stresses and deformations in a building also will be greatly influenced by the symmetry of the building in terms of stiffness against lateral displacement. A building with main structural frames having approximately the same stiffness against horizontal displacement from the center to the right as from the center to the left will be subject to smaller stresses and deformations than a similar building with main structural frames having columns or a shear wall at one end substantially stiffer against horizontal displacement than the rest of the columns. Therefore, the design of expansion joints should be influenced by the type of frame, type of connection to the foundation, and the stiffness against lateral displacement of the structural framing, each of which is discussed in greater detail subsequently.

## 5. Materials of Construction

The type of material used in the construction of the frame (e.g., steel, concrete, masonry) can influence the effects thermal changes will have on the building. For example, comparison of the effect of thermal changes in two similar frames with identical moments of inertia, one of which has beams with greater cross-sectional area than the other, indicates that the frame with the greater cross-sectional area develops the greater axial forces, shear forces, and bending moments at the critical sections of both beams and columns. Consequently, considering that the ratio of the cross-sectional area to the moment of inertia is greater for concrete frames than for steel frames, it would be reasonable to expect that the thermal effects on structures would generally result in higher stresses in concrete frames than in steel frames. Therefore, a designer would need to be somewhat more conservative in evaluating potential thermal effects when using concrete as a structural material than when using steel, unless of course, he conducts a more complete analysis of the structure for all forces, including thermal effects, and provides explicitly for the critical loading conditions.

Shrinkage of concrete members accounts for a portion of the dimensional change in a building frame. However, shrinkage usually takes place during a relatively short period of time following concrete placement. Its extent can be estimated with reasonable accuracy, and its effects can be controlled by proper planning of the construction sequence of the building. Consequently, concrete shrinkage has not been considered in this study but should be taken into account when planning the construction sequence of concrete frames of lengthy buildings.

### B. DETERMINATION OF NEED FOR EXPANSION JOINTS

Although the need for expansion joints can be determined empirically in many cases, in certain situations it would be determined best through analytical evaluation. The empirical approach is likely to be the simpler of the two, but is the more conservative. The analytical method requires that the designer fully evaluate and account for in the overall design the effects of all factors influencing the need for expansion joints (discussed in Section III.A). The basic elements, concepts, and/or procedures involved in each are discussed below.

#### 1. The Empirical Approach

##### a. Current practices and existing data

With the exception of criteria currently used by some federal agencies in determining building expansion joint requirements and a report concerning a one-year (1943-1944) experiment examining expansion joint movement, a search of the literature revealed no significant quantitative data or specifications. Considerable information on the design of the actual expansion joint for a variety of

specific building components and materials is available in engineering/architectural aids and specifications; however, through the years, the decision concerning the number and location of expansion joints, as well as the ultimate design, has been left primarily to the judgment of the designer on the basis of his intuition and experience. Individual agencies have examined the performance of buildings that seemed to lack appropriate expansion joints and have provided remedies for such problems on a case-by-case basis. Unfortunately, the results relating cause and effect were not formally documented.

An examination of the federal agency criteria for expansion joints indicates that they are very basic in concept. These criteria are based on the assumption that the maximum allowable linear dimension of buildings is a function of two parameters:

- (1) The maximum difference between the mean annual temperature at the locality of the building and the maximum or minimum expected temperature, and
- (2) The provision for heat control in the building under consideration.

The first parameter causes the dimensional change, while the second reflects the ability of the building to dampen, and thus to reduce, the severity of the effects of outside temperature changes. Curves for heated and unheated buildings (Figure 3) are used to relate the maximum allowable length of a building without expansion joints as a step function to design temperature changes.

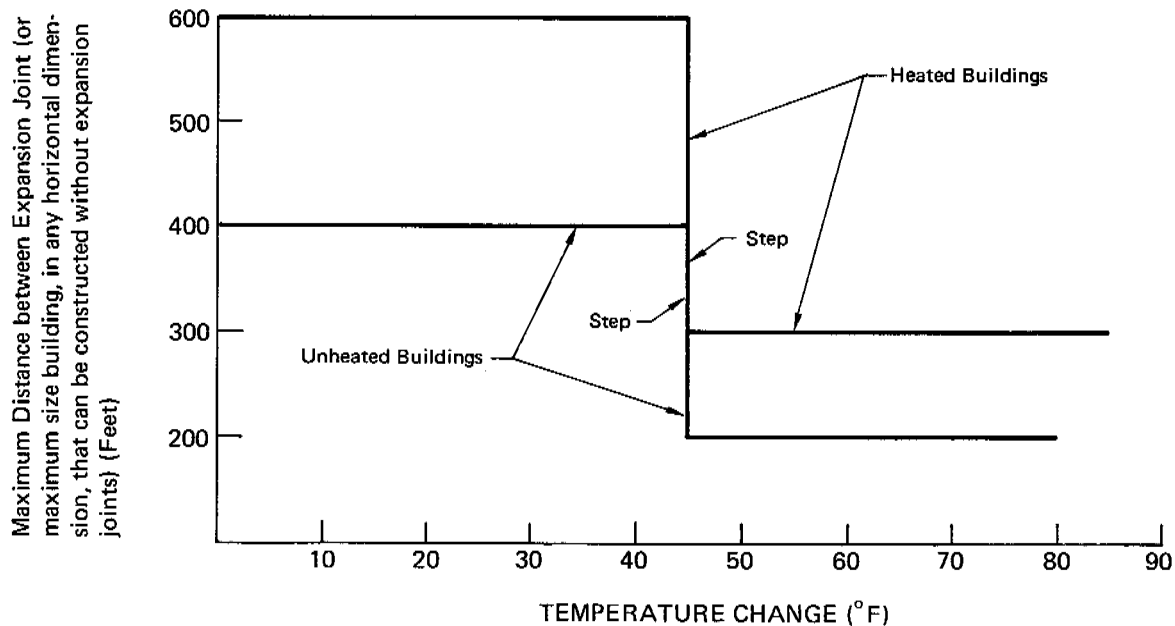


FIGURE 3 Expansion joint spacing criteria of one federal agency.

There is little doubt that a step function cannot represent the behavior of a physical phenomenon, such as thermal effect, that has evident characteristics of continuity. However, while the maximum allowable building length can be expected to decrease as the design temperature change increases, the definition of the exact nature of their relationship requires more rigorous and elaborate quantitative data than is available at present or is expected to become available. Therefore, the limits of 600 and 200 feet in the linear dimensions of buildings are assumed to reflect the considered consensus of long experience within the engineering profession. Consequently, without any further experimental or theoretical justification, they are used herein as boundary values.

Taking the above factors into consideration, the curves in Figure 1 have been developed and are recommended in Section II as an aid in the empirical determination of the need for expansion joints in buildings. These curves are within the 600- and 200-foot bounds and assume a linear change (in the absence of any evidence justifying curves of other shapes) in allowable maximum length with regard to design temperature change. For relatively small temperature changes (up to 25 °F) the maximum allowable length is permitted. In addition, factors can be used to modify the maximum allowable building lengths obtained from Figure 1 for parameters other than heating (e.g., air conditioning, type of support, type of configuration, and type of material used) to account in a conservative manner for their influence. These factors were listed in Section II, Recommendation A.2, and are based on a qualitative assessment; the following sections of this report provide the rationale for their adoption.

b. Findings of a previous study on expansion joints

Structural engineers of the Public Buildings Administration\* investigated expansion joint movement over a period of one year (September 1943 to August 1944) in nine federal buildings to obtain measurements of dimensional changes over a complete cycle of seasons.\*\* Although some of the assumptions made in the analysis are questionable and data collected are not sufficiently complete to serve as a basis for definitive statements, several important conclusions relative to this report can be drawn from that investigation and those considered most significant are presented below.

- (1) There is a considerable time lag (2 to 12 hours) between the maximum dimensional change of a building and the peak ambient temperature associated with this dimensional change. The investigators theorized that the time lag was due to the temperature

---

\*Now the Public Buildings Service of the General Services Administration.

\*\*Public Buildings Administration, Movement of Expansion Joints in Nine Federal Buildings in Washington, D. C. (September 10, 1943-August 29, 1944), unpublished.

gradient between the outside ambient temperature and the inside temperature of the building, the resistance to the transfer of temperature change (insulation), and the duration of the ambient temperature at its extreme levels. Since such parameters determine the rate of temperature change at the axis, this theory appears to be valid.

- (2) The maximum temperature change and the maximum linear dimension of a building are not the only parameters affecting the extent of dimensional change in the building. For example, the effective coefficients of thermal expansion appear to vary widely from building to building and even within a single building.
- (3) The effective coefficient of thermal expansion of the first floor level is approximately one-third to two-thirds that of the upper floors.
- (4) The dimensional change of each building at the upper level corresponds, in most cases, to an effective coefficient of thermal expansion between 2 and 5 per million degrees Fahrenheit. Given the value for this coefficient of 3.3 for brick, 5.5 for concrete, and 6 for steel and the uncertainty of the assumption used to evaluate the temperature change on the basis of which the range from 2 to 5 was derived, the investigation seems to confirm that the upper levels of buildings undergo dimensional changes corresponding to the coefficient of thermal expansion of the principal material of which each is constructed.

c. Explanation of structural expansion by statics

The problem of structural expansion due to temperature change can best be understood in light of the basic mechanics involved. A fundamental analysis of the problem can be made by utilizing statics. Assume for this purpose a one-bay simple bent (Figure 4), free in the two-dimensional space and subjected to uniform positive temperature change. Intuitively, it becomes obvious that the bent ABCD will expand as shown in Figure 4a to the new configuration A'B'C'D' with no accompanying stresses since the expansion is completely unrestrained. If bent  $A_1B_1C_1D_1$  is fixed at the ground, expansion of the bent will occur as shown in Figure 4b. In its deformed position ( $A_1B_1C_1D_1$ ) the bent will be under stress. Supports  $A_1$  and  $D_1$  will develop horizontal thrust  $H_1$  and fixing moment  $M$ , thus subjecting beam  $B_1C_1$  to an axial compressive force. Due to this internal force, the expansion  $B_1B_1'$  of Figure 4b will be smaller than  $BB'$  of Figure 4a. If, on the other hand, the bent is hinged at the bottom, as shown in Figure 4c, there will be no support moment and horizontal thrust  $H_2$  will be smaller than  $H_1$ . As a result, the compression of  $B_2C_2$  will be smaller than that of  $B_1C_1$ . The elongation,  $B_2B_2'$ , of Figure 4c therefore will be greater than  $B_1B_1'$  of Figure 4b but



smaller than  $BB'$  of Figure 4a. Similarly, the compression of  $B_2C_2$  will be between the zero compression of  $BC$  and the compression  $H_1$  of  $B_1C_1$ .

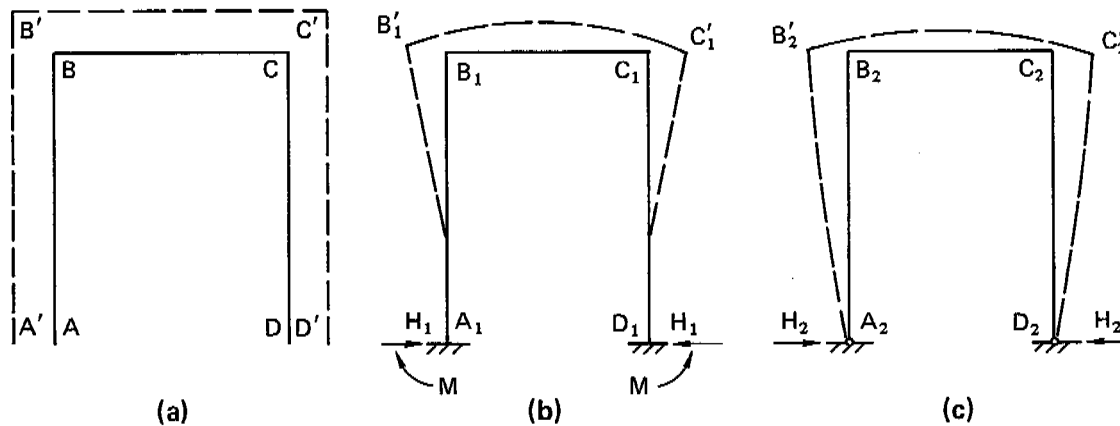


FIGURE 4 Analysis of one-bay simple bent subjected to uniform temperature change: (a) bent completely unrestrained; (b) bent fixed at ground; (c) bent hinged at ground.

In the multistory and multibay frame conditions illustrated in Figure 5, a temperature increase will produce a pattern of stresses and deformations similar to those of the single bent of Figure 4. Although it is more difficult to visualize the mechanics, it remains possible to predict the relative intensities of the thrusts and horizontal joint movements. Due to symmetry, the intensity of the thrusts ( $H_1$ ,  $H_2$ , ... in Figure 5a and  $H'_1$ ,  $H'_2$ , ... in Figure 5b) is maximum at the extreme ends and approaches zero at the center. Similarly, the horizontal displacements of the joints within each floor are maximum at the ends and approach zero at the center of the frame.

These progressive changes of magnitude are a result of the cumulative effect of elongation from the center to the outside. It can be reasoned that the beams near the center of the frame are subjected to maximum axial stresses while the columns near the edges of the frame are subjected to maximum bending moments and shear forces. However, the intensity of these forces, and the accompanying elongations, may vary from story to story and their assessment will require analytical study.

#### d. Analyses of stresses and deformations in frames

An analytical study was formulated and conducted by the Committee to investigate the effects of uniform temperature change on typical two-dimensional elastic frames. It was anticipated that, with the aid of a computer program for two-dimensional stress analysis, the study would facilitate the understanding and evaluation of the temperature effects on joint displacement and forces (shear, axial, and bending) in a long building.

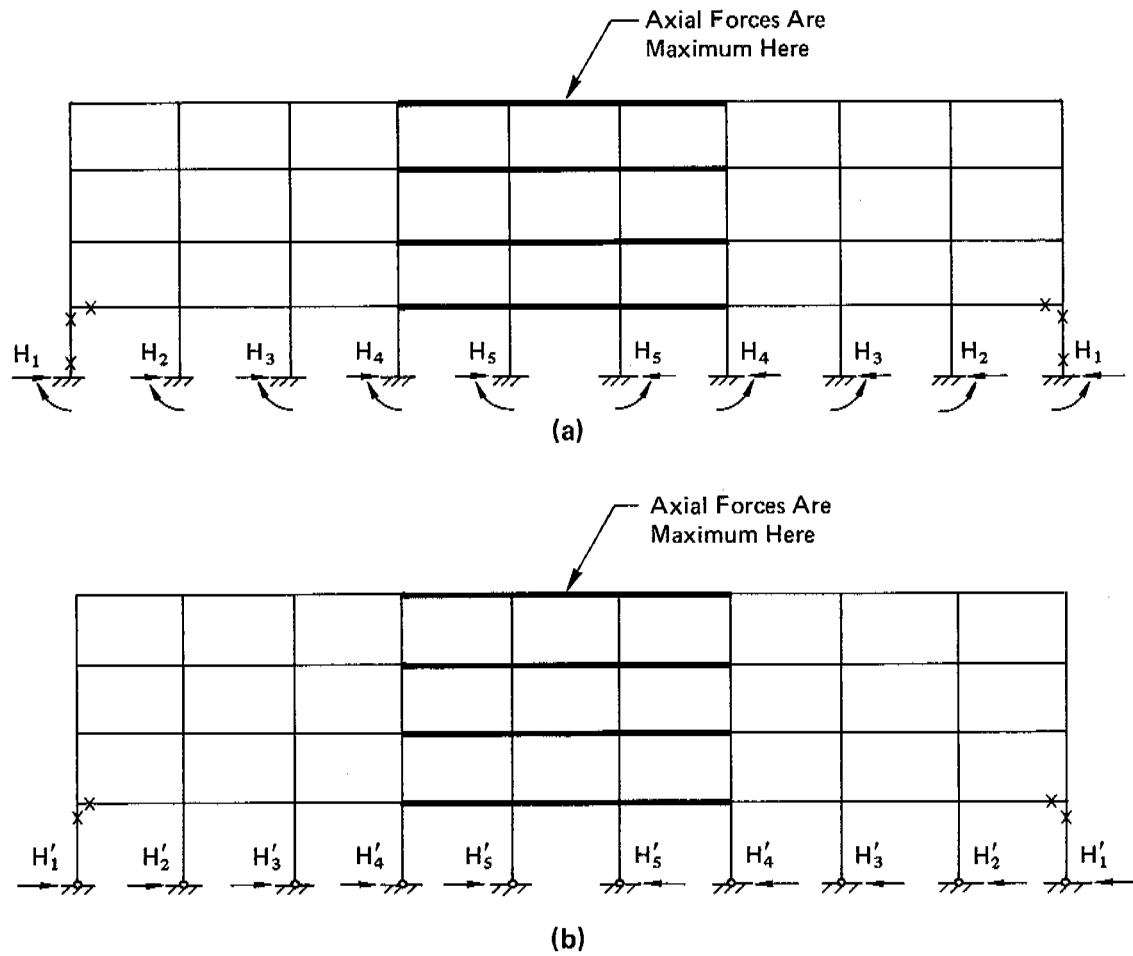


FIGURE 5 Analysis of multistory and multibay frame subjected to uniform temperature change (x = points of maximum bending moments and maximum shear forces): (a) frame fixed at ground; (b) frame hinged at ground.

It is recognized that, in the analysis of a building frame, the actual moments, shears, and thrusts that occur at any point depend on the degree of fixity obtained in the structural joints, the degree of fixity assigned to the foundation of the structure, and other pertinent considerations of this nature. However, for reasons of simplicity and in order to gain a basic qualitative understanding of the nature of temperature effects on a typical frame, extreme conditions were utilized for such considerations during the computer analysis.

The frames analyzed were given a typical bay of 25 feet and a height of 13 feet for the first story and 10 feet for the stories above. These dimensions were common in all frames; however, the following conditions (Table 2) were differentiated:

- (1) Columns fixed at the base (e.g., Anal. 1-1) or columns hinged at base (e.g., Anal. 2-1).
- (2) Either 24 x 24-inch (e.g., Anal. 1-1) or 16 x 16-inch (e.g., Anal. 3-1) columns framed to 14 x 20-inch beams.
- (3) Frames with two (e.g., Anal. A-1) or three stories (e.g., Anal. 4-1) comprised of columns and beams with identical dimensions.
- (4) Frames with beams of a given moment of inertia but different cross-sectional areas (e.g., Anal. A-2)
- (5) Frames with eight bays of 25 feet each (e.g., Anal. 1-1) and a similar frame with 16 bays of 25 feet each (e.g., Anal. B-1).
- (6) Frames symmetrical about a vertical axis and frames with the extreme columns on one end substantially stiffer than the rest of the column (e.g., Anal. M-1; see Appendix A).
- (7) Frames with all columns fixed to the beams at their upper end and frames with outside columns hinged both at top and bottom (e.g., Anal. M-2)

All frames were analyzed for a 100 °F uniform temperature increase and for a coefficient of thermal expansion equal to 6 per million degrees Fahrenheit. An example of the computer output of this study (Anal. M-1) is presented as Appendix A. The tabulated results of the analysis are shown in Table 2.

Column 11 of Table 2 lists the horizontal displacement ratio  $\Delta/\Delta_0$  for the outside joint of the lowest story of the analyzed frames, where  $\Delta_0$  is the unrestrained displacement of a joint and  $\Delta$  is the actual displacement of the joint. A review of analyses 1-1 and 2-1 verifies that for similar frames with fixed or hinged columns  $\Delta/\Delta_0$  is 0.71 and 0.87, respectively. It is noted that the hinged column

TABLE 2 Tabulated Results of Analysis

Anal. No.	Col. Size (in.)	Beam Size (in. 2)	Base Type	Total Length (ft)	No. Stories	Beam		Column		$\Delta/\Delta_o$ (%)	$M/M_E$ (%)	$V/V_E$ (%)	Remarks
						Max. $M^a$	Max. $N^a$	Max. $M^a$	Max. $V^a$				
1	2	3	4	5	6	7	8	9	10	11	12	13	14
1-1	24	280	F	200	3	70	135	600	69	71	48	36	
2-1	24	280	H	200	3	45	77	250	19	87	21	10	
3-1	16	280	F	200	3	53	70	170	22	89	71	60	
4-1	16	280	H	200	3	25	25	75	6	90	31	15	
A-1	24	280	F	200	2	43	182	570	67	71	46	35	
A-2	24	1000	F	200	2	70	321	750	95	86	60	50	
B-1	24	280	F	400	2	128	280	840	90	55	34	23	
M-1	24	280	F	200	3	100	253	740	83	93	59	44	Stiff End
M-2	24	280	F	200	3	50	138	500	60	83	40	31	Hinges Top & Bottom

<sup>a</sup>All figures rounded.

$b_\Delta$  = displacement at edge of base floor

M = max. column B.M. in inch-kips

V = max. column shear in kips


N = axial force in kips

$\Delta_o$  = uninhibited displacement at edge of floors corresponding to 100 °F and length of analyzed frame

$$= \alpha \Delta_t L = 100^\circ F \alpha L$$

$M_E = \frac{6EI\Delta_o}{L^2}$  : end moment corresponding to relative displacement  $\Delta_o$  of ends of member with no rotation permitted at either end of member

$V_E = \frac{12EI\Delta_o}{L^3}$  : shear force developing in member with fixed ends which are displaced relative to each other by  $\Delta_o$

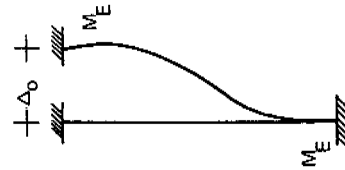

has a horizontal displacement ratio less than the unity value corresponding to an unrestrained frame but greater than the 0.71 value for a fixed column. If columns are hinged rather than fixed at the base, the maximum deformation of the frame at the first floor increases by approximately  $\frac{(87-71)}{71} \approx 23\%$ .

Comparison of analyses 1-1 to 2-1 and 3-1 to 4-1 in columns 7, 8, 9, and 10 of Table 2 reveals that the maximum forces associated with the fixed-column and the hinged-column cases vary in the following ratios:

	For 24 x 24-in. Columns	For 16 x 16-in. Columns
For beam moments	$(70-45)/45 = 55\%$	$(53-25)/25 = 110\%$
For beam axial forces	$(135-77)/77 = 75\%$	$(70-25)/25 = 180\%$
For column moments	$(600-250)/250 = 140\%$	$(70-75)/75 = 130\%$
For column shears	$(60-19)/19 = 150\%$	$(22-6)/6 = 250\%$

Analyses of the results of the various computer runs (Table 2) allow the following observations to be made:

The horizontal displacements ( $\Delta$ ) of all stories except the lower one is almost identical to the displacement,  $\Delta_0$ , that would develop in a totally unrestrained frame (i.e.,  $\Delta \approx \Delta_0$ ). Therefore, if both ends of a frame are equally free to displace, the horizontal displacement of the outside joints of upper stories will be equal to one half of the unrestrained elongation of the frame corresponding to a temperature change,  $\Delta t$ , and a coefficient of thermal expansion,  $\alpha$ ; that is,

$$\Delta_0 = \alpha \Delta_t (1/2L) = 1/2 \alpha (\Delta_t) L, \quad (5)$$

where  $\alpha$  = coefficient of thermal expansion,  $\Delta_0$  = horizontal displacement of a joint at a distance  $1/2 L$  from the center of the frame, and  $L$  = total length of the frame.

In a frame that is restricted from side displacement at one of its two ends, the unimpeded horizontal displacement of the other end will be equal to

$$\Delta_0 = \alpha (\Delta_t) L, \quad (6)$$

since the total expansion of the full length,  $L$ , of the frame will be reflected in displacement of only the unrestricted end of the frame.

A comparison of the data obtained in analyses A-1 and A-2 indicates that for a given frame an increase in the relative cross-sectional area of the beams (not associated with a

simultaneous increase in the moment of inertia of the beams) results in a substantial increase in the deformation of the first floor as well as the maximum forces developed in the frame. This is based on the fact that in temperature-induced stressing a force resulting from the structural restraints and the temperature change is proportional to the cross-sectional area of the restrained members (in this case the beams since the frame is not restrained in the vertical direction). Considering that the rate at which cross-sectional areas increase for a given increase in moment of inertia is faster in concrete members than in steel members, it can be anticipated that a concrete frame will suffer somewhat more than a steel frame from the consequences of thermal expansion.

Finally, a comparison of the results of analyses 1-1 and M-2 indicates that hinges placed at the top and bottom of the exterior columns of the frame reduce the maximum stresses that can be expected to develop in the frame. However, such an arrangement permits an increase in the horizontal expansion of the first floor because it reduces the resistance to such movement.

These analytical studies of temperature effects have quantitative value in the sense that they provide valid bounds of stresses and deformations caused by temperature changes and help to define relative values of stress and deformation among the various locations of a structural frame for given ranges of temperature change.

## 2. The Analytical Method

The difficulties of categorizing every conceivable building configuration and the complexity of the stress and deformation patterns created by thermal change effects in buildings with other than a rectangular configuration make it impracticable to always determine the need for expansion joints on an empirical basis. Also, the designer may wish to exceed the limits on lengths of a building without expansion joints established by the empirical approach described above. In all such cases a detailed structural analysis needs to be performed to support the design. The analysis should incorporate the following basic concepts of and procedures for the design of buildings against the effects of thermal change, regardless of building type or configuration.

### a. Uniform design temperature change ( $\Delta T$ )

When establishing for design purposes the effective maximum temperature change to which a structure is likely to be subjected, the influence of heating and air conditioning must be considered as well as the extreme range of outside temperature. However, there are no available experimental or theoretical data or procedures that will

permit the quantitative evaluation of the influence of heating and air conditioning in reducing the effects of outside temperature fluctuations on a structure. Even if such could be quantified, only a portion of the dampening effect of temperature control on temperature fluctuation could be recognized safely during frame design in view of the lack of temperature control during the construction phase and during periods when the heating/air-conditioning equipment is likely to be inoperative because of mechanical failure or service and maintenance operations. For these reasons, the calculation of the design temperature change for heated and/or air-conditioned buildings should include a minimum empirical coefficient that will reduce the maximum temperature change to which the structure is expected to be exposed but will not give full value to the influence of internal temperature control. In the absence of technically sound data that dictate otherwise, the uniform design temperature change,  $C\Delta_t$ , can be satisfactorily determined by considering  $\Delta_t = (T_w - T_m)$  or  $(T_m - T_c)$ , whichever is greater, and  $C = 1.0$  for buildings not provided with temperature control,  $0.70$  for buildings heated but not air conditioned, and  $0.55$  for buildings heated and air conditioned. Any deviation from these values should be quantitatively justified.

b. Suggested procedures for design of buildings against thermal changes

As in most structural problems, the investigation of thermal effects on a building is reduced to a basic understanding of distributed forces and deformation within the structure. If deformations are resisted the resulting force system in structural members may well exceed the members' strength and cause structural failure; if they are not resisted the change of geometry in the structure may interfere with its overall performance. Therefore, the designer's task is to select one of the following three broad but basic approaches:

- (1) Limit the potential for deformation in the structure (without causing failure) by designing the appropriate members to be substantially stiffened and strengthened.
- (2) Allow for substantial movement of the building's structural members and nonstructural components such that ultimate building performance will not be adversely affected. Such a structure will require practically no additional strength of members to withstand thermal effects.
- (3) Strike a compromise between capacity to resist stress and ability to withstand deformation without sacrificing building performance.

The first approach is quite unrealistic for buildings above two stories. Stiffening and strengthening the lower floors will only transfer the adverse thermal effects to the stories above, and, in effect, the upper floors would then be resting on a rigid artificial base instead of on the ground. Conversely, this approach is inherent

in low, long and massive masonry buildings that have a low tolerance to movement. Their structural frames are designed to maintain building integrity by withstanding the substantial thermal forces that challenge structural strength rather than deformation. Most field experiences indicate that buildings with continuous masonry bearing walls should be provided with expansion joints at intervals not exceeding 200 feet and with additional subjoints in accordance with the recommendations of the Brick Institute of America and the National Concrete Masonry Association.\*

The portions of walls at and near the intersection of two walls, surfaces likely to be weakened by numerous openings for doors and windows, and the rigid connections between horizontal elements (particularly concrete or other stiff roofs) and massive walls are most sensitive to the effects of thermal change. In all such cases either expansion joints or very strong elements that can successfully resist the tendency to deform without yielding must be provided. The forces assumed to be generated under these circumstances can be derived by analyzing the forces necessary to cause elastic deformations comparable to the deformations caused in an unrestricted structure by corresponding temperature changes. Thus, these forces can be determined by the very elementary formula:

$$F = \alpha tEA, \quad (7)$$

where  $F$  = axial force that develops in a member when it is restrained from changing to temperature change,  $\alpha$  = coefficient of thermal expansion,  $E$  = modulus of elasticity,  $A$  = cross-sectional area, and  $t$  = temperature change.

If the member is completely restrained,  $F$  will become the maximum axial force which can develop in a member. However, if the member is completely free to expand,  $F$  will be equivalent to zero. In actual structures the completely restrained and completely unrestrained conditions are unattainable. Physically, the problem can be interpreted through two superimposed conditions.

Thermal changes cause a total change of length,  $\Delta l_t$ , given by the equation:

$$\Delta l_t = \alpha tL, \quad (8)$$

where  $L$  = the affected length of the member.

Forces resisting the change of length will cause a change in length,  $\Delta l_f$ , in the direction opposite  $\Delta l_t$ ;  $\Delta l_f$  is given by Hooke's Law:

$$\Delta l_f = \frac{FL}{EA}. \quad (9)$$

---

\*See p. 4 for publication references.



The net change of length will be:

$$\Delta l = (\Delta l_t - \Delta l_f); \quad (10)$$

therefore, if  $\Delta l = \Delta l_t$  (i.e.,  $\Delta l_f = 0$  or unrestricted change), then  $F = 0$  and if  $\Delta l = 0$  (fully resisted change),  $\Delta l_f = \Delta l_t$  or  $F = \alpha tEA$ .

In all real situations  $F$  therefore lies between these two extremes; i.e.,  $0 < F < \alpha tEA$ .

If  $\Delta l = \beta \Delta l_t$ , where  $0 < \beta < 1.0$ , then  $\Delta l_f = \Delta l_t - \Delta l = \Delta l_t(1 - \beta)$  or  $\frac{FL}{EA} = (1 - \beta)\alpha tEA$ . In interpreting this expression it is observed that if  $\beta$  is the fraction of unrestricted change of length that the member undergoes, the restricting force will equal the complement of this fraction  $(1 - \beta)$  multiplied by the absolute restrictive force ( $F = \alpha tEA$ ). Therefore, the designer must first evaluate what percentage of deformation ( $\beta \Delta l_t$ ) the structure can tolerate without loss of performance and then provide for extra strength in the affected members, beyond the requirements of conventional design needs, to resist the forces  $(1 - \beta)$  and  $\alpha tEA$ . If this cannot be effected within reasonable dimensional or cost constraints, the designer must consider the following alternatives in modifying the structure:

- (1) Provide appropriate connections among structural, parastructural, and nonstructural components that will allow a greater tolerance of deformation without loss of performance (i.e., increase  $\beta$ ).
- (2) Provide for an expansion joint (also called an "isolation" or "separation" joint) in the structural frame, thus reducing the effective length ( $L$ ) value that influences the primary parameter  $\Delta l_t = \alpha tL$ .

While the above is a rational and broad approach to investigation and design, one aspect of the interpretation not readily obvious requires special attention. That is, although a particular structure can tolerate unrestricted change of length (which would correspond to  $\beta = 1$  and  $F = 0$ ), the designer should evaluate how much of the change of length actually can take place under the physical details of the structure. Such an evaluation is important because the statical redundancy of the structure will resist changes in length, even though the structure can tolerate such changes without loss of performance. Unfortunately, the evaluation of resisting forces, and hence the stresses, that will develop in each situation cannot be effected on the basis of a simple mathematical expression. It will require a thorough knowledge of both structural theory and the details of construction and materials involved. When large and multi-indeterminate structures are involved, a computer analysis may be required to supplement the designer's understanding of the nature and distribution of forces. It is important that, initially, the maximum tolerable  $\beta$  be evaluated and used for design; however, the same procedure then should be applied to the probable maximum resisting forces.

It should be noted that the maximum resisting force will depend not on the maximum tolerable fraction  $\beta$ , but rather on the fraction  $\beta$  that will develop as a result of the physical restraints and redundancy of the structure. This value,  $\beta$ , may well be substantially smaller than the maximum a structure can tolerate. The discrepancy between  $\beta$  (tolerable) and  $\beta$  (developed) is easily recognized in the low-level massive masonry building that can tolerate a great deal of elongation but is so rigid and monolithic that the  $\beta$  that does develop is a small fraction of the value that could be tolerated. The result is a buildup of very high internal forces ( $F$ ) that can produce failures at the weak points of the structure. These failures are normally brittle in nature, indicating that they were caused by forces exceeding capacity rather than excessive deformation. In such cases the designer has few options for adapting his structure, which is inherently too stiff, and instead, he must design to allow expansion by reducing the effective length ( $L$ ) that determines the fundamental parameter,  $\Delta l_t = \alpha t L$ . The lowest allowable value of maximum  $L$  obviously depends on the maximum expected temperature change ( $t$ ) since the elongation will be proportionate to both  $L$  and  $t$ . Conversely, when considering flexible buildings with a frame consisting mostly of slender flexural members, the designer can influence the  $\beta$  (developed) value (i.e., the amount of the maximum change of length that will develop in a building). This can be done by an interplay of strength and flexibility. In general, strong but slender flexible members will allow greater changes of length [i.e., higher  $\beta$  (developed) values], and in these situations,  $\beta$  (developed) will approach the ultimate deformation tolerable to the structure. This combination will ensure that the building will perform with a minimum of distress due to temperature change.

### C. THE DESIGN OF EXPANSION JOINTS

The following principles are considered basic to sound expansion joint design.

1. The width of the expansion joint should exceed the maximum potential dimensional changes by an amount sufficient to prevent the complete closing of the joint and, simultaneously, provide for construction tolerances and nature of filler material. The maximum potential dimensional change can be computed either empirically (point 2 below) or by using the formulas given for  $\Delta l_t$  and  $\Delta l_f$  [Eq. (8) and (9)] and by an accurate evaluation of the forces,  $F$  (see p. 25), in the structural system through appropriate structural analysis.
2. The upper bound, UB, of the maximum joint closing obviously will depend on the coefficient of thermal expansion of the material of the frame, the maximum temperature change (i.e., the effective temperature increase  $\Delta t_e = T_w - T_m$ ) that the structural frame is assumed to undergo, and the

effective length,  $L$ , of the structural segments converging at the joints. The effective length,  $L$ , can be computed utilizing the following empirical guidelines in conjunction with Figure 6:

- a. If both the building segments converging on the joint have symmetrical stiffness, only one half of the dimensional change of each segment will affect the joint separation (Figure 6a), hence,

$$L = 1/2(L_1 + L_2). \quad (11)$$

- b. If, however, either segment has one end substantially stiffer than the other, the dimensional change resulting from temperature fluctuation will be distributed unevenly between the two ends of such a segment with comparatively less deformation developing at the stiff end. In such cases,

$$L = 1/2(KL_1 + L_2), \quad (12)$$

where  $K = 1.5$  (i.e., the length of the unsymmetrically stiff segment will be increased by 50 percent if the stiff end is farthest away from the joint; see Figure 6b) or  $K = 0.67$  (i.e., the length of the unsymmetrically stiff end will be decreased by 33 percent if the stiff end is the one abutting the joint; see Figure 6c).

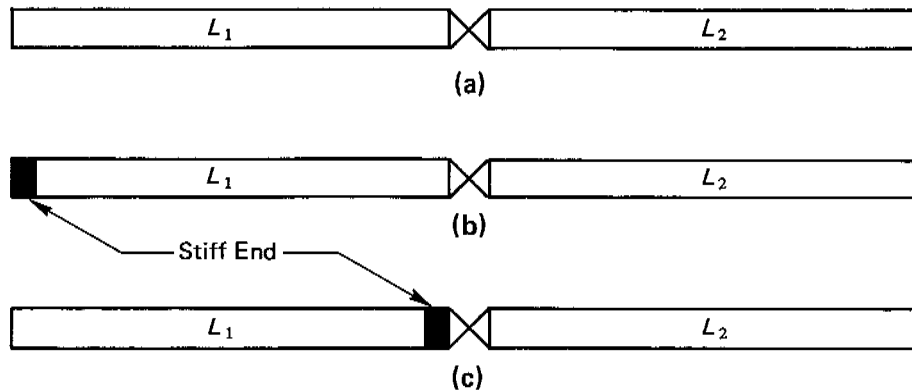


FIGURE 6 Computation of effective length  $L$  of building segments adjacent to the expansion joint: (a) building segments with symmetrical stiffness,  $L = 1/2(L_1 + L_2)$ ; (b) one segment with unsymmetrical stiffness and the stiff end farthest from the joint,  $L = 1/2(1.5L_1 + L_2)$ ; (c) one segment with unsymmetrical stiffness and the stiff end abutting the joint,  $L = 1/2(0.67L_1 + L_2)$ .

The coefficient of thermal expansion of concrete and steel (the principal materials used for buildings with column-and-beam frames) can be considered approximately the same and equal to  $6 \cdot 10^{-6}$  per degree Fahrenheit. The upper bound, UB, of the maximum joint closing can be computed from the expression:

$$UB = (6 \cdot 10^{-6}) \Delta t_e \cdot L, \quad (13)$$

where  $\Delta t_e$  and L are as previously defined.

3. The actual width of the expansion joint must be greater than the UB to provide for construction tolerances and for the width and compressibility or expandability of the joint filler. The UB is likely to develop in those buildings that are not temperature controlled; for this condition, a joint width equal to twice the UB probably would be required. Because the maximum horizontal movement in temperature-controlled buildings is expected to be lower than that in noncontrolled buildings, the joint width can be narrower. Joint widths equal to 1.7 times the UB for buildings heated but not air conditioned and equal to 1.4 times the UB for buildings both heated and air conditioned should be sufficient.
4. For buildings with exterior bearing walls of continuous clay masonry the required joint width, W, can be determined by the expression:

$$W = C_1 \cdot L (50^\circ F + \Delta t_e) (4 \cdot 10^{-6}), \quad (14)$$

where  $C_1 = 2.0$  for buildings with no heat control, 1.7 for buildings heated but not air conditioned, and 1.4 for buildings both heated and air conditioned and  $\Delta t_e$  and L are as previously defined.

In this expression  $4 \cdot 10^{-6}$  is a coefficient approximateing the coefficient of thermal expansion of clay masonry. The term  $50^\circ F$  in the factor  $(50^\circ F + \Delta t_e)$  represents a temperature equivalent to the dimensional changes resulting from potential of swelling of clay masonry under moisture conditions. Finally, the coefficient  $C_1$  is intended to provide for construction tolerances, compressibility and expandability of the joint filler, and the dampening effects on the effective  $\Delta t_e$  of temperature control.

The values for  $C_1$ , which are based on the judgment of the Committee members, are comparable to the correction factors recommended for use with Figure 1 when buildings are provided with temperature control. The rationale for the values is the same as for the Figure 1 correction factors.

5. Notwithstanding the above procedures, practical limits on the width of an expansion joint need to be adopted. It seems reasonable that, in general, an expansion joint should not be narrower than 1 inch. On the other hand, an expansion joint that, according to the computations above, requires greater than 2 inches of width should be specially designed to

ensure that these relatively large dimensional changes can take place without any loss of building serviceability. During architectural design and filler material selection, care must be taken to ensure that the functional and aesthetic requirements of the building are satisfactorily met and that the joint will be sufficiently flexible to guarantee durable and trouble-free operation.

6. It is necessary that an expansion joint extend all the way to the footing because, as is indicated by the analytical studies conducted on two-dimensional frames, a large percentage (on the order of 75 percent) of the maximum dimensional change due to temperature fluctuation develops in the lowest story of a structure and almost the maximum change develops in all the stories above.
7. An expansion joint requires protection from potential accumulation of foreign material or debris that could interfere with the proper functioning of the two parts of the joint. The joint should be designed in such a way that it can be maintained and inspected without difficulty to ensure that it remains effective.

#### D. AREAS OF FUTURE RESEARCH

For convenience, the scope of the Committee's study was limited to expansion joints that separate structural frames of buildings in order to relieve excessive temperature-induced stresses. The practices and procedures suggested herein are considered to be sound and should guide the designer in producing a more efficient building system than in the past. Also, they have been based for the most part on experience and educated judgment. Temperature fluctuations also effect dimensional changes in the vertical direction and the performance of the nonstructural building components; while such effects are not considered in this report, they cannot be ignored during design.

Execution of the most efficient design with respect to the total effects of temperature changes on building performance requires criteria developed on a data base more technically sound than exists at present. Thus, research should be undertaken immediately to provide urgently needed information and data that:

1. Reflect building damage directly attributable to temperature fluctuation.
2. Permit the correlation of ambient temperature with temperatures of building components (structural and nonstructural) at the periphery and within buildings for different building types and materials.
3. Permit the correlation of ambient temperature fluctuations with temperature gradients existing within building components under different conditions of exposure and insulation of these components.


Also needed are analytic and experimental investigations that will lead to the correlation of stresses in the various building components with the different patterns of temperature fluctuations and gradients and with the different types of assembly component (connectors).

Buildings supported on masonry walls require special examination since effects of temperature changes on the performance of such buildings will vary according to the type of masonry material or combinations of material used. Each type and combination should be investigated with respect to construction details, connections of walls to horizontal and vertical components (roofs, floors, walls, and partitions at right angles), optimal spacing of joints, and extent of joints.

## APPENDIX A

### COMPUTER PRINTOUT OF AN ELASTIC ANALYSIS

This section gives an example of a computer printout of an analysis for a frame with the extreme columns on one end substantially stiffer than the rest of the columns (see Figure A-1). This example corresponds to analysis M-1 presented in Table 2. The frame was analyzed for a 100 °F uniform temperature increase and for a coefficient of thermal expansion equal to 6 per million degrees Fahrenheit.

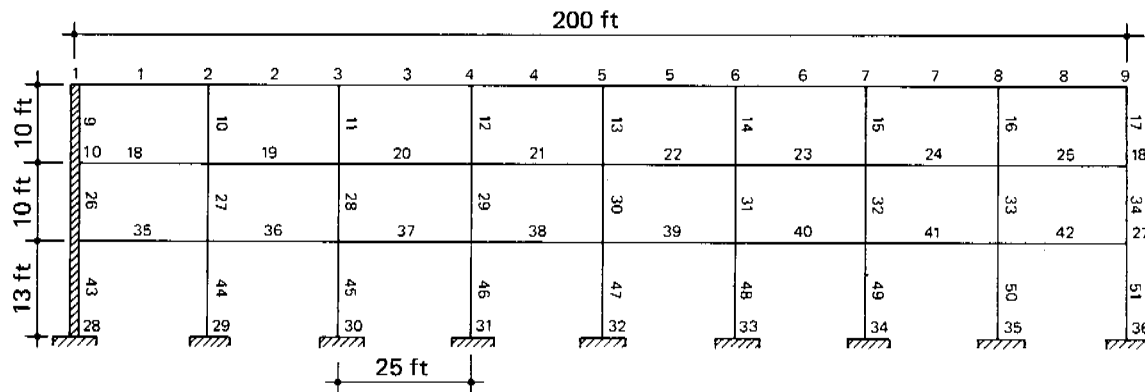

Column Size = 24 • 24 in.  
 Area (A) = 576 in.<sup>2</sup>  
 Moment of Inertia (I) = 27648 in.<sup>4</sup>

Beam Size = 14 • 20 in.  
 Area (A) = 280 in.<sup>2</sup>  
 Moment of Inertia (I) = 4667 in.<sup>4</sup>

FIGURE A-1 Elastic analysis of a frame with columns at one end stiffer than the rest of the columns.

Analysis M-1

## INPUT DATA

PLANE FRAME BY STIFFNESS EQTS M.SOTERIADES 1969

STRUCTURE NO. 2				LOADING NO. 1	
STRUCTURE PARAMETERS*					
M	NJ	NR	NRJ	E	
51	36	27	9	3000000.	
JOINT COORDINATES AND RESTRAINTS					
JOINT	X	Y	X-RESTR.	Y-RESTR.	Z-RESTR.
1	0.00	396.00	0	0	0
2	300.00	396.00	0	0	0
3	600.00	396.00	0	0	0
4	900.00	396.00	0	0	0
5	1200.00	396.00	0	0	0
6	1500.00	396.00	0	0	0
7	1800.00	396.00	0	0	0
8	2100.00	396.00	0	0	0
9	2400.00	396.00	0	0	0
10	0.00	276.00	0	0	0
11	300.00	276.00	0	0	0
12	600.00	276.00	0	0	0
13	900.00	276.00	0	0	0
14	1200.00	276.00	0	0	0
15	1500.00	276.00	0	0	0
16	1800.00	276.00	0	0	0
17	2100.00	276.00	0	0	0
18	2400.00	276.00	0	0	0
19	0.00	156.00	0	0	0
20	300.00	156.00	0	0	0
21	600.00	156.00	0	0	0
22	900.00	156.00	0	0	0
23	1200.00	156.00	0	0	0
24	1500.00	156.00	0	0	0
25	1800.00	156.00	0	0	0
26	2100.00	156.00	0	0	0
27	2400.00	156.00	0	0	0
28	0.00	0.00	1	1	1
29	300.00	0.00	1	1	1
30	600.00	0.00	1	1	1
31	900.00	0.00	1	1	1
32	1200.00	0.00	1	1	1
33	1500.00	0.00	1	1	1
34	1800.00	0.00	1	1	1
35	2100.00	0.00	1	1	1
36	2400.00	0.00	1	1	1

\*Legend:

M = No. of members in the frame  
 NJ = No. of joints in the frame  
 NR = No. of support restraints  
 NRJ = No. of restrained supports  
 E = Modulus of elasticity (lb/in.<sup>2</sup>)  
 JJ = Left end of member  
 JK = Right end of member  
 CX = Directional cosine (x)  
 CY = Directional cosine (y)  
 R = End restraint index (zero = fixed at both ends)  
 W = Dead load

Notes:

- Coordinates x and y are entered in inches and relate to a Cartesian system positioned on joint 28.
- Member cross-sectional areas A are entered in in.<sup>2</sup>
- Moments of inertia of members I are entered in in.<sup>4</sup>
- Member lengths are given in inches
- In general, all dimensions used in input and output are exclusively in inches and pounds



## MEMBER PROPERTIES \*

	JJ	JK	AREA	INERTIA	LENGTH	CX	CY	R	W
1	1	2	280.00	4667.00	300.00	1.000	0.000	0	0.000
2	2	3	280.00	4667.00	300.00	1.000	0.000	0	0.000
3	3	4	280.00	4667.00	300.00	1.000	0.000	0	0.000
4	4	5	280.00	4667.00	300.00	1.000	0.000	0	0.000
5	5	6	280.00	4667.00	300.00	1.000	0.000	0	0.000
6	6	7	280.00	4667.00	300.00	1.000	0.000	0	0.000
7	7	8	280.00	4667.00	300.00	1.000	0.000	0	0.000
8	8	9	280.00	4667.00	300.00	1.000	0.000	0	0.000
9	1	10	576.00	0.00	120.00	0.000	-1.000	0	0.000
10	2	11	576.00	27648.00	120.00	0.000	-1.000	0	0.000
11	3	12	576.00	27648.00	120.00	0.000	-1.000	0	0.000
12	4	13	576.00	27648.00	120.00	0.000	-1.000	0	0.000
13	5	14	576.00	27648.00	120.00	0.000	-1.000	0	0.000
14	6	15	576.00	27648.00	120.00	0.000	-1.000	0	0.000
15	7	16	576.00	27648.00	120.00	0.000	-1.000	0	0.000
16	8	17	576.00	27648.00	120.00	0.000	-1.000	0	0.000
17	9	18	576.00	0.00	120.00	0.000	-1.000	0	0.000
18	10	11	280.00	4667.00	300.00	1.000	0.000	0	0.000
19	11	12	280.00	4667.00	300.00	1.000	0.000	0	0.000
20	12	13	280.00	4667.00	300.00	1.000	0.000	0	0.000
21	13	14	280.00	4667.00	300.00	1.000	0.000	0	0.000
22	14	15	280.00	4667.00	300.00	1.000	0.000	0	0.000
23	15	16	280.00	4667.00	300.00	1.000	0.000	0	0.000
24	16	17	280.00	4667.00	300.00	1.000	0.000	0	0.000
25	17	18	280.00	4667.00	300.00	1.000	0.000	0	0.000
26	10	19	576.00	0.00	120.00	0.000	-1.000	0	0.000
27	11	20	576.00	27648.00	120.00	0.000	-1.000	0	0.000
28	12	21	576.00	27648.00	120.00	0.000	-1.000	0	0.000
29	13	22	576.00	27648.00	120.00	0.000	-1.000	0	0.000
30	14	23	576.00	27648.00	120.00	0.000	-1.000	0	0.000
31	15	24	576.00	27648.00	120.00	0.000	-1.000	0	0.000
32	16	25	576.00	27648.00	120.00	0.000	-1.000	0	0.000
33	17	26	576.00	27648.00	120.00	0.000	-1.000	0	0.000
34	18	27	576.00	0.00	120.00	0.000	-1.000	0	0.000
35	19	20	280.00	4667.00	300.00	1.000	0.000	0	0.000
36	20	21	280.00	4667.00	300.00	1.000	0.000	0	0.000
37	21	22	280.00	4667.00	300.00	1.000	0.000	0	0.000
38	22	23	280.00	4667.00	300.00	1.000	0.000	0	0.000
39	23	24	280.00	4667.00	300.00	1.000	0.000	0	0.000
40	24	25	280.00	4667.00	300.00	1.000	0.000	0	0.000
41	25	26	280.00	4667.00	300.00	1.000	0.000	0	0.000
42	26	27	280.00	4667.00	300.00	1.000	0.000	0	0.000
43	19	28	576.00	0.00	156.00	0.000	-1.000	0	0.000
44	20	29	576.00	27648.00	156.00	0.000	-1.000	0	0.000
45	21	30	576.00	27648.00	156.00	0.000	-1.000	0	0.000
46	22	31	576.00	27648.00	156.00	0.000	-1.000	0	0.000
47	23	32	576.00	27648.00	156.00	0.000	-1.000	0	0.000
48	24	33	576.00	27648.00	156.00	0.000	-1.000	0	0.000
49	25	34	576.00	27648.00	156.00	0.000	-1.000	0	0.000
50	26	35	576.00	27648.00	156.00	0.000	-1.000	0	0.000
51	27	36	576.00	0.00	156.00	0.000	-1.000	0	0.000

## LOAD DATA

LOADED JOINTS= 0

LOADED MEMBS.= 0 (DISTR. L= 0 CONCEN. L= 0 OTHER L= 0)

UNIFORM TEMP. CHANGE=100 DEGREES

COEFF. OF THERMAL EXPANSION= 6.000 PER MILLION DEGREES

\*See Legend, p. 34.

## OUTPUT DATA

JOINT DISPLACEMENTS			
JOINT	DIRECTION-X	DIRECTION-Y	DIRECTION-Z
27	0.6006209E 00	0.9349361E-01	0.1217476E-02
26	0.4206209E 00	0.9335021E-01	-0.2433518E-02
25	0.2678654E 00	0.9373797E-01	-0.1578297E-02
24	0.1304534E 00	0.9374416E-01	-0.7919014E-03
23	-0.1678797E-07	0.9374802E-01	0.1405881E-09
22	-0.1304534E 00	0.9374417E-01	0.7919017E-03
21	-0.2678654E 00	0.9373797E-01	0.1578298E-02
20	-0.4206209E 00	0.9335021E-01	0.2433519E-02
19	-0.6006209E 00	0.9349361E-01	-0.1217476E-02
18	0.7317835E 00	0.1654906E 00	-0.1052131E-03
17	0.5517835E 00	0.1653390E 00	-0.2089101E-03
16	0.3677876E 00	0.1657378E 00	-0.2320321E-03
15	0.1836831E 00	0.1657527E 00	-0.1379756E-03
14	-0.3231054E-07	0.1657592E 00	0.1037993E-09
13	-0.1836831E 00	0.1657527E 00	-0.1379758E-03
12	-0.3677877E 00	0.1657378E 00	0.2320323E-03
11	-0.5517836E 00	0.1653390E 00	0.2089104E-03
10	-0.7317836E 00	0.1654906E 00	-0.1052132E-03
9	0.7292213E 00	0.2374945E 00	-0.5875955E-04
8	0.5492213E 00	0.2373495E 00	0.1189688E-03
7	0.3675841E 00	0.2377333E 00	0.9926945E-04
6	0.1842663E 00	0.2377463E 00	0.5139868E-04
5	-0.4258106E-07	0.2377525E 00	-0.6599168E-10
4	-0.1842664E 00	0.2377463E 00	-0.5139855E-04
3	-0.3675841E 00	0.2377333E 00	-0.9926933E-04
2	-0.5492214E 00	0.2373495E 00	-0.1189687E-03
1	-0.7292214E 00	0.2374945E 00	0.5875952E-04

MEMBER END ACTIONS*									
MEMBER	END	NLF	VLF	MLF	NRT	VRT	MRT		
1	1	-0.488281E-03	-0.552971E-02	-0.224113E-03	0.488281E-03	0.552971E-02	-0.165891E-05		
1	2	-0.458420E-04	-0.206091E-03	-0.318331E-05	0.458420E-04	0.206091E-03	-0.299943E-05		
1	3	-0.928973E-04	-0.140714E-02	-0.233412E-03	0.928973E-04	0.140714E-02	-0.188730E-05		Girders
4	5	-0.119458E-05	0.480144E-02	0.480144E-02	0.119458E-05	0.480144E-02	0.960093E-04		
5	6	-0.928973E-04	0.140714E-02	0.188730E-05	0.928973E-04	0.140714E-02	0.233412E-03		
6	7	-0.458420E-04	0.206091E-03	0.299943E-05	0.458420E-04	0.206091E-03	0.318331E-05		
8	9	-0.476562E-03	0.552971E-02	0.165891E-05	0.476562E-03	0.552971E-02	-0.299943E-05		
10	11	-0.552971E-02	0.458420E-04	0.000000E-00	0.552971E-02	0.458420E-04	0.000000E-00		
11	12	0.963798E-02	0.470552E-04	0.533356E-05	0.963798E-02	0.470552E-04	0.533356E-05		Columns
13	14	0.963798E-02	0.278299E-04	0.284739E-05	0.963798E-02	0.278299E-04	0.284739E-05		
15	16	0.928973E-04	-0.278299E-04	-0.284739E-05	0.928973E-04	-0.278299E-04	-0.284739E-05		
17	18	-0.552971E-02	0.458420E-04	0.000000E-00	-0.552971E-02	0.458420E-04	0.000000E-00		
18	19	0.976562E-03	0.977343E-02	0.203728E-03	0.976562E-03	0.977343E-02	0.203728E-03		
21	22	-0.118847E-05	0.409094E-03	0.602880E-05	-0.118847E-05	0.409094E-03	0.602880E-05		
22	23	-0.103128E-05	0.128746E-03	0.257513E-05	-0.103128E-05	0.128746E-03	0.257513E-05		Girders
23	24	-0.118847E-05	0.409094E-03	0.602880E-05	-0.118847E-05	0.409094E-03	0.602880E-05		
25	26	0.341796E-02	0.977343E-02	0.293202E-03	0.341796E-02	0.977343E-02	0.293202E-03		
27	28	0.424822E-03	0.000000E-00	0.000000E-00	0.424822E-03	0.000000E-00	0.000000E-00		
29	30	-0.158398E-04	0.157726E-04	-0.591287E-06	-0.158398E-04	0.157726E-04	-0.591287E-06		Columns
31	32	-0.161437E-03	-0.494965E-03	-0.363417E-01	-0.161437E-03	-0.494965E-03	-0.363417E-01		
33	34	-0.157812E-01	0.509800E-04	0.629950E-06	-0.157812E-01	0.509800E-04	0.629950E-06		
35	36	-0.424541E-02	0.000000E-00	0.591287E-06	-0.424541E-02	0.000000E-00	0.591287E-06		
37	38	0.192284E-06	0.374221E-04	0.601245E-06	0.192284E-06	0.374221E-04	0.601245E-06		Girders
39	40	0.138730E-06	0.221230E-03	0.147828E-06	0.138730E-06	0.221230E-03	0.147828E-06		
41	42	0.192284E-06	0.374221E-04	0.601245E-06	0.192284E-06	0.374221E-04	0.601245E-06		
43	44	0.117840E-04	0.000000E-00	0.000000E-00	0.117840E-04	0.000000E-00	0.000000E-00		
45	46	-0.152831E-04	-0.605118E-05	-0.342604E-07	-0.152831E-04	-0.605118E-05	-0.342604E-07		Columns
47	48	-0.159696E-04	0.180075E-05	0.983542E-06	-0.159696E-04	0.180075E-05	0.983542E-06		
49	50	-0.159696E-04	0.180075E-05	0.983542E-06	-0.159696E-04	0.180075E-05	0.983542E-06		
51	52	0.276688E-04	0.605118E-05	0.342604E-07	0.276688E-04	0.605118E-05	0.342604E-07		

\*Legend:

NLF = Axial force: left end (lb)

VLF = Shear force: left end (lb)

MLF = Moment: left end (lb)

NRT = Axial force: right end (lb)

VRT = Shear force: right end (lb)

MRT = Moment: right end (lb)

SUPPORT REACTIONS		
JOINT	DIRECTION-X	DIRECTION-Y
28	0.000000E 00	0.117840E 04
29	0.605118E 05	0.276884E 04
30	0.379520E 05	-0.152831E 04
31	0.180075E 05	-0.159696E 04
32	0.152641E -02	-0.163970E 04
33	-0.180075E 05	-0.159696E 04
34	-0.379520E 05	-0.152831E 04
35	-0.605118E 05	-0.276884E 04
36	0.000000E 00	0.117840E 04

Deformations		Deformations		$\Sigma \Delta_x$	
0.45 in. •	1 X	1	1	1	1.07 in. •
0.33 in. •	2 X	2	2	2	0.99 in. •
0.17 in. •	3 X	3	3	3	0.67 in. •

x Designates Location of Critical Stress (*N*, *V*, or *M*)

Uninhibited Motion  $\Delta_0 = \alpha \cdot 100^\circ \cdot L = 1.44$  in.  
 $\Sigma \Delta_x = 1.52$  in.

Critical Stress Components

Floor Level	Column		Girder	
	<i>M</i> <sub>max</sub> (ft-kips)	<i>V</i> <sub>max</sub> (kips)	<i>M</i> <sub>max</sub> (ft-kips)	<i>N</i> <sub>max</sub> (kips)
Base floor	740 (51) <sup>a</sup>	83.2 (51)	~100 (42)	253 (36)
Mid floor	245 (34)	11.1 (34)	~30 (25)	57.3 (19)
Top floor	100 (17)	9.4 (17)	~11 (2)	46.8 (1)

<sup>a</sup>Numbers in parenthesis refer to the number of the member.

## APPENDIX B

## TEMPERATURE DATA

The following tabulation presents mean construction season temperature ( $T_m$ ) and extreme summer ( $T_w$ ) and winter ( $T_c$ ) temperature data for various localities in the United States. Most stations listed are located at airports; those identified as CO are city offices.

$T_m$  = the mean temperature during the normal construction season in the locality of the building. For the purpose of this report the normal construction season for a locality is defined as that contiguous period in a year during which the minimum daily temperature equals or exceeds 32 °F.\*

$T_w$  = the temperature exceeded, on the average, only 1 percent of the time during the summer months of June through September in the locality of the building. (In a normal summer there would be approximately 30 hours at or above the design value.\*\*)

$T_c$  = the temperature equaled or exceeded, on the average, 99 percent of the time during the winter months of December, January, and February in the locality of the building. (In a normal winter there would be approximately 22 hours at or below this design value.\*\*)

---

\*These contiguous periods for each locality in the United States were obtained from the Decennial Census of United States Climate: Daily Normals of Temperature and Heating Degree Days (see reference on page 11) and the mean construction season temperature values  $T_m$  were computed (by Maj. T. E. Stanton of the USAF Environmental Technical Applications Center, Washington, D. C.) from the mean monthly temperatures extracted from the National Weather Services' Local Climatological Data Summaries for the stations. In a few cases other sources also were used.

\*\*The  $T_w$  and  $T_c$  values are extracted from the ASHRAE Handbook of Fundamentals (1972), published by the American Society of Heating, Refrigerating and Air-Conditioning Engineers.

Station	Temperature (°F)			Station	Temperature (°F)		
	T <sub>w</sub>	T <sub>m</sub>	T <sub>c</sub>		T <sub>w</sub>	T <sub>m</sub>	T <sub>c</sub>
<u>Alabama</u>				<u>Florida (Continued)</u>			
Birmingham	97	63	19	Jacksonville	96	68	29
Huntsville	97	61	13	Key West	90	77	55
Mobile (CO)	96	68	28	Lakeland (CO)	95	72	35
Montgomery	98	66	22	Miami	92	75	44
<u>Alaska</u>				Miami Beach (CO)	91	75	45
Anchorage	73	51	-25	Orlando	96	72	33
Barrow	58	38	-45	Pensacola (CO)	92	68	29
Fairbanks	82	50	-53	Tallahassee	96	68	25
Juneau	75	48	-7	Tampa	92	72	36
Nome	66	45	-32	West Palm Beach	92	75	40
<u>Arizona</u>				<u>Georgia</u>			
Flagstaff	84	58	0	Athens	96	61	17
Phoenix	108	70	31	Atlanta	95	62	18
Prescott	96	64	15	Augusta	98	64	20
Tucson	105	67	29	Columbus	98	65	23
Winslow	97	67	9	Macon	98	65	23
Yuma	111	72	37	Rome	97	62	16
<u>Arkansas</u>				Savannah/Travis	96	67	24
Ft. Smith	101	65	15	<u>Hawaii</u>			
Little Rock	99	65	19	Hilo	85	73	59
Texarkana	99	65	22	Honolulu	87	76	60
<u>California</u>				<u>Idaho</u>			
Bakersfield	103	65	31	Boise	96	61	4
Burbank	97	64	36	Idaho Falls	91	61	-12
Eureka/Arcata	67	52	32	Lewiston	98	60	6
Fresno	101	63	28	Pocatello	94	60	-8
Long Beach	87	63	41	<u>Illinois</u>			
Los Angeles	94	62	41	Chicago	95	60	-3
Oakland	85	57	35	Moline	94	63	-7
Sacramento	100	60	30	Peoria	94	61	-2
San Diego	86	62	42	Rockford	92	62	-7
San Francisco	83	56	35	Springfield	95	62	-1
Santa Maria	85	57	32	<u>Indiana</u>			
<u>Colorado</u>				Evansville	96	65	6
Alamosa	84	60	-17	Fort Wayne	93	62	0
Colorado Springs	90	61	-1	Indianapolis	93	63	0
Denver	92	62	-2	South Bend	92	61	-2
Grand Junction	96	64	8	<u>Iowa</u>			
Pueblo	96	64	-5	Burlington	95	64	-4
<u>Connecticut</u>				Des Moines	95	64	-7
Bridgeport	90	60	4	Dubuque	62	63	-11
Hartford	90	61	1	Sioux City	96	64	-10
New Haven	88	59	5	Waterloo	91	63	-12
<u>Delaware</u>				<u>Kansas</u>			
Wilmington	93	62	12	Dodge City	99	64	3
<u>Florida</u>				Goodland	99	65	-2
Daytona Beach	94	70	32	Topeka	99	69	3
Ft. Myers	94	74	38	Wichita	102	68	5

Station	Temperature (°F)			Station	Temperature (°F)		
	T <sub>w</sub>	T <sub>m</sub>	T <sub>c</sub>		T <sub>w</sub>	T <sub>m</sub>	T <sub>c</sub>
<u>Kentucky</u>				<u>Montana</u>			
Covington	93	63	3	Billings	94	60	-10
Lexington	94	63	6	Glasgow	96	60	-25
Louisville	96	64	8	Great Falls	91	58	-20
<u>Louisiana</u>				Havre	91	58	-22
Baton Rouge	96	68	25	Helena	90	58	-17
Lake Charles	95	68	29	Kalispell	88	56	-7
New Orleans	93	69	32	Miles City	97	62	-19
Shreveport	99	66	22	Missoula	92	58	-7
<u>Maine</u>				<u>Nebraska</u>			
Caribou	85	56	-18	Grand Island	98	65	-6
Portland	88	58	-5	Lincoln (CO)	100	64	-4
<u>Maryland</u>				Norfolk	97	64	-11
Baltimore	94	63	12	North Platte	97	64	-6
Frederick	94	63	7	Omaha	97	64	-5
<u>Massachusetts</u>				Scottsbluff	96	62	-8
Boston	91	58	6	<u>Nevada</u>			
Pittsfield	86	58	-5	Elko	94	61	-13
Worcester	89	58	-3	Ely	90	59	-6
<u>Michigan</u>				Las Vegas	108	66	23
Alpena	87	57	-5	Reno	95	62	2
Detroit-Metropolitan	92	58	4	Winnemucca	97	63	1
Escanaba	82	55	-7	<u>New Hampshire</u>			
Flint	89	60	-1	Concord	91	60	-11
Grand Rapids	91	62	2	<u>New Jersey</u>			
Lansing	89	59	2	Atlantic City	91	61	14
Marquette	88	55	-8	Newark	94	62	11
Muskegon	87	59	4	Trenton (CO)	92	61	12
Sault Ste Marie	83	55	-12	<u>New Mexico</u>			
<u>Minnesota</u>				Albuquerque	96	64	14
Duluth	85	55	-19	Raton	92	64	-2
International Falls	86	57	-29	Roswell	101	70	16
Minneapolis/St. Paul	92	62	-14	<u>New York</u>			
Rochester	90	60	-17	Albany	91	61	-5
St. Cloud	90	60	-20	Binghampton (CO)	91	67	-2
<u>Mississippi</u>				Buffalo	88	59	3
Jackson	98	66	21	New York	94	59	11
Meridian	97	65	20	Rochester	91	59	2
Vicksburg (CO)	97	66	23	Syracuse	90	59	-2
<u>Missouri</u>				<u>North Carolina</u>			
Columbia	97	65	2	Asheville	91	60	13
Kansas City	100	65	4	Charlotte	96	60	18
St. Joseph	97	66	-1	Greensboro	94	64	14
St. Louis	98	65	4	Raleigh/Durham	95	62	16
Springfield	97	64	5	Wilmington	93	63	23
				Winston/Salem	94	63	14

Station	Temperature (°F)			Station	Temperature (°F)		
	T <sub>w</sub>	T <sub>m</sub>	T <sub>c</sub>		T <sub>w</sub>	T <sub>m</sub>	T <sub>c</sub>
<u>North Dakota</u>				<u>Tennessee</u>			
Bismarck	95	60	-24	Bristol/Tri City	92	63	11
Devils Lake	93	58	-23	Chattanooga	97	60	15
Fargo	92	59	-22	Knoxville	95	60	13
Minot	91		-24	Memphis	98	62	17
Williston	94	59	-21	Nashville	97	62	12
<u>Ohio</u>				<u>Texas</u>			
Akron/Canton	89	60	1	Abilene	101	65	17
Cincinnati (CO)	94	62	8	Amarillo	98	66	8
Cleveland	91	61	2	Austin	101	68	25
Columbus	92	61	2	Brownsville	94	74	36
Dayton	92	61	0	Corpus Christi	95	71	32
Mansfield	91	61	1	Dallas	101	66	19
Sandusky (CO)	92	60	4	El Paso	100	65	21
Toledo	92	61	1	Fort Worth	102	66	20
Youngstown	89	59	1	Galveston	91	70	32
<u>Oklahoma</u>				Houston	96	68	28
Oklahoma City	100	64	11	Laredo AFB	103	74	32
Tulsa	102	65	12	Lubbock	99	67	11
<u>Oregon</u>				Midland	100	66	19
Astoria	79	50	27	Port Arthur	94	69	29
Eugene	91	52	22	San Angelo	101	65	20
Medford	98	56	21	San Antonio	99	69	25
Pendleton	97	58	3	Victoria	98	71	28
Portland	91	52	21	Waco	101	67	21
Roseburg	93	54	25	Wichita Falls	103	66	15
Salem	92	52	21	<u>Utah</u>			
<u>Pennsylvania</u>				Salt Lake City	97	63	5
Allentown	92	61	3	<u>Vermont</u>			
Erie	88	59	7	Burlington	88	57	-12
Harrisburg	92	61	9	<u>Virginia</u>			
Philadelphia	93	63	11	Lynchburg	94	62	15
Pittsburgh	90	63	5	Norfolk	94	60	20
Reading (CO)	92	61	6	Richmond	96	64	14
Scranton/Wilkes-Barre	89	61	2	Roanoke	94	63	15
Williamsport	91	61	1	<u>Washington, D. C.</u>			
<u>Rhode Island</u>				National Airport	94	63	16
Providence	89	60	6	<u>Washington</u>			
<u>South Carolina</u>				Olympia	85	51	21
Charleston	95	66	23	Seattle	85	51	20
Columbia	98	64	20	Spokane	93	58	-2
Florence	96	64	21	Walla Walla	98	57	12
Greenville	95	61	19	Yakima	94	62	6
Spartanburg	95	60	18	<u>West Virginia</u>			
<u>South Dakota</u>				Charleston	92	63	9
Huron	97	62	-16	Huntington (CO)	95	63	10
Rapid City	96	61	-9	Parkersburg (CO)	93	62	8
Souix Falls	95	62	-14				



Station	Temperature (°F)			Station	Temperature (°F)		
	T <sub>w</sub>	T <sub>m</sub>	T <sub>c</sub>		T <sub>w</sub>	T <sub>m</sub>	T <sub>c</sub>
<u>Wisconsin</u>				<u>Wyoming</u>			
Green Bay	88	59	-12	Casper	92	59	-11
La Crosse	90	62	-12	Cheyenne	89	58	-6
Madison	92	61	-9	Lander	92	58	-16
Milwaukee	90	60	-6	Sheridan	95	59	-12