

Ordering details

When ordering a universal c.t. it is sufficient to quote the type designation. The inscription on the nameplate, which is fixed for each type, conforms to the values given under "Technical details".

But in order that it can be clearly seen from the order, for what data the c.t. are actually to be used, the details given in the order should be specified in roughly the following manner.

Item 20: 3 universal intermediate c.t.'s type WI 23 D 1, 0.446/2.89 A, 4 VA in class 5 P 20, 50 Hz.
Connections as per enclosed form CH-ES 64-71.021.

Item 30: 3 universal intermediate c.t.'s type WI 23 D 5, 5/1 A, 30 VA, current error at rated current and rated output, max. 1%. Connections as per enclosed form CH-ES 64-71.021.

Determination of the ratio to be used in a given case, as well as the connection and the dimensions, is the task of those who plan the installation (customer, local BBC agents, Baden).

Dimensions (in millimetres)

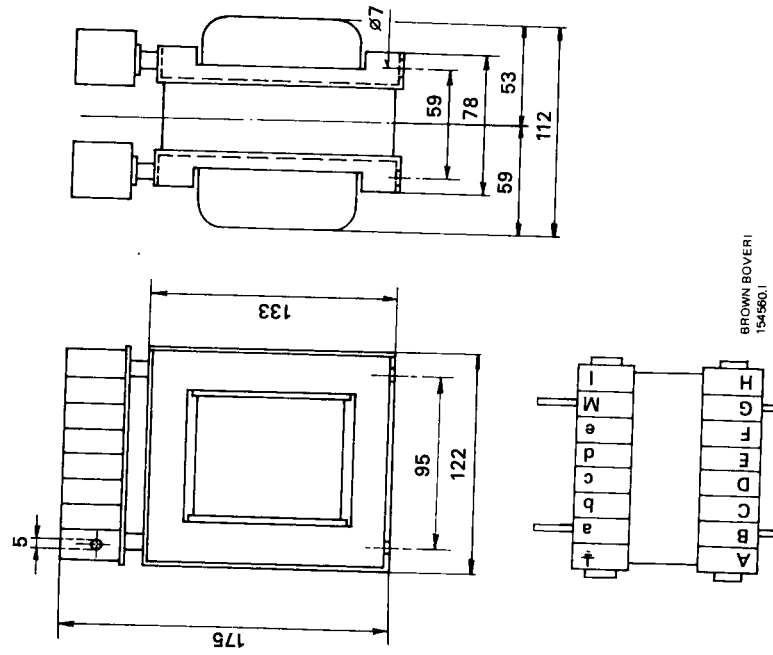


Fig. 4

Weight: 5.3 kg