


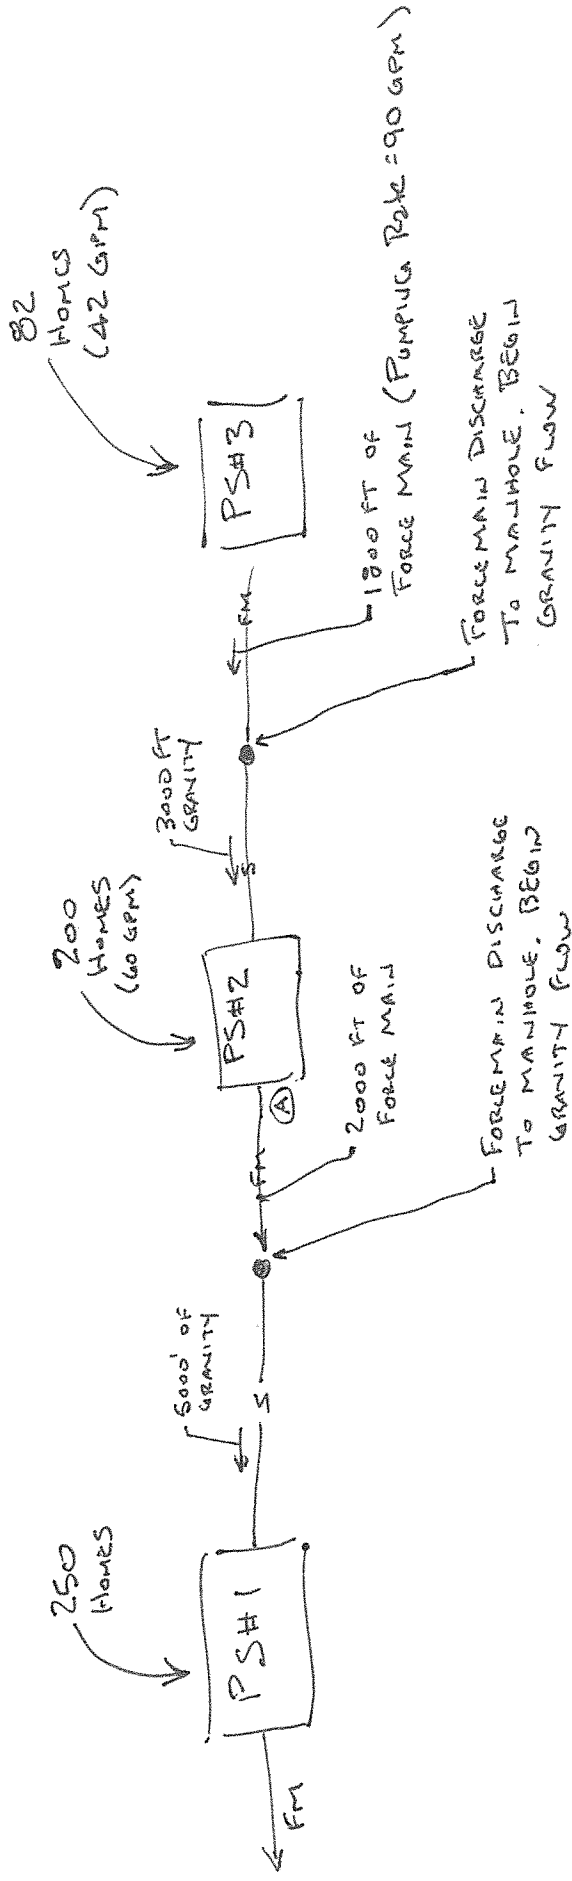

AT POINT (A) SHOULD PUMP STATION #2 BE SIZED FOR THE 60 GPM OF DIRECT INFLOW AND THE PUMPING RATE OF 90 GPM FROM PUMP STATION #3?

GPM = gallons per minute
 PS = Pump Station
 FM = Force Main