


MER DRAWING
1011 FOR
TENANTS EAST
BOARD

One REF relay two LV supply's
Two sets of match CT's on each
supply but with different ratio's
MCAG set at 0.5.

2000A
TP&N

630A
TP&N

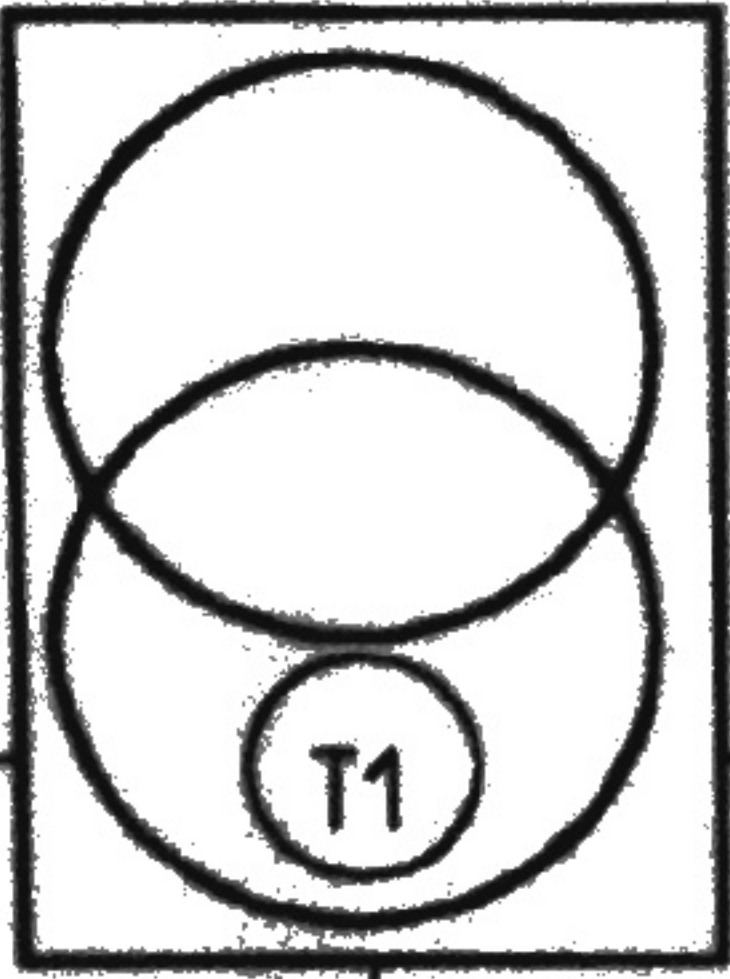

800 kVA
DRY, FANCOOLED
TRANSFORMER

HV ISOLATOR
+ EARTH

SUPPLY
AUTHORITY
METERING
EQUIPMENT

LANDLORD

No Neutral Earth Link in place
After CT's
**4 POLE
1600A**
One Set of Matched 1600/5 CT's (This set had the missing Neutral CT)

Neutral Earth link in place after CT's
**4 POLE
400A**
2nd Set of Matched 400/5 CT's
**HARDWIRED INTERLOCK
& PLC CONTROL**