

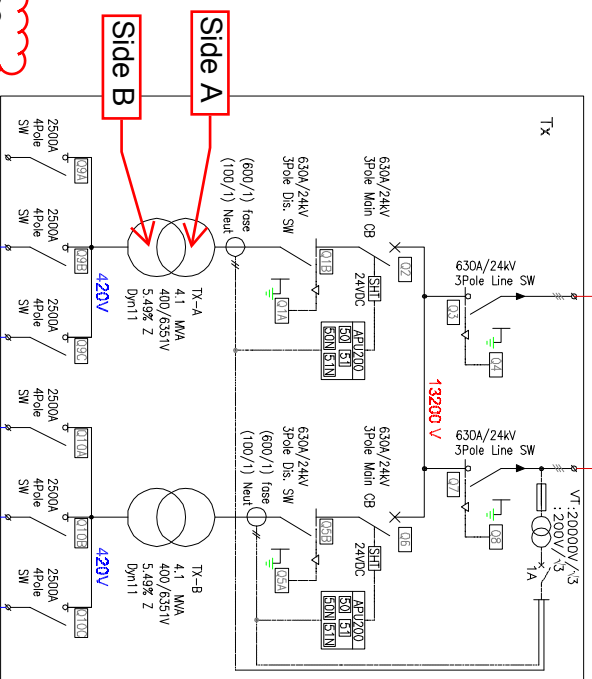


3 x 1C x 120 MM Cu Cable (13.2KV)

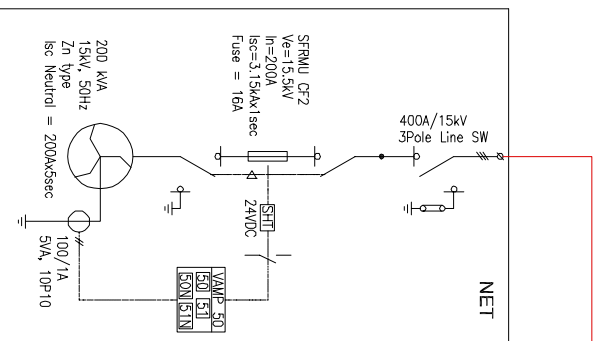

Based on the data next to the transformers..

1. Where should I draw the delta and the wye?
2. Should the wye be solid grounded?
3. What requirement does the zigzag transformer impose?

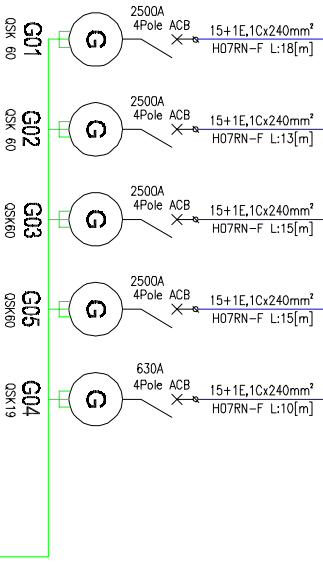

Point of Earth
Connection by Client