






Branch A, low pressure drop.
Q objective 30%

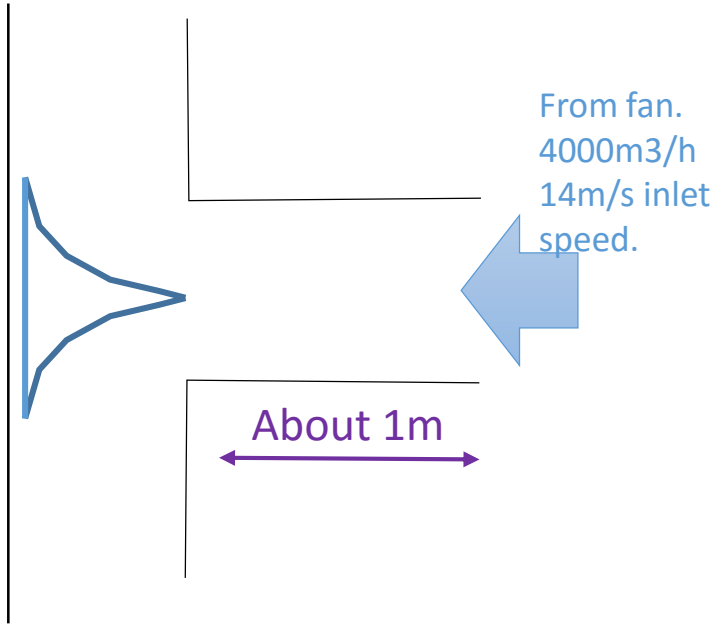

We ask our CFD consultant to
match deflector position to balance
the flow as we need.
The result seems not sensible for
me.

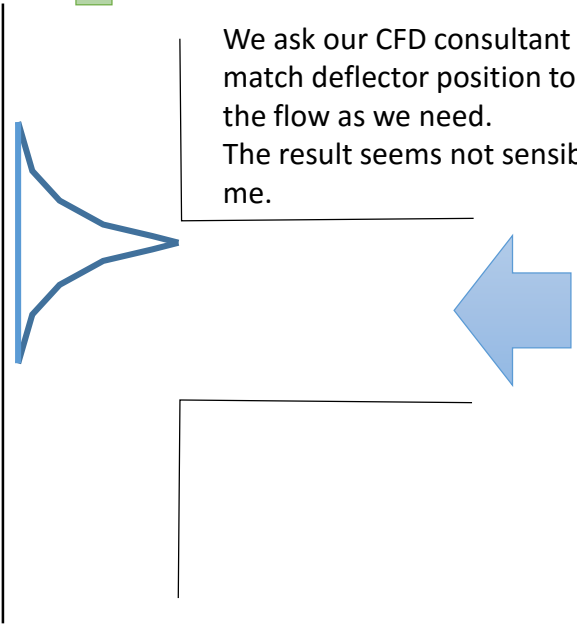

Our fan supplier proposes this
Solution that they seem to have
applied in other problems.

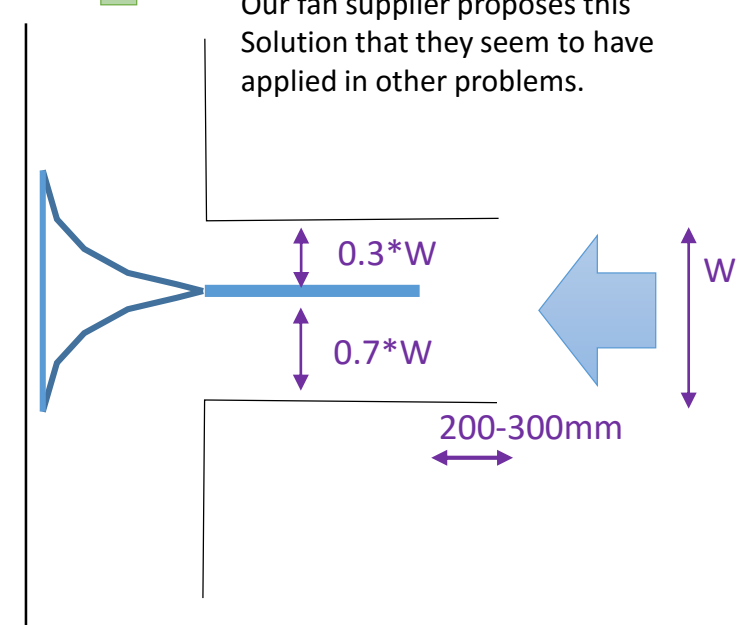

Branch B, high pressure drop.
(x2 A in nominal flow)
Q objective 70%

