



NOTES:

1. POLYPROPYLENE LINER MINIMUM 750 MICRON. ALL JOINTS TO BE FUSION WELDED.
2. ATLANTIS FLO DUCTS TO HAVE A MIN SPACING OF 25 mm.
3. DRAWING TO BE READ IN CONJUNCTION WITH 480,481,483 AND DESIGN SPECIFICATIONS AND CONTRACT DOCUMENT .
4. HUMIDIFIER NOZZLE TO BE ULTIMIST 1/4" INCH 416 SS MISTING NOZZLE,MEDIUM ANGLE.
5. SINAGE IN ISOLATION MH TO BE WHITE TRAFFOLYTE FIXED TO INSIDE OF MH,TEXT BLACK 25mm.
6. ALL VALVES TO BE CLOCKWISE CLOSING.

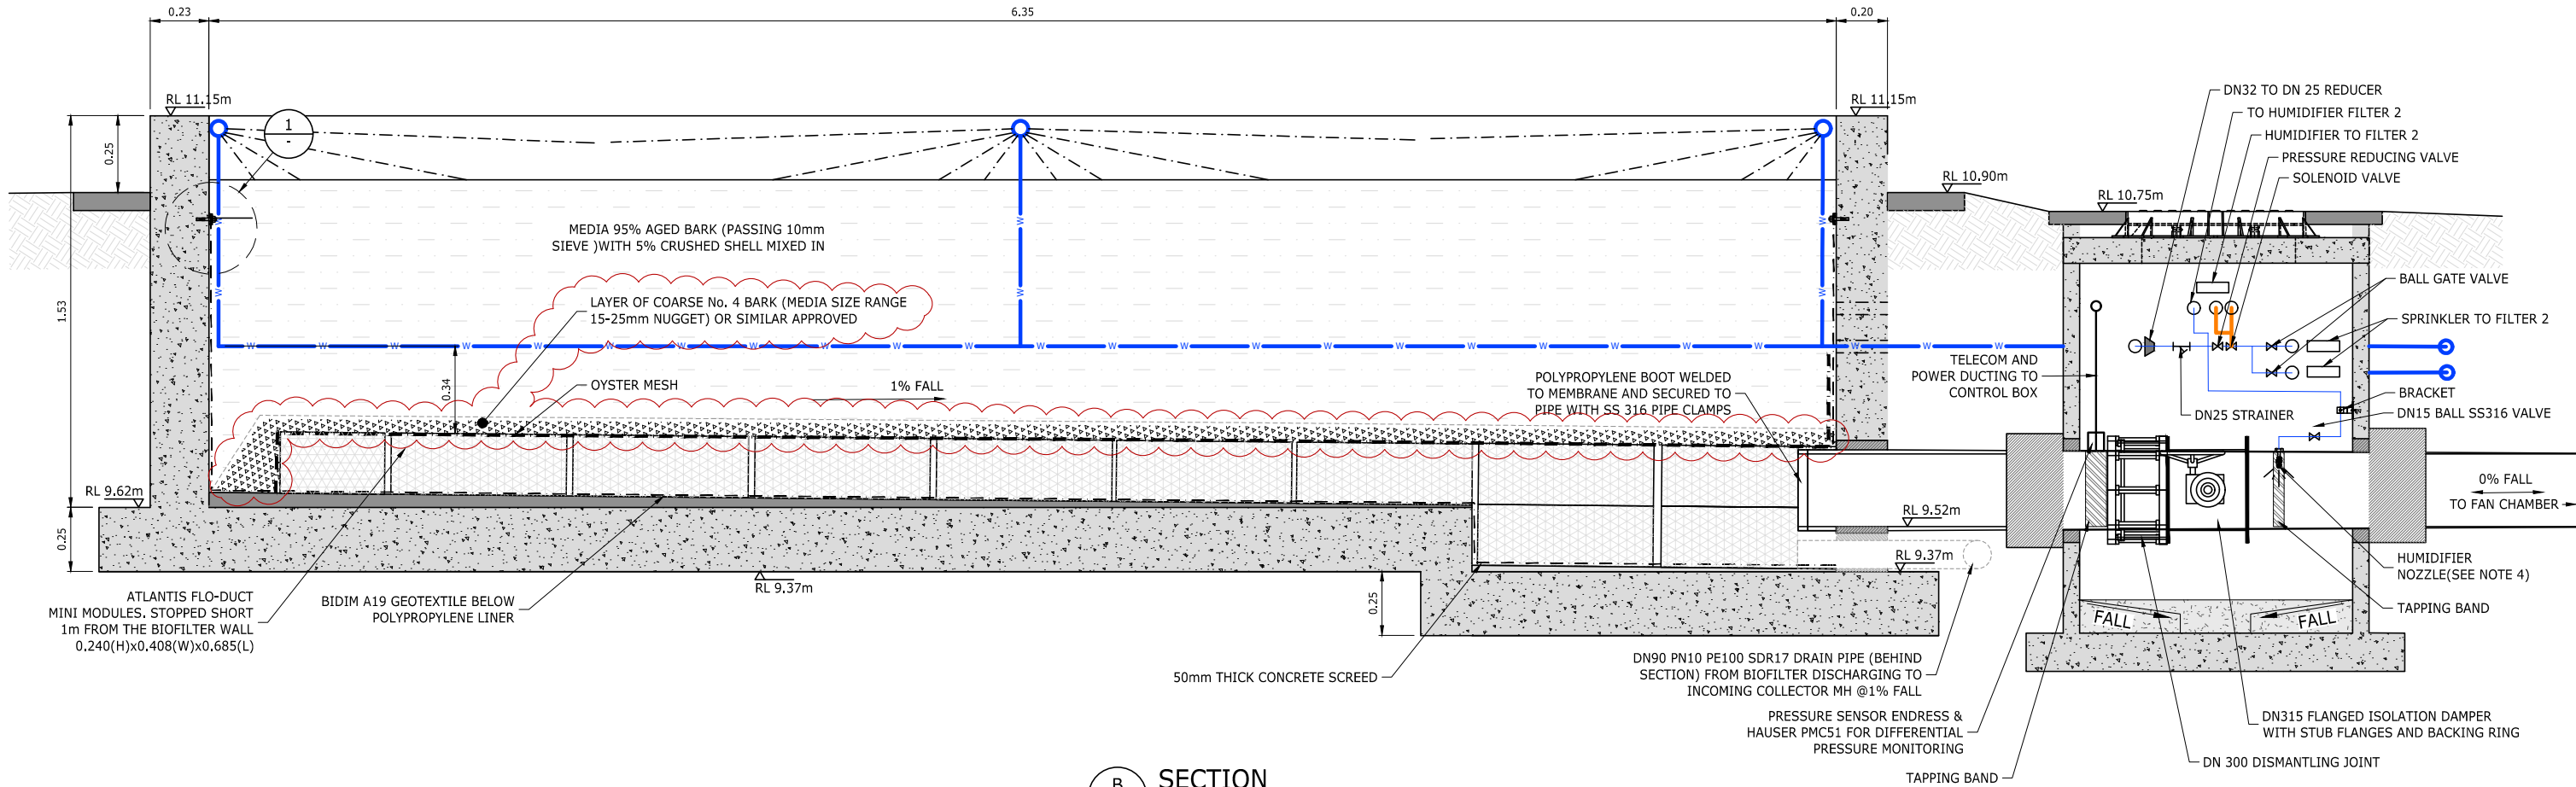

B SECTION
SCALE 1:12.5 - A1, 1:25 - A3

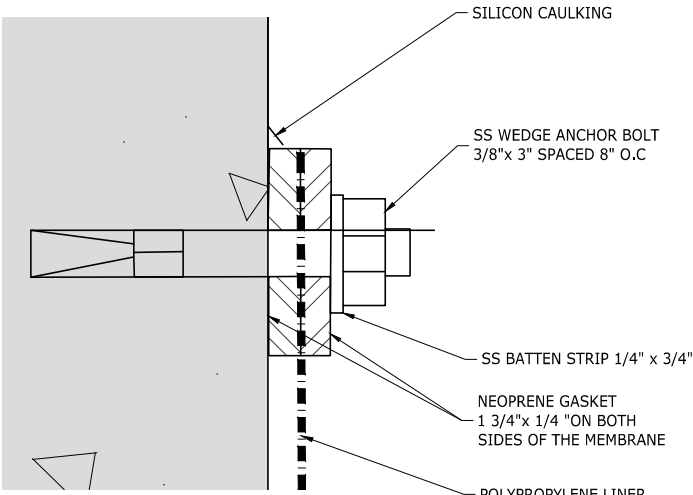

1 DETAIL
SCALE NTS

				ORIGINATOR: NXS	DATE: 20.04.21	SIGNED:	PLOT BY: NXS		ASSOCIATION OF CONSULTING ENGINEERS NEW ZEALAND	ISO 9001 QUALITY ASSURED		TAURANGA OFFICE LEVEL 1, 60 SPRING STREET TAURANGA 3110 T +64 7 578 0023 W www.harrisongrierson.com	PROJECT:  TBE 3 LIMITED TAURIKO BUSINESS ESTATE TAURIKO	TITLE: STAGE 3A WASTEWATER PUMP STATION PS164 BIO-FILTER SECTION	ISSUE STATUS: CONSTRUCTION	
				DRAWN: NXS	DATE: 20.04.21	SIGNED:	PLOT DATE: 29.06.22								PROJECT No: 1550-A2010290.00	SCALES: AS SHOWN
C	LAYER OF COARSE BARK ADDED	RNK	29.06.22	CHECKED: KWG	DATE: 29.06.22	SIGNED:	SURVEY BY:	THIS DRAWING AND DESIGN REMAINS THE PROPERTY OF, AND MAY NOT BE REPRODUCED OR ALTERED, WITHOUT THE WRITTEN PERMISSION OF HARRISON GRIERSON CONSULTANTS LIMITED. NO LIABILITY SHALL BE ACCEPTED FOR UNAUTHORISED USE OF THIS DRAWING.								
B	LEVELS CLARIFIED AND SCALE ADDED	NXS	20.12.2021													
A	ISSUED FOR CONSTRUCTION	GPR	05.10.21	APPROVED: MF	DATE: 29.06.22	SIGNED:	SURVEY DATE:									
REF	REVISIONS	BY	DATE													