

Damage taken place at Air vent Area



Air Vent Photograph



2018-9-14 14:18


Internal Damage at Air Vent Area



Internal Damage at Chilled water supply & return line nozzles area



View from Top of the air vent

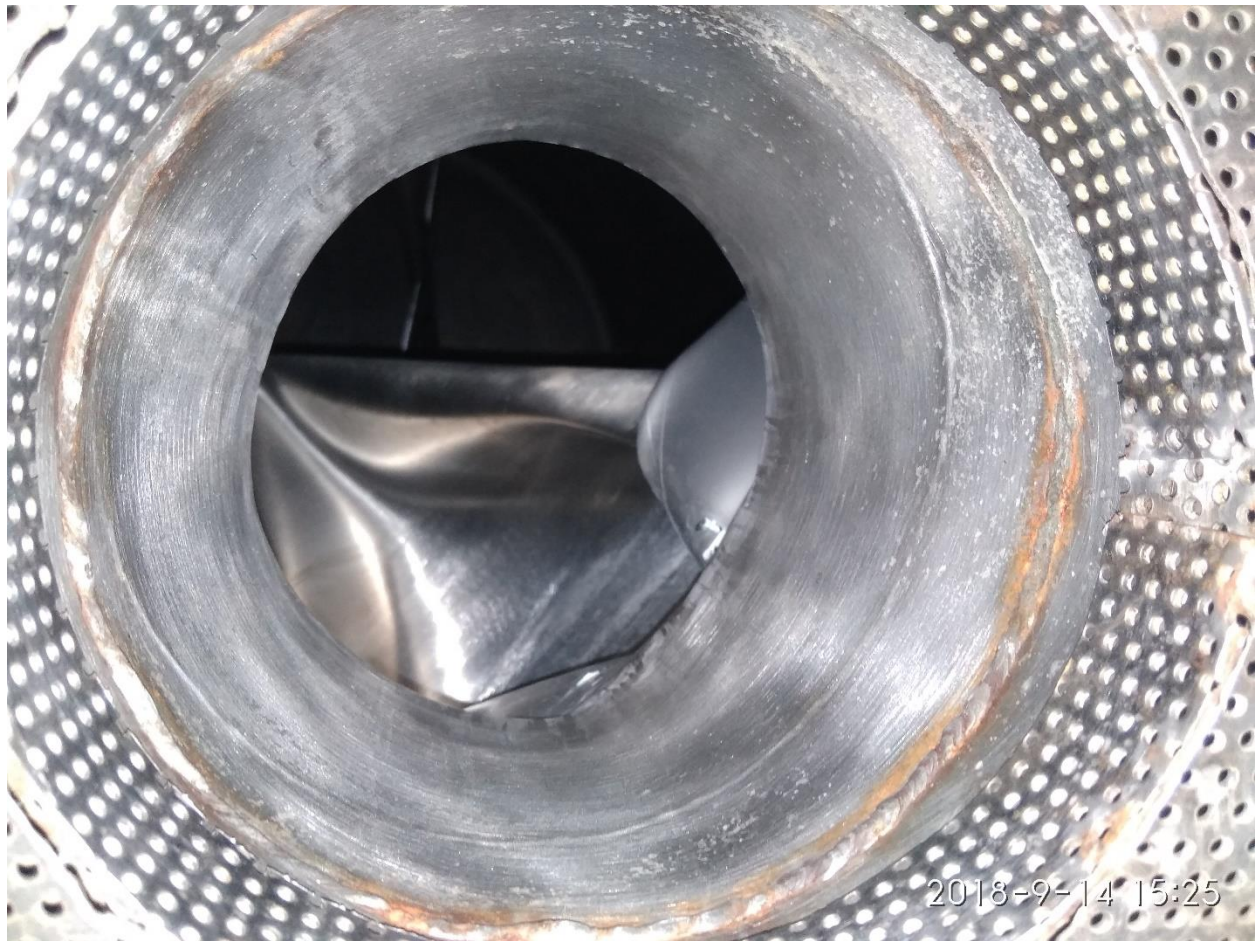

View from Top of the Air vent



2018-9-14 15:26