



# EW-HT 0152 - 0612

**NEW!**

70,2-279 kW

Water to water heat pumps, heating only, very high temperature water production



(The photo of the unit is indicative and may vary depending on the model)

- EXTENSIVE RANGE OF OPERATION
- MAXIMUM RELIABILITY
- ELECTRONIC EXPANSION VALVE SUPPLIED STANDARD
- RENEWABLE ENERGY FOR COMMERCIAL INSTALLATIONS
- COMPACTNESS

# CERTIFICATIONS

---

## Product certifications



Certificate Number MCS HP0005  
Heat Pumps

---

## System certifications



Climaveneta S.p.A.:

Quality System complying with the requirements of UNI EN ISO9001:2008 regulation

Environmental Management System complying with the requirements of UNI EN ISO14001:2004 regulation



Certificate Number MCS HP0005  
Heat Pumps

2.1	PRODUCT FEATURES	pg.2.1.1 / 2.1.1
3.1	PRODUCT PRESENTATION	pg.3.1.1 / 3.1.1
4.1	UNIT STANDARD COMPOSITION	pg.4.1.1 / 4.1.1
5.1	ACCESSORIES	pg.5.1.1 / 5.1.4
6.1	GENERAL TECHNICAL DATA	pg.6.1.1 / 6.1.1
7.1	OPERATING LIMITS	pg.7.1.1 / 7.1.1
8.1	HYDRAULIC DATA	pg.8.1.1 / 8.1.1
9.1	ELECTRICAL DATA	pg.9.1.1 / 9.1.1
10.1	FULL LOAD SOUND LEVEL	pg.10.1.1 / 10.1.1
11.1	DIMENSIONAL DRAWINGS	pg.11.1.1 / 11.1.2

**Liability disclaimer**

The present publication is drawn up by of information only and does not constitute an offer binding upon Climaveneta. Climaveneta has compiled the content of this publication to the best of its knowledge. The data contained herein are subject to change without notice. Climaveneta explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Climaveneta.

## LEGEND

### Functions



Heating 78°C



Heating



Hot water

### Refrigerant



R-134a

### Compressors



Scroll compressor

### Exchangers



Plates

## 2.1 PRODUCT FEATURES

### 2.2 GREEN CERTIFICATION RELEVANT

Climaveneta as a major player in the world HVAC market and a leading manufacturer of energy efficient, sustainable HVAC solutions, recognizes and supports the diffusion of green certification systems, as an effective way to deliver high performance buildings and improve the quality and the sustainability of the built environment.

Since the first certification system was introduced at the beginning of the 1990s, the demand for certified buildings has grown considerably, as well as the number of standards, rating and certification programs. Operating worldwide Climaveneta has extensive experience with many of them and is active member of Green Building Council Italy.

Climaveneta commitment to develop responsible and sustainable HVAC solutions, is reflected by a full range of premium efficiency products and systems, designed with special care to improve building energy performance ratings, according to major certification protocols, including LEED, BREEM, GREENSTAR, BCA, NABERS, DNGB, HQE and BEAM.

To find out more about how our products contribute to enhanced green certification rating and energy performance of a building, please refer to:  
<http://www.climaveneta.com/GLOBAL/Company/Green-Certifications/>  
QR code



### 3.1 PRODUCT PRESENTATION

EW-HT represents the best solution for systems where very high temperature water is needed, for domestic hot water production, space heating or industrial process purpose.

The special compressor adopted grants hot water production up to 78°C and allows high evaporation temperature (evaporator leaving water temperature up to 40°C). The extraordinary operating limits ensure the perfect integration of the unit in any application, such as 4-pipe systems for residential and commercial buildings, industrial process heat recovery, WLHP systems, IT-cooling plants.

### 3.3 EXTENSIVE RANGE OF OPERATION

Hot water production up to 78°C (evaporator water outlet up to 40°C).

### 3.4 MAXIMUM RELIABILITY

Unit with dual-circuit refrigerant section designed to ensure maximum efficiency at full load, ensuring continuity without interruption of operation in the event of temporary stop of one of the 2 circuits.

### 3.5 ELECTRONIC EXPANSION VALVE SUPPLIED STANDARD

The use of the electronic expansion valve generates considerable benefits, especially in cases of variable demand and different external conditions. It was introduced into these units as a result of accurate design choices concerning the cooling circuit and the optimisation of operation in various different working conditions

### 3.6 RENEWABLE ENERGY FOR COMMERCIAL INSTALLATIONS

Best solution in centralised residential systems such as apartment buildings, where the cost of renovation needs to be limited by keeping the same distribution system with radiators, while offering a source of renewable energy.

### 3.7 COMPACTNESS

Reduced dimensions, for easy installation even in sites with space constraints

## 4.1 UNIT STANDARD COMPOSITION

### 4.2 Water to water heat pumps, heating only, very high temperature water production

EW-HT represents the best solution for systems where very high temperature water is needed, for domestic hot water production, space heating or industrial process purpose.

The special compressor adopted grants hot water production up to 78°C and allows high evaporation temperature (evaporator leaving water temperature up to 40°C). The extraordinary operating limits ensure the perfect integration of the unit in any application, such as 4-pipe systems for residential and commercial buildings, industrial process heat recovery, WLHP systems, IT-cooling plants.

### 4.3 Installation note

The unit is supplied fully refrigerant charged and factory tested. On site installation only requires power and hydraulic connection.

### 4.4 Structure

Load-bearing base and structure made from suitably thick hot galvanized steel plate. All parts painted with polyester power coat.

### 4.5 Panelling

The external panelling, made from aluminium-like epoxy painted sheet metal, offers maximum ease of access to the internal components. Standard version without acoustic insulation on compressors case. Available, on request, acoustic insulation on compressors section by 30mm thick Fiberform. See acoustic performances section to be informed on the noise reduction level.

### 4.6 Compressors

Latest generation hermetic rotary scroll compressors operating on R134a, complete with sump heater, electronic thermal protector with centralized manual reset, and two-pole electric motor.

### 4.7 Plant side heat exchanger

Braze-welded AISI 316 plate heat exchanger, dual circuit type. The heat exchanger is externally insulated with a layer of closed-cell neoprene. When the unit is operating, the heat exchangers are protected against no flow conditions by a water differential pressure switch. Grooved pipe hydraulic connection. Grooved coupling kit available as accessory.

### 4.8 Source side heat exchanger

Braze-welded AISI 316 plate heat exchanger, dual circuit type. The heat exchanger is externally insulated with a layer of closed-cell neoprene. When the unit is operating, the heat exchangers are protected against no flow conditions by a water differential pressure switch. Grooved pipe hydraulic connection. Grooved coupling kit available as accessory.

### 4.9 Refrigerant circuit

Unit fitted with 2 independent refrigerant circuits.

Standard equipment of each circuit:

- electronic thermostatic valves
- liquid line shut-off valve
- drier filter with replaceable cartridge
- high pressure safety valve
- high and low pressure transducers

### 4.10 Electrical and control panel

Electrical and control panel built to EN60204-1 and EC204-1 standards, complete with:

- control circuit transformer
- numbered cables
- general door lock isolator
- automatic circuit breakers and contactors for compressors
- terminals for cumulative alarm block
- relay for remote pump(s) activation
- remote ON/OFF terminals
- spring-type control circuit terminal board
- electronic controller
- multi-language user keypad with LCD display
- protection level IP21
- Power supply: 400V~ ±10% 3ph 50Hz PE

### 4.11 Certification and applicable directives

The unit complies with the following directives and relative amendments:

- Machine directive 2006/42/EC
- PED directive 97/23/EC
- Low Voltage directive 2006/95/EC
- ElectroMagnetic compatibility directive 2004/108/EC
- ISO 9001 Company's Quality Management System certification
- ISO 14001 Company's Environmental Management System certification

### 4.12 Tests

Tests performed throughout the production process, as indicated in ISO9001.

Performance or noise tests can be performed by highly qualified staff in the presence of customers.

Performance tests comprise the measurement of:

- electrical data
- water flow rates
- working temperatures
- power input
- power output
- pressure drops on the water-side exchanger both at full load (at the conditions of selection and at the most critical conditions for the condenser) and at part load conditions.

During performance testing it is also possible to simulate the main alarm states.

Noise tests are performed to check noise emissions according to ISO9614.

### 4.13 W3000TE Compact

The W3000TE controller is the new device designed especially for heat pump applications with incorporated logic for high and very high temperature hot water production. The keypad features function controls and a complete LCD display for viewing data and activating the unit, via a multilevel menu, with settable display language. The controller provides temperature control for the heating and cooling systems in the air-conditioned rooms, as well as for domestic hot water. These different temperatures are managed automatically based on the different conditions in which the system operates, with the possibility to assign specific levels of priority to domestic hot water production, depending on the needs of the application. Diagnostics include complete alarm management, with "blackbox" functions (via PC) and alarm log (display or PC) for best analysis of unit behaviour. For systems made up of multiple units, differentiated device management means just a certain portion of the capacity installed can be dedicated to domestic water production, in this way ensuring more efficient energy distribution and, at the same time, guaranteeing simultaneous water delivery to the different distribution systems. The built-in clock can be used to create an operating profile containing up to 4 typical days and 10 time bands, essential for efficient programming of energy production, and fundamental for managing the Legionella prevention cycles.

Supervision is available with different options, using proprietary devices or by integration into third party systems using ModBus, BACnet, BACnet-over-IP and Echelon LonWorks protocols.

A dedicated wall-mounted keypad can be used for remote control of all the functions.



## 5.1 ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
<b>1960 PRESSURE RELIEF VALVES</b>			
1961 DUAL RELIEF VALVES WITH SWITCH	Dual relief valve with switch	Allows to unselect a relief valve in order to service the unit avoiding medium or long inoperative periods	ALL
<b>380 NUMBERED WIRING</b>			
381 NUMBERED WIRING ON EL. BOARD			ALL
<b>2410 PHASE SEQUENCE RELAY</b>			
2411 WITH EXTERNAL PHASE SEQUENCE RELAY	Relay for checking mains phase-sequence	Protects loads against faults due to incorrect connection of mains	ALL
<b>3410 AUTOMATIC CIRCUIT BREAKERS</b>			
3412 AUTOM. CIRCUIT BREAK. ON LOADS	Over-current switch on the major electrical loads.	In case of overcurrent allows resetting of the switch without the replacement of relative fuses.	ALL
<b>3600 ON/OFF COMPRESSOR SIGNAL</b>			
3601 COMPRESSOR OPERATION SIGNAL	Auxiliary contacts providing a voltage-free signal.	Allows remote signalling of compressor's activation or remote control of any auxiliary loads.	ALL
<b>4180 REMOTE CONNECTION ARRANGEMENT</b>			
4181 SERIAL CARD MODBUS	Interface module for ModBUS protocols.	Allows integration with BMS operating with ModBUS protocol.	ALL
4182 SERIAL CARD FOR LONWORKS	Interface module for Echelon systems.	Allows integration with BMS operating with LonWorks protocols	ALL
4184 SERIAL CARD BACNET MS/TP RS485	Interface module for BACnet protocols.	Allows integration with BMS operating with BACnet protocol.	ALL
4185 SERIAL CARD FOR BACNET OVER IP	Interface module for BACnet OVER-IP protocols.	Allows to interconnect BACnet devices over Internet Protocol within wide-area networks.	ALL
<b>6160 AUXILIARY INPUT</b>			
6161 AUXILIARY SIGNAL 4-20mA	4..20mA analogue input.	Allows to change the operating set-point according to the value of current applied to the analogue input.	ALL
6162 REMOTE SIGNAL DOUBLE SP	Allows to activate the Energy Saving set-point.	Allows to activate the Energy Saving set-point.	ALL
<b>6170 DEMAND LIMIT</b>			
6171 INPUT REMOTE DEMAND LIMIT	Digital input (voltage free)	It permits to limit the unit's power absorption for safety reasons or in temporary situation.	ALL
<b>6190 TYPE OF VISUAL DISPLAY</b>			
6195 W3000 TOUCH VISUAL DISPLAY	Colour WVGA 7" display keyboard with adjustable LED backlight (WARNING: with outdoor temperature below 0°C the display response time may visibly increase)	The touch-screen's technology is characterized by an easy-to-access data, and it allows an effective graphical representation of the main figures protecting the access through 3 privilege levels.	ALL

## ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
<b>1510 SOFT-STARTER</b>			
1511 SOFT-STARTER FOR THREE-PHASE POWER SUPPLY	Electronic device adopted to manage the inrush current.	Break down of the inrush current compared to the direct motor start, lower motor windings' mechanical wear, avoidance of mains voltage fluctuations during starting, favourable sizing for the electrical system.	ALL
<b>5920 MANAGEMENT &amp; CONTROL SYSTEMS</b>			
5922 ClimaPRO ModBUS RS485 - MID	This option includes all following devices on-board the unit panel: - MID certified network analyzer operating on ModBUS over EIA RS-485 - Current transformers - W3000TE controller - Software release LA09 or later version.	This accessory allows to acquire the electrical data and the power absorbed by the unit and communicate with ClimaPRO via high level communication interface based on ModBUS over EIA RS-485. More specifically, the data collected are: power supply, current, frequency, power factor ( $\cos\phi$ ), electrical power consumption, energy consumption. This specific energy meter model is MID certified and can therefore be used for billing applications. This option also ensures the compatibility between the units and ClimaPRO, thus allowing ClimaPRO to acquire all the main unit's operating variables and status by means of a high level communication interface to the controller installed onboard the unit panel.	ALL
5923 ClimaPRO BacNET over IP	This option includes all following devices on-board the unit panel: - network analyzer operating on BACnet over IP - Current transformers - W3000TE controller - Software release LA09 or later version.	This accessory allows to acquire the electrical data and the power absorbed by the unit and communicate with ClimaPRO via high level communication interface based on BACnet over IP. More specifically, the data collected are: power supply, current, frequency, power factor ( $\cos\phi$ ), electrical power consumption, energy consumption. This network analyzer is not MID certified and cannot therefore be used for billing applications. This option also ensures the compatibility between the units and ClimaPRO, thus allowing ClimaPRO to acquire all the main unit's operating variables and status by means of a high level communication interface to the controller installed onboard the unit panel.	ALL
<b>1400 HP AND LP GAUGES</b>			
1401 HP AND LP GAUGES	High and low pressure gauges	Allows immediate reading of the pressure values on both low and high pressure circuits	ALL
<b>1900 COMPRESSOR SUCTION VALVE</b>			
1901 COMPRESSOR SUCTION VALVE	Shut-off valve on compressor's suction circuit.	Simplifies maintenance activities	ALL

## ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
<b>1910 COMPRESSOR DISCHARGE VALVE</b>			
1911 COMPR. DISCHARGE LINE VALVE	Shut-off solenoid valve on compressor discharge circuit	Simplifies maintenance activities	ALL
<b>1940 EXPANSION VALVE</b>			
1941 ELECTRONIC EXPANSION VALVE	Electronic expansion valve	Electronic lamination device with step motor. It is designed for the continuous and precise control of refrigerant flow entering in the evaporator. This solution permits extremely short times for reaction to variation in load, optimising power consumption.	ALL
<b>2620 ACOUSTICAL ENCLOSURE</b>			
2621 EXTRA INSUL.ON COMPR. SECTION	Increased soundproofing enclosure for compressor section	Noise emission reduction of 4 dB(A)	ALL

## NOTES ACCESSORIES

The following accessories are provided as standard:

- 381 Numbered wiring on el. board
- 3412 Autom. circuit break. on loads
- 1901 Compressor suction valve
- 1941 Electronic expansion valve

## ACCESSORIES

### Chiller Plant Control with Active Optimization System

#### ClimaPRO System Manager

ClimaPRO System Manager represents the state-of-the-art platform for chiller plant management and control.

ClimaPRO ensures to actively optimize the entire chiller plant by managing and adjusting each component directly involved in the production and the distribution of the heating and the cooling energies, therefore involving chillers and heat pumps, pumping groups as well as the source-side devices like, for example, the cooling towers.

In particular, ClimaPRO measures in real-time all the operating variables from the field, for each individual device and each of the main system branches, by using serial communication lines as well as dedicated analogue signals.

The acquired data are then compared with the design data of each single unit at any different working conditions, thus allowing to implement control strategies based on dynamic algorithms which take into account the real operating conditions.

On the basis of these values, an advanced diagnostic module also allows to assess the level of efficiency for each individual unit, translating data into easy-to-read information in order to simplify and optimize the maintenance activities.

The "Chart Builder" software module allows to display the trends of the main operating variables. The "Reporting" module allows to send reports to selected users, including data and system's status of the main devices as well as to perform calculation of the energy indexes for each single unit and for the entire chiller plant.

The accessibility to ClimaPRO System Manager is ensured by an integrated web server that makes it visible from any computer equipped with a web browser, either locally or remotely.



## 6.1 GENERAL TECHNICAL DATA


## EW-HT

[ SI System ]

EW-HT		0152	0182	0202	0262	0302	0412	0512	0612	
Power supply		V/ph/Hz 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50								
<b>PERFORMANCE</b>										
<b>HEATING ONLY (GROSS VALUE)</b>										
Total heating capacity	(1)	kW	70,2	79,3	92,5	113	139	181	225	279
Total power input	(1)	kW	17,0	18,9	22,0	27,9	34,2	43,7	55,1	67,6
COP	(1)	kW/kW	4,13	4,20	4,20	4,05	4,08	4,14	4,08	4,13
<b>EXCHANGERS</b>										
<b>HEAT EXCHANGER USER SIDE IN HEATING</b>										
Water flow	(1)	l/s	2,15	2,42	2,83	3,45	4,26	5,52	6,87	8,54
Pressure drop	(1)	kPa	23,9	25,0	24,2	24,2	19,7	19,8	19,8	20,1
<b>HEAT EXCHANGER SOURCE SIDE IN HEATING</b>										
Water flow	(1)	l/s	2,62	2,97	3,47	4,19	5,18	6,74	8,35	10,4
Pressure drop	(1)	kPa	45,4	46,7	51,8	53,8	49,7	50,1	37,6	37,7
<b>COMPRESSORS</b>										
Compressors nr.		N°	2	2	2	2	2	2	2	2
Number of capacity		N°	2	2	2	2	2	2	2	2
No. Circuits		N°	2	2	2	2	2	2	2	2
Regulation			STEPS							
Min. capacity step		%	50	50	50	50	50	50	50	50
Refrigerant			R134a							
Refrigerant charge		kg	6	7	8	9	10	11	12	13
Oil charge		kg	5	7	7	7	7	9	14	13
<b>NOISE LEVEL</b>										
Noise Pressure	(2)	dB(A)	58	58	58	60	60	62	62	64
Noise Power	(3)	dB(A)	74	74	74	76	76	78	78	80
<b>SIZE AND WEIGHT</b>										
A	(4)	mm	1223	1223	1223	1223	1223	1223	1223	1223
B	(4)	mm	877	877	877	877	877	877	877	877
H	(4)	mm	1496	1496	1496	1496	1496	1496	1496	1496
Operating weight	(4)	kg	365	380	390	415	430	610	675	740

**Notes:**

- 1 Plant (side) heating exchanger water (in/out) 70,0°C/78,0°C; Source (side) heat exchanger water (in/out) 45,0°C/40,0°C.
  - 2 Average sound pressure level at 1m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.
  - 3 Sound power on the basis of measurements made in compliance with ISO 9614.
  - 4 Unit in standard configuration/execution, without optional accessories.
- Unavailable

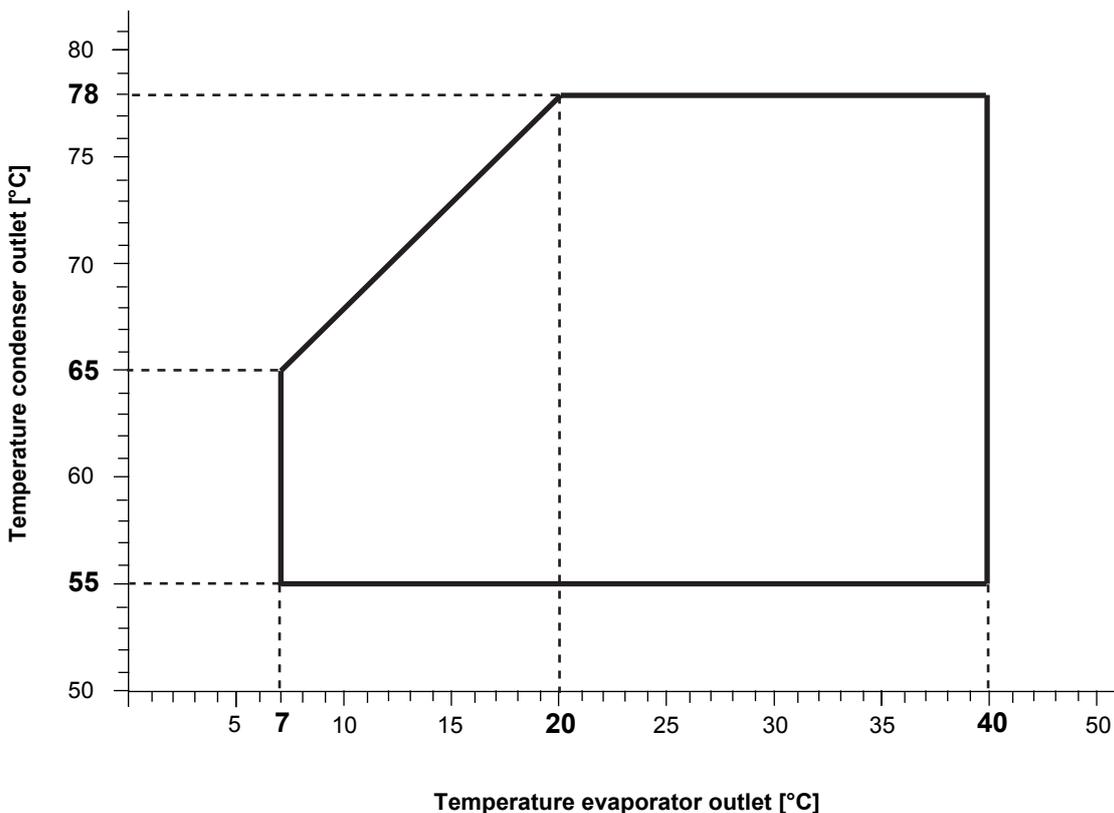

7.2 ETHYLENE GLYCOL MIXTURE

Ethylene glycol and water mixture, used as a heat-conveying fluid, cause a variation in unit performance. For correct data, use the factors indicated in the following table.

	Freezing point (°C)							
	0	-5	-10	-15	-20	-25	-30	-35
	Ethylene glycol percentage by weight							
	0%	12%	20%	30%	35%	40%	45%	50%
cPf	1	0,985	0,98	0,974	0,97	0,965	0,964	0,96
cQ	1	1,02	1,04	1,075	1,11	1,14	1,17	1,2
cdp	1	1,07	1,11	1,18	1,22	1,24	1,27	1,3

cPf: cooling power correction factor  
 cQ: flow correction factor  
 cdp: pressure drop correction factor

For data concerning other kind of anti-freeze solutions (e.g. propylene glycol) please contact our Sale Department.

7.3 FOULING FACTORS

Performances are based on clean condition of tubes (fouling factor = 1). For different fouling values, performance should be adjusted using the correction factors shown in the following table.

SERIES	FOULING FACTORS	EVAPORATOR			CONDENSER/RECOVERY		
	ff (m <sup>2</sup> °CW)	F1	FK1	KE [°C]	F2	FK2	KC [°C]
VARIOUS	0	1,000	1,000	0,0	1,000	1,000	0,0
VARIOUS	1,80 x 10 <sup>-5</sup>	1,000	1,000	0,0	1,000	1,000	0,0
VARIOUS	4,40 x 10 <sup>-5</sup>	1,000	1,000	0,0	0,990	1,030	1,0
VARIOUS	8,80 x 10 <sup>-5</sup>	0,960	0,990	0,7	0,980	1,040	1,5
VARIOUS	13,20 x 10 <sup>-5</sup>	0,944	0,985	1,0	0,964	1,050	2,3
VARIOUS	17,20 x 10 <sup>-5</sup>	0,930	0,980	1,5	0,950	1,060	3,0

ff: fouling factors  
 f1 - f2: potential correction factors  
 fk1 - fk2: compressor power input correction factors  
 KE: minimum condenser outlet temperature increase  
 KC: maximum condenser outlet temperature decrease

## 8.1 HYDRAULIC DATA

[ SI System ]

### Water flow and pressure drop

Water flow in the plant (side) exchanger is given by:

$$Q = P \times 0,86 / Dt$$

Q: water flow (l/s)

Dt: difference between inlet and outlet water temp. (°C)

P: heat exchanger capacity (kW)

Pressure drop is given by:

$$Dp = K \times Q^2 / 1000$$

Q: water flow (l/s)

Dp: pressure drop (kPa)

K: unit size ratio

SIZE	Power supply V/ph/Hz	HEAT EXCHANGER USER SIDE					HEAT EXCHANGER SOURCE SIDE			
		K	Q min l/s	Q max l/s	C.A.S. l	C.a. min l	K	Q min l/s	Q max l/s	C.A.S. l
EW-HT /0152	400/3/50	401	1,00	4,19	4,00	250	512	0,94	4,31	3,60
EW-HT /0182	400/3/50	328	1,14	4,72	4,50	290	409	1,06	4,89	4,00
EW-HT /0202	400/3/50	234	1,31	5,53	5,50	330	333	1,22	5,69	4,50
EW-HT /0262	400/3/50	157	1,61	6,75	6,90	410	237	1,50	6,89	5,50
EW-HT /0302	400/3/50	83,7	2,06	8,36	7,70	530	143	2,03	8,58	7,30
EW-HT /0412	400/3/50	50,0	2,75	10,9	10,1	680	85,1	2,69	11,2	10,2
EW-HT /0512	400/3/50	32,3	3,42	13,5	13,0	850	41,6	3,31	13,9	11,4
EW-HT /0612	400/3/50	21,3	4,17	16,7	16,8	1050	26,8	4,08	17,3	14,7

Q min: minimum water flow admitted to the heat exchanger

Q max: maximum water flow admitted to the heat exchanger

C.a. min: minimum water content admitted in the plant

C.A.S.: Exchanger water content

## 9.1 ELECTRICAL DATA

## EW-HT

[ SI System ]

SIZE	Power supply V/ph/Hz	Maximum values						
		n	Compressor			Total (1)		
			F.L.I. [kW]	F.L.A. [A]	L.R.A. [A]	F.L.I. [kW]	F.L.A. [A]	S.A. [A]
0152	400/3/50	2	2 x 9.3	2 x 17.3	2 x 95	18,6	35	112
0182	400/3/50	2	2 x 10.4	2 x 19.0	2 x 111	20,8	38	130
0202	400/3/50	2	2 x 12.1	2 x 21.3	2 x 118	24,2	43	139
0262	400/3/50	2	2 x 15.3	2 x 24.4	2 x 140	30,6	49	164
0302	400/3/50	2	2 x 18.5	2 x 31.9	2 x 174	37,0	64	206
0412	400/3/50	2	2 x 24.8	2 x 39.6	2 x 225	49,6	79	265
0512	400/3/50	2	2 x 31.2	2 x 49.5	2 x 272	62,4	99	322
0612	400/3/50	2	2 x 38.2	2 x 62.7	2 x 310	76,4	125	373

**F.L.I.:** Full load power

**F.L.A.:** Full load current

**L.R.A.:** Locked rotor amperes for single compressor

**S.A.:** Inrush current

(1) Safety values to be considered when cabling the unit for power supply and line-protections

Electrical data valid for standard units without any additional option

Plant (side) heating exchanger water (in/out) 70,0°C/78,0°C; Source (side) heat exchanger water (in/out) 45,0°C/40,0°C.

Voltage tolerance: 10%

Maximum voltage unbalance: 3%

Given the typical operating conditions of units designed for indoor installation, which can be associated (according to reference document IEC 60721) to the following classes:

- climatic conditions class AA4: air temperature range from 5 up to 42°C (\*)
- special climatic conditions negligible
- presence of water class AD2: possibility of water dripping inside the technical room
- biological conditions class 4B1 and 4C2: negligible presence of corrosive and polluting substances
- mechanically active substances class 4S2: locations in areas with sand or dust sources

The required protection level for safe operation, according to reference document IEC 60529, is IP21 BW (protection against access of external devices with diameter larger than 12 mm and water falling vertically).

The unit can be considered IP21 CW protected, thus fulfilling the above operating conditions.

(\*) for the unit's operating limits, see "selection limits" section

10.1 FULL LOAD SOUND LEVEL

EW-HT

SOUND POWER									
SIZE	Octave band [Hz]								Total sound level dB(A)
	63	125	250	500	1000	2000	4000	8000	
	Sound power level dB								
0152	75	73	70	71	71	64	60	54	74
0182	75	73	70	71	71	64	60	54	74
0202	75	73	70	71	71	64	60	54	74
0262	76	74	75	74	70	68	64	53	76
0302	76	74	75	74	70	68	64	53	76
0412	78	76	77	76	72	70	66	55	78
0512	78	76	77	76	72	70	66	55	78
0612	80	78	79	78	74	72	68	57	80

Working conditions

Plant (side) heating exchanger water (in/out) 70,0°C/78,0°C; Source (side) heat exchanger water (in/out) 45,0°C/40,0°C.

Sound power in compliance with ISO 3744 for non-certified units.



Such certification refers specifically to the sound Power Level in dB(A). This is therefore the only acoustic data to be considered as binding.

SOUND PRESSURE LEVEL									
SIZE	Octave band [Hz]								Total sound level dB(A)
	63	125	250	500	1000	2000	4000	8000	
	Sound pressure level dB								
0152	59	57	54	55	55	48	44	38	58
0182	59	57	54	55	55	48	44	38	58
0202	59	57	54	55	55	48	44	38	58
0262	60	58	59	58	54	52	48	37	60
0302	60	58	59	58	54	52	48	37	60
0412	62	60	61	60	56	54	50	39	62
0512	62	60	61	60	56	54	50	39	62
0612	64	62	63	62	58	56	52	41	64



Working conditions

Plant (side) heating exchanger water (in/out) 70,0°C/78,0°C; Source (side) heat exchanger water (in/out) 45,0°C/40,0°C.

Average sound pressure level at 1m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.

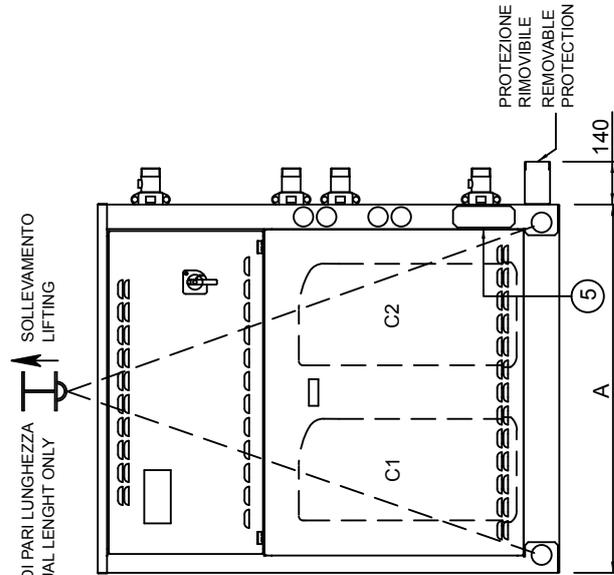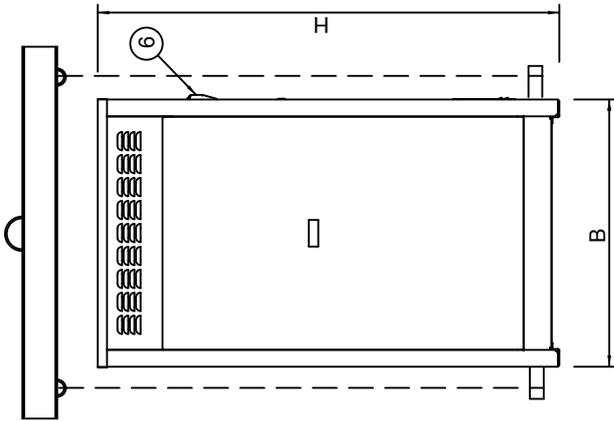

ATTN: UTILIZZARE N° 4 FUNI DI SOLLEVAMENTO DI PARI LUNGHEZZA  
ATTN: USE N° 4 LIFTING ROPES WITH EQUAL LENGTH ONLY

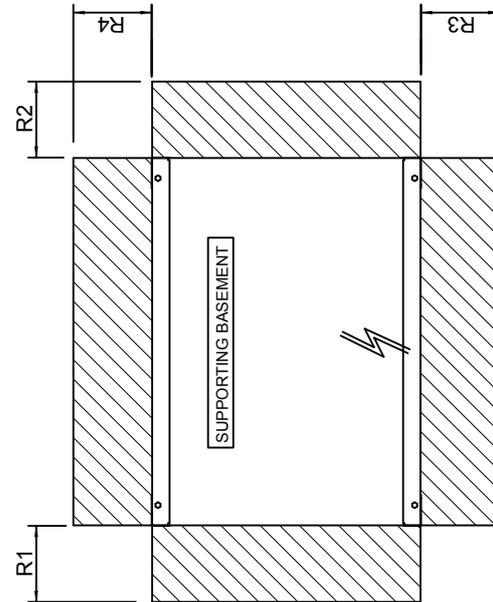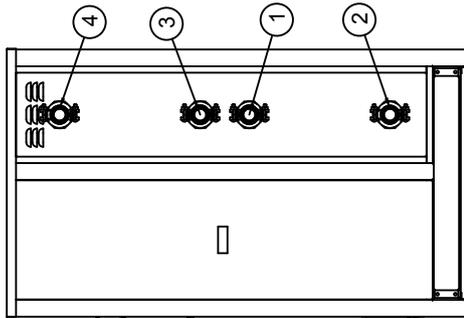

- ① ENTRATA ACQUA EVAPORATORE  
EVAPORATOR WATER INLET
- ② USCITA ACQUA EVAPORATORE  
EVAPORATOR WATER OUTLET
- ③ ENTRATA ACQUA CONDENSATORE  
CONDENSER WATER INLET
- ④ USCITA ACQUA CONDENSATORE  
CONDENSER WATER OUTLET
- ⑤ INGRESSO LINEA ELETTRICA  
POWER INLET
- ⑥ MANIGLIA SEZIONATORE GENERALE  
(RIMOVIBILE)  
(REMOVABLE)

GRANDEZZA SIZE	Ø A
0152	EN10226 R2
0182	EN10226 R2
0202	EN10226 R2
0262	EN10226 R2
0302	EN10226 R2
0412	EN10226 R2½
0512	EN10226 R2½
0612	EN10226 R2½


"REMARKS:  
For installation purposes, please refer to the documentation sent after the purchase-contract. This technical data should be considered as indicative. CLIMAVENETA may modify them at any moment."

**DIMENSIONAL DRAWINGS**  
[ SI System ]

**EW-HT 0152 - 0612**

SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT EXCHANGER SOURCE SIDE	
	A	B	H	WEIGH	R1	R2	R3	R4	IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø
EW-HT /0152	1223	877	1496	365	600	600	800	600	F	2"	F	2"
EW-HT /0182	1223	877	1496	380	600	600	800	600	F	2"	F	2"
EW-HT /0202	1223	877	1496	390	600	600	800	600	F	2"	F	2"
EW-HT /0262	1223	877	1496	415	600	600	800	600	F	2"	F	2"
EW-HT /0302	1223	877	1496	430	600	600	800	600	F	2"	F	2"
EW-HT /0412	1223	877	1496	610	600	600	800	600	F	2"1/2	F	2"1/2
EW-HT /0512	1223	877	1496	675	600	600	800	600	F	2"1/2	F	2"1/2
EW-HT /0612	1223	877	1496	740	600	600	800	600	F	2"1/2	F	2"1/2

**LEGEND OF PIPE CONNECTIONS**



**TYPE = F**  
Grooved coupling with male threaded counter-pipe user side

**UNI ISO 228/1**

Pipe threads where pressure-tight joints are not made on the threads - Designation, dimensions and tolerances

**Used terminology:**

G: Pipe threads where pressure-tight joints are not made on the threads

A: Close tolerance class for external pipe threads where pressure-tight joints are not made on the threads

B: Wider tolerance class for external pipe threads where pressure-tight joints are not made on the threads

Internal threads: G letter followed by thread mark (only tolerance class)

External threads: G letter followed by thread mark and by A letter for A class external threads or by B letter for B class external threads.

**UNI EN 10226-1**

Pipe threads where pressure-tight joints are made on the threads - Designation, dimensions and tolerances

**Used terminology:**

Rp: Internal cylindrical threads where pressure-tight joints are made on the threads

Rc: Internal conical threads where pressure-tight joints are made on the threads

R: External conical threads where pressure-tight joints are made on the threads

Internal cylindrical threads: R letter followed by p letter

Internal conical threads: R letter followed by c letter

External conical threads: R letter

Designation	Description
UNI EN 10226-1 - Rp 1 1/2	Internal cylindrical threads where pressure-tight joints are made on the threads, defined by standard UNI ISO 7/1 Conventional ø 1 1/2"
UNI EN 10226-1 - Rp 2 1/2	Internal cylindrical threads where pressure-tight joints are made on the threads, defined by standard UNI ISO 7/1 Conventional ø 2 1/2"
UNI EN 10226-1 - Rp 3	Internal cylindrical threads where pressure-tight joints are made on the threads, defined by standard UNI ISO 7/1 Conventional ø 3"
UNI EN 10226-1 - R 3	External conical threads where pressure-tight joints are made on the threads, defined by standard UNI ISO 7/1 Conventional ø 3"
UNI ISO 228/1 - G 4 B	Internal cylindrical threads where pressure-tight joints are not made on the threads, defined by standard UNI ISO 228/1 Tolerance class B for external thread Conventional ø 4"
DN 80 PN 16	Flange Nominal Diameter: 80 mm Nominal Pressure: 16 bar

**Notes:**

Conventional diameter value [in inches] identifies short thread designation, based upon the relative standard.

All relative values are defined by standards.

As example, here below some values:

	UNI EN 10226-1	UNI ISO 228/1
Conventional ø	1"	1"
Pitch	2.309 mm	2.309 mm
External ø	33.249 mm	33.249 mm
Core ø	30.291 mm	30.291 mm
Thread height	1.479 mm	1.479 mm

**Climaveneta S.p.A.**

Via Sarson 57/c  
36061 Bassano del Grappa (VI) - Italy  
Tel +39 0424 509 500  
Fax +39 0424 509 509  
info@climaveneta.com  
www.climaveneta.com

**Climaveneta France**

3, Village d'Entreprises  
ZA de la Couronne des Prés  
Avenue de la Mauldre  
78680 Epône - France  
Tel +33 (0)1 30 95 19 19  
Fax +33 (0)1 30 95 18 18  
info@climaveneta.fr  
www.climaveneta.fr

**Climaveneta Deutschland GmbH**

Lyrenstraße 13  
44866 Bochum - Germany  
Tel +49 2327-95428-0  
Fax +49 2327-95428-99  
info@climaveneta.de  
www.climaveneta.de

**Climaveneta España - Top Clima**

Londres 67, 1º 4º  
08036 Barcelona - Spain  
Tel +34 934 195 600  
Fax +34 934 195 602  
topclima@topclima.com  
www.climaveneta.com

**Climaveneta Chat Union Refrig. Equipment Co., Ltd**

No.88 Baiyun Rd, Pudong Xinghuo  
New Dev. Zone 201419 Shanghai - China  
Tel +86 21 5750 5566  
Fax +86 21 5750 5797  
info@climaveneta.com.cn  
www.climaveneta.com.cn

**Climaveneta Polska Sp. z o.o.**

Ul. Sienkiewicza 13A,  
05-120 Legionowo - Poland  
Tel +48 22 766 34 55-57  
Fax +48 22 784 39 09  
info@climaveneta.pl  
www.climaveneta.pl

**Climaveneta - Climate Technologies (P) Ltd**

#3487, 14th Main, HAL 2nd stage,  
Indiranagar, Bangalore 560008 - India  
Tel:+91-80-42466900 - 949  
Fax: +91-80-25203540  
sales@climaveneta.in

**Climaveneta - Powermaster ltd**

Unit 6, St Clare Business Park  
Holly Road - Hampton Hill  
Middlesex - TW12 1PZ - U.K.  
Tel: +44 (0) 20 8783 1008  
Fax: +44 (0) 20 8783 1009  
response@climaveneta.co.uk  
www.climaveneta.co.uk

**Climaveneta Middle East JLT**

Jumeirah Bay X3 Tower, Unit No. 3103  
Jumeirah Lakes Towers  
P.O. Box 116226 Dubai - U.A.E  
Tel: 00971 4 2765490  
info@climaveneta.ae  
ae.climaveneta.com

**ООО Climaveneta**

ул. Нижняя Красносельская,  
д.40/12, к.20а  
105066 Moscow - Russia  
Tel: +7 495 987 37 53  
info@climaveneta.ru  
ru.climaveneta.com

