


NOTE:


200mm WIDE PERIPHERAL BASE AREA SHOULD BE WITHIN $\pm 5\text{mm}$ OF SPECIFIED LEVEL AND SHOULD NOT VARY MORE THAN $\pm 3\text{mm}$ IN ANY 3.0m LENGTH.

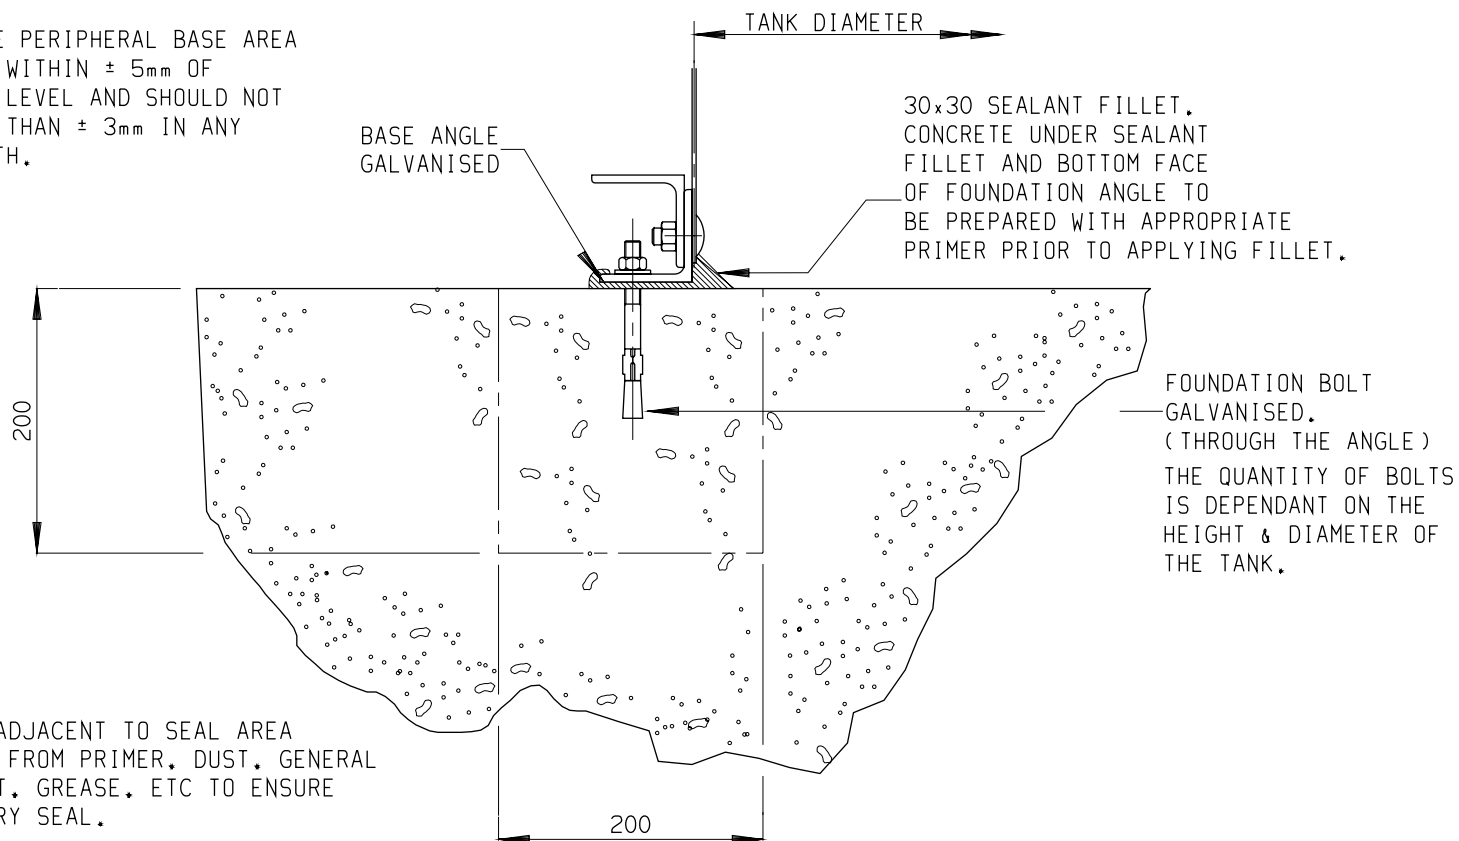


NOTE:

TANK WALL ADJACENT TO SEAL AREA TO BE FREE FROM PRIMER, DUST, GENERAL CONTAMINANT, GREASE, ETC TO ENSURE SATISFACTORY SEAL.


CIRCUMFERENTIAL REINFORCING BAR EXCLUSION ZONE

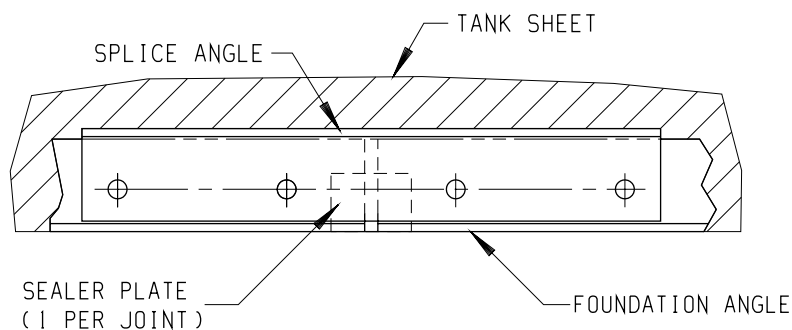

BECAUSE PERMASTORE LIMITED IS CONSTANTLY IMPROVING PRODUCTS, IT RESERVES THE RIGHT TO CHANGE DESIGN AND/OR THE SPECIFICATION WITHOUT NOTICE. PLEASE CHECK DETAILS FOR SPECIFIC USE.

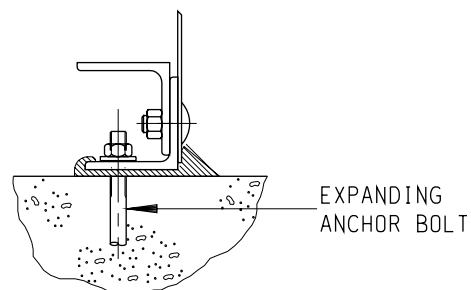

ISO 9001 UNCONTROLLED COPY

| REV | DESCRIPTION |
|---|--|
| 6 | SPLICE ANGLE ADDED DOCUMENT REVIEWED 02/02/09 G.S. |
| THIS DRAWING IS INTENDED TO BE INDICATIVE ONLY TO SHOW THE ARRANGEMENT OF THE TANK BASE CONNECTION. FLAT BASE TANKS SHOULD BE INSTALLED USING CONSTRUCTION JACKS. THE APPLICATION OF THE BASE SEAL IS CRITICAL AND NEEDS TO BE COMPLETED IN A SINGLE OPERATION. UNLESS OTHERWISE STATED IN OUR QUOTATION THE CUSTOMER IS RESPONSIBLE FOR THE DETAILED FOUNDATION DESIGN WHICH MUST ACCOMMODATE LOCAL GROUND CONDITIONS. | |
| ANY RANGES OF APPLICABILITY SPECIFIED IN THIS DRAWING ARE INDICATIVE ONLY & MAY EXTEND OR REDUCE DEPENDING ON SERVICE/ ENVIRONMENT. | |
|  <p>EYE, SUFFOLK IP23 7HS, ENGLAND. TELEPHONE (01379 870723) TELEFAX (01379 870530)</p> <p>E-mail sales@permastore.com www.permastore.com</p> | |
| DESCRIPTION | |
| FLAT BASE FOUNDATION DETAIL (THRO' THE ANGLE BOLTING) FOR TANKS UP TO & INCLUDING 16.2m DIA & 9.8m HIGH ONLY. | |
| PART No | MK/006F |