



## Annex-I Condensing Extraction Turbine Parameters Boiler Trip Event

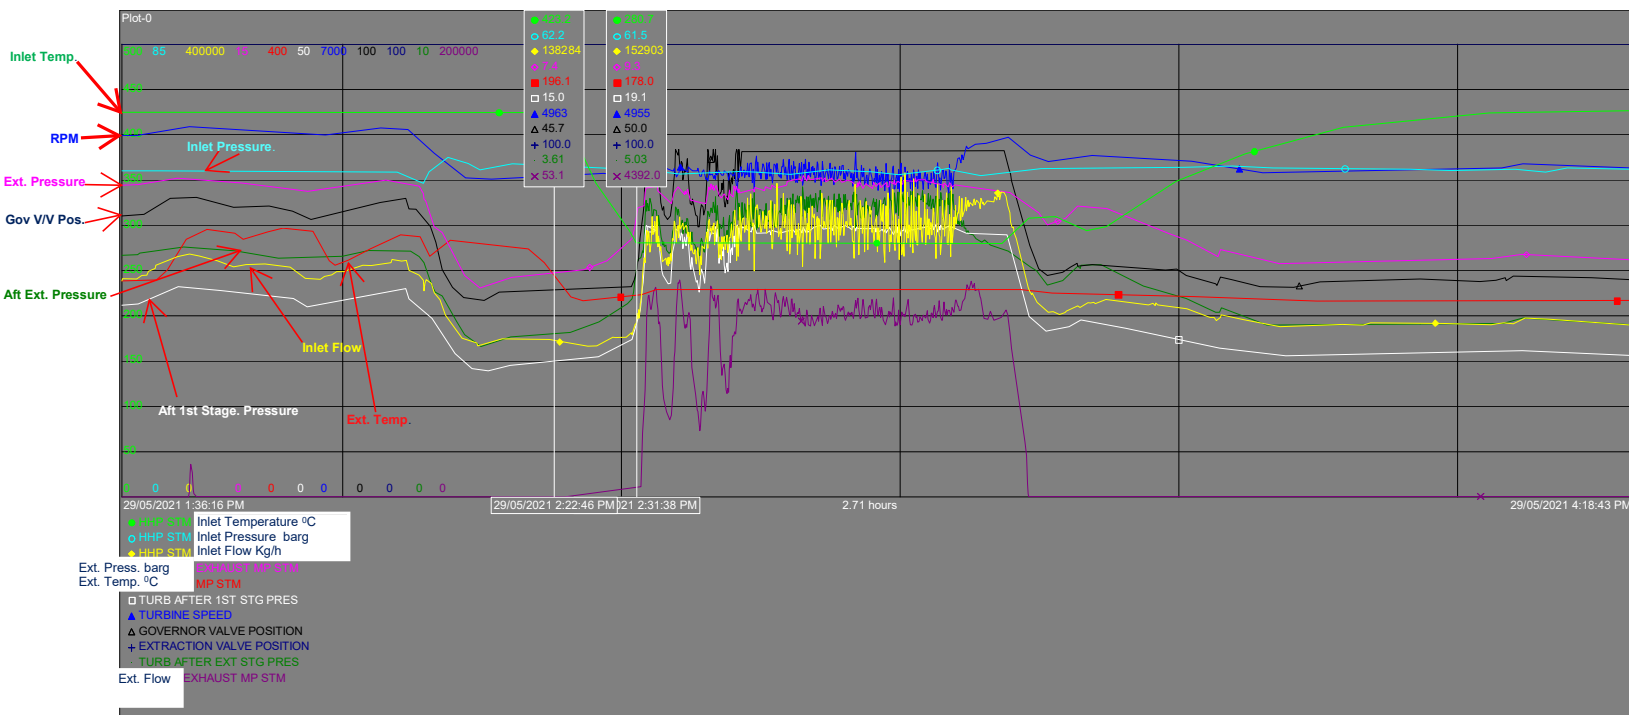

Annex-II Back Pressure Once Through Turbine Parameters

Startup

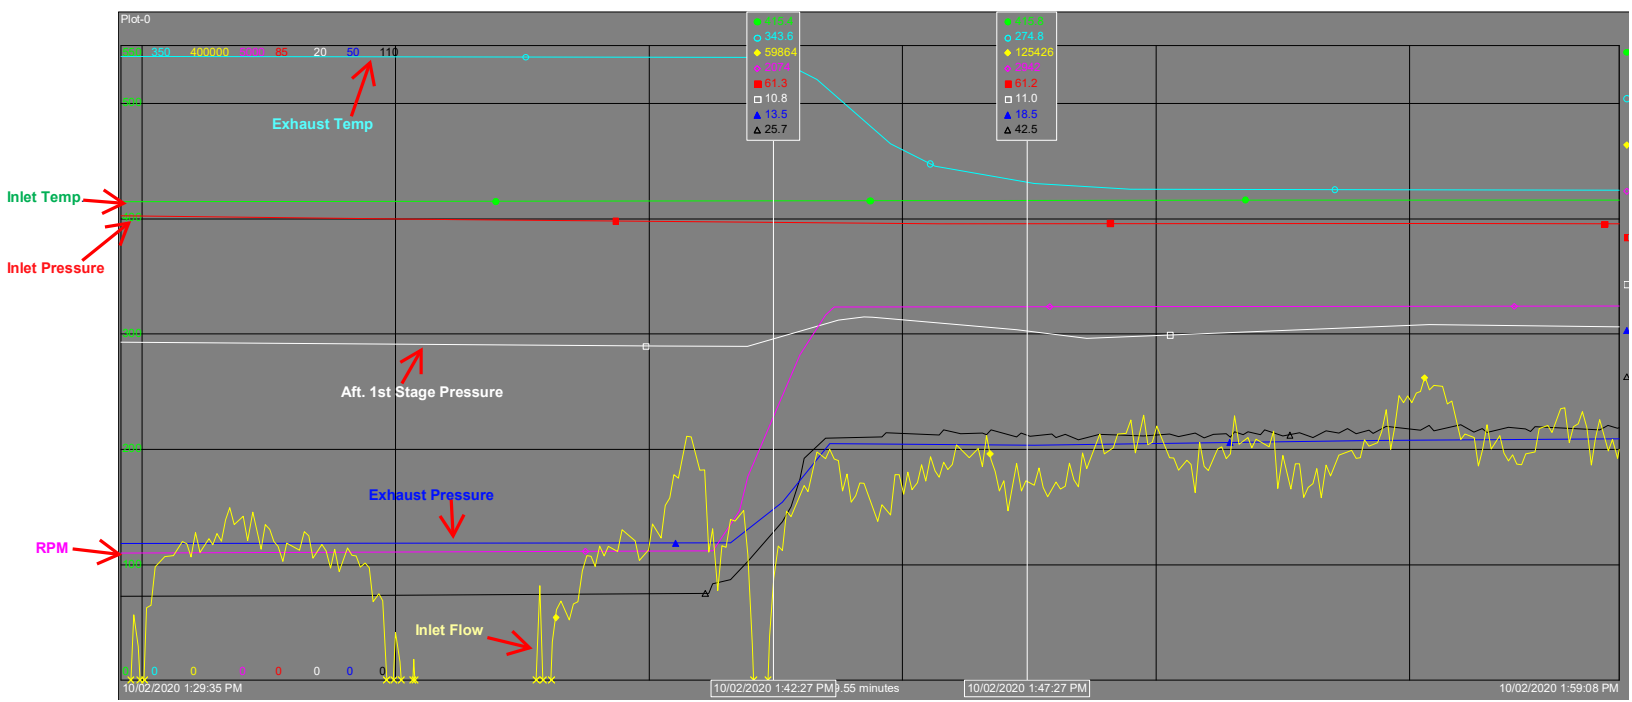

# Annex-III

