


GENERAL NOTES

1. ALL WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS AND IN ACCORDANCE WITH THE LATEST EDITION OF AWS D1.1.
2. THE FOLLOWING MATERIAL DESIGNATIONS SHALL APPLY  
  
W-SHAPES..... ASTM A992 GR 50  
PLATE..... ASTM A36  
ELECTRODES.... E70xx
3. ENSURE THAT EXISTING STEEL IS TEMPORARILY SUPPORTED PRIOR TO PERFORMING THE WORK.

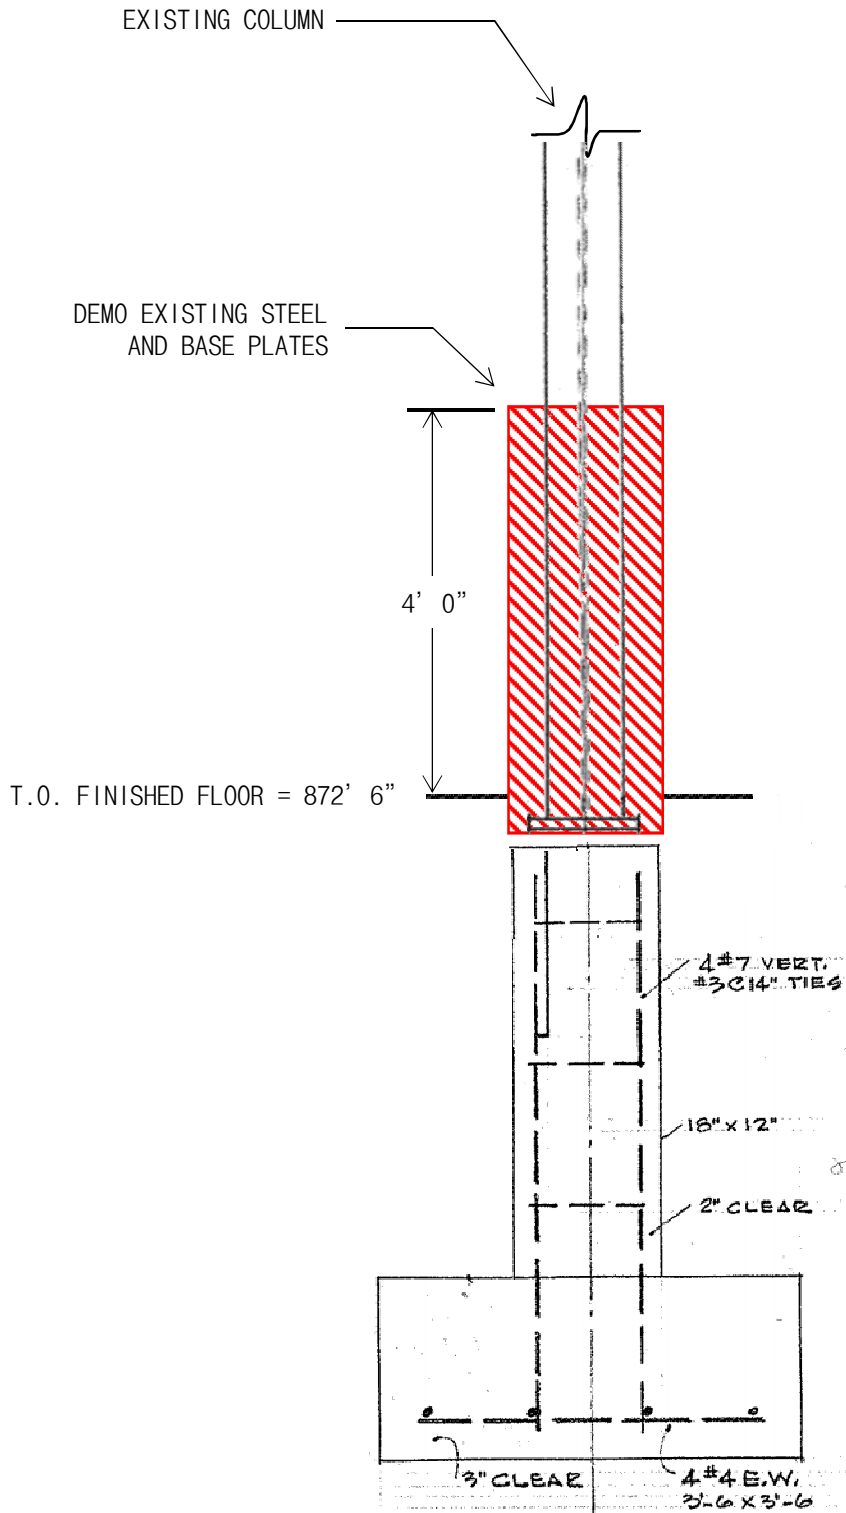

TYPICAL COLUMN REPAIR  
(LOOKING EAST)

FOR  
REFERENCE  
ONLY


GENERAL NOTES

1. ALL WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS AND IN ACCORDANCE WITH THE LATEST EDITION OF AWS D1.1.
2. THE FOLLOWING MATERIAL DESIGNATIONS SHALL APPLY  
  
 W-SHAPES..... ASTM A992 GR 50  
 PLATE..... ASTM A36  
 ELECTRODES.... E70xx
3. ENSURE THAT EXISTING STEEL IS TEMPORARILY SUPPORTED PRIOR TO PERFORMING THE WORK.

INSTALL COLUMN AND BASE PLATE  
NEW BASE PLATE DIMENSIONS TO  
MATCH EXISTING BASE PLATE

CADWELD GROUND  
CABLE 1' ABOVE THE  
COLUMN BASE PLATE

T.O. FINISHED FLOOR = 872' 6"

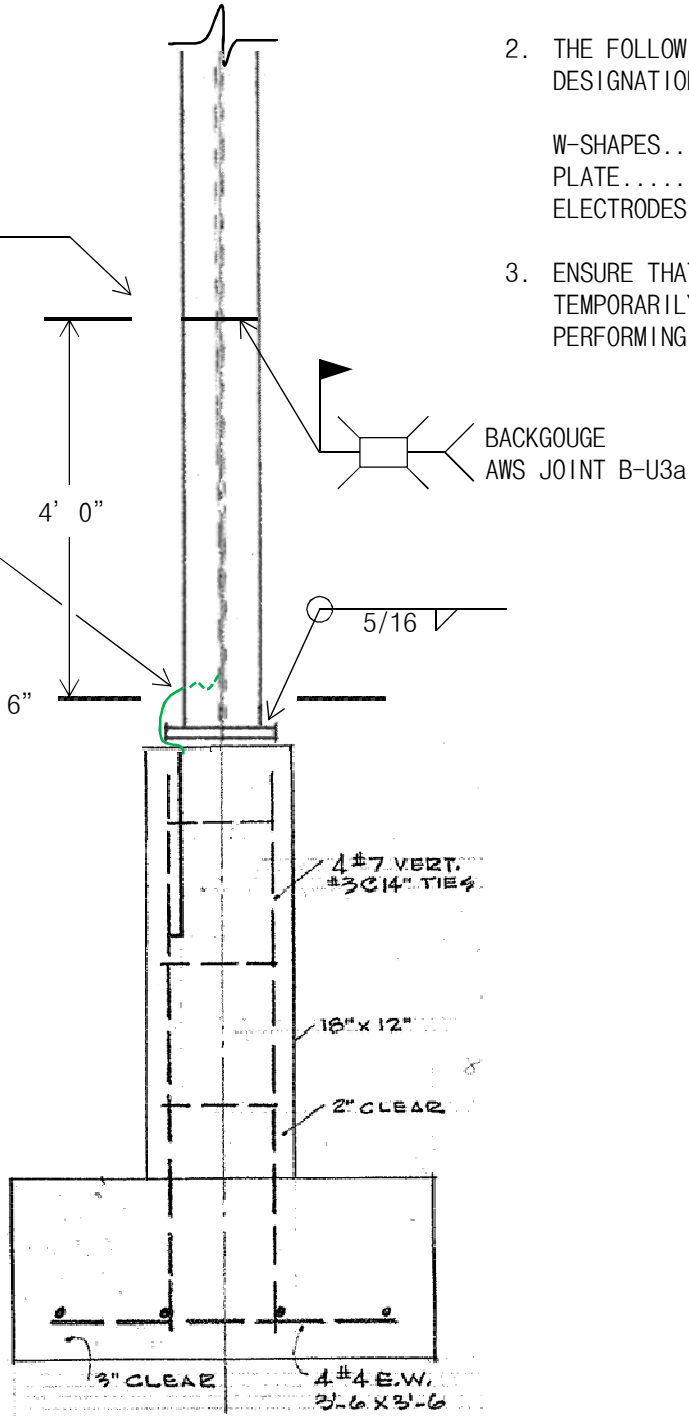

FOR  
REFERENCE  
ONLY

TYPICAL COLUMN REPAIR  
(LOOKING EAST)